

MIN. 6" TOPSOIL TO

ENSURE GRASS GROWTH

IF NOT UNDER PAVEMENT

Bc = OUTSIDE DIAMETER

D = INSIDE DIAMETER

OF THE INSTALLED PIPE

CONTRACTORS NOTES:

d = DEPTH OF BEDDING MATERIAL BELOW

1. ALL BEDDING & INITIAL BACKFILL SHALL BE

INSTALLED IN 6" TO 12" BALANCED LIFTS MIN. 9"

OF CLEARANCE SHALL BE PROVIDED ON EACH SIDE

REINFORCED CONCRETE PIPE (RCP) TRENCH DETAIL

REINFORCED CONCRETE PIPE (RCP) TRENCH DETAIL

5' OR LESS

GREATER 5' FROM EDGE OF PAVEMENT NOT TO SCALE

EDGE OF PAVEMENT,

CURB, GUTTER OR

SIMILAR STRUCTURE

IN THE PUBLIC R/W

"B" BORROW OR EQUIV. GRANULAR -

MATERIAL COMPACTED TO 95%

STANDARD PROCTOR DENSITY.

DEPTH OF BEDDING MATERIAL BELOW PIPE


WITHIN 5' FROM EDGE OF PAVEMENT NOT TO SCALE

27" & SMALLER

30" TO 60"

66" & LARGER

<u>(d) MIN.</u>

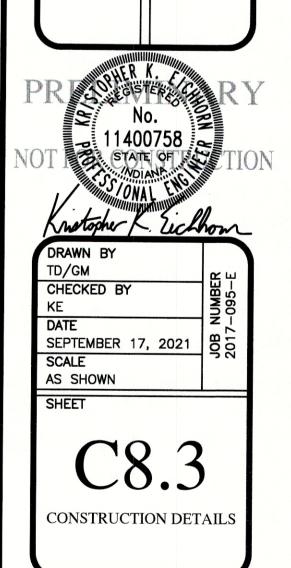

DATE DESCRIPTION

STRU

© 2021