


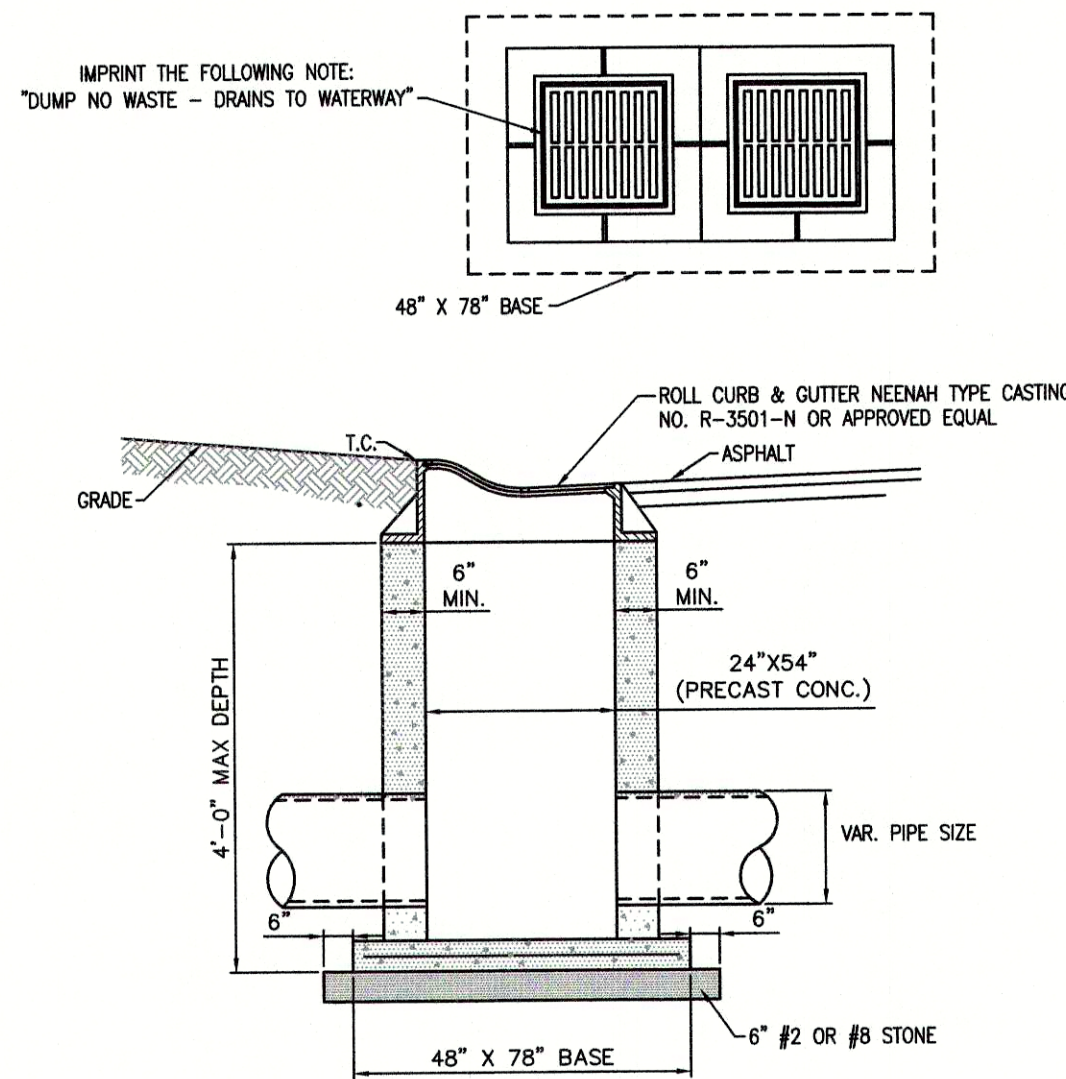
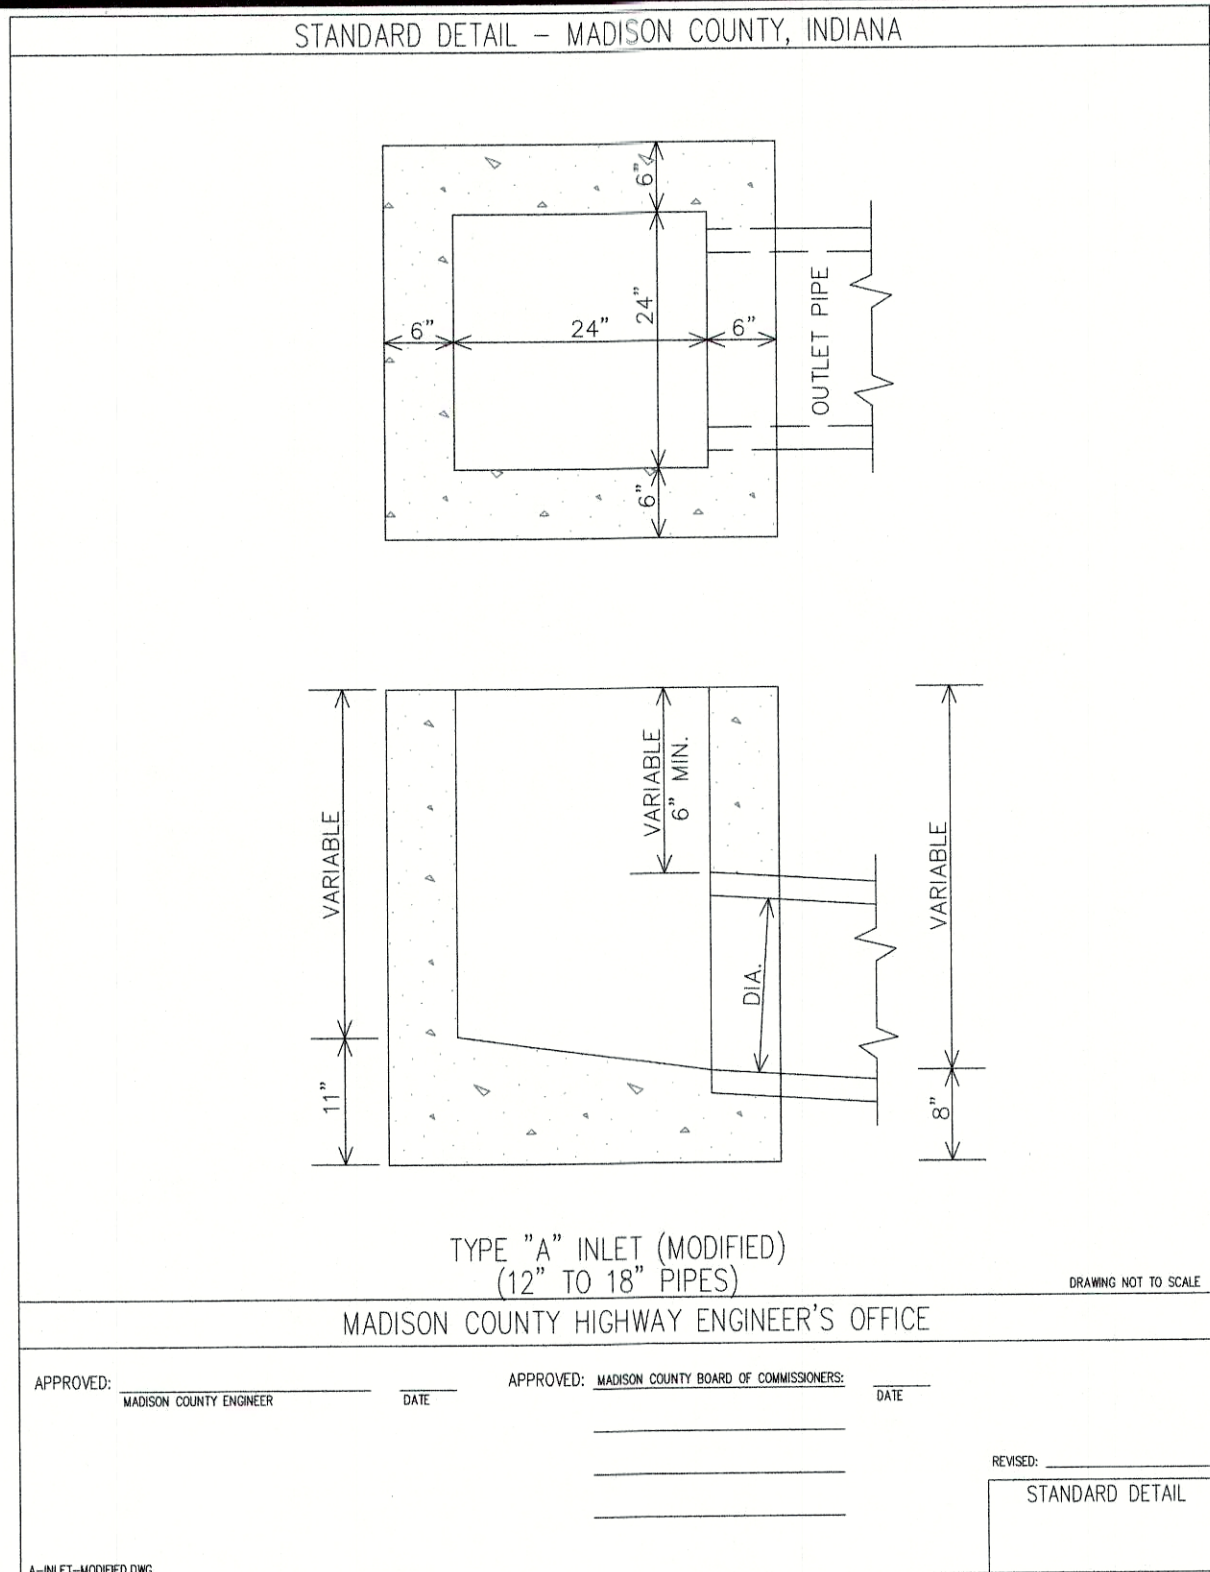
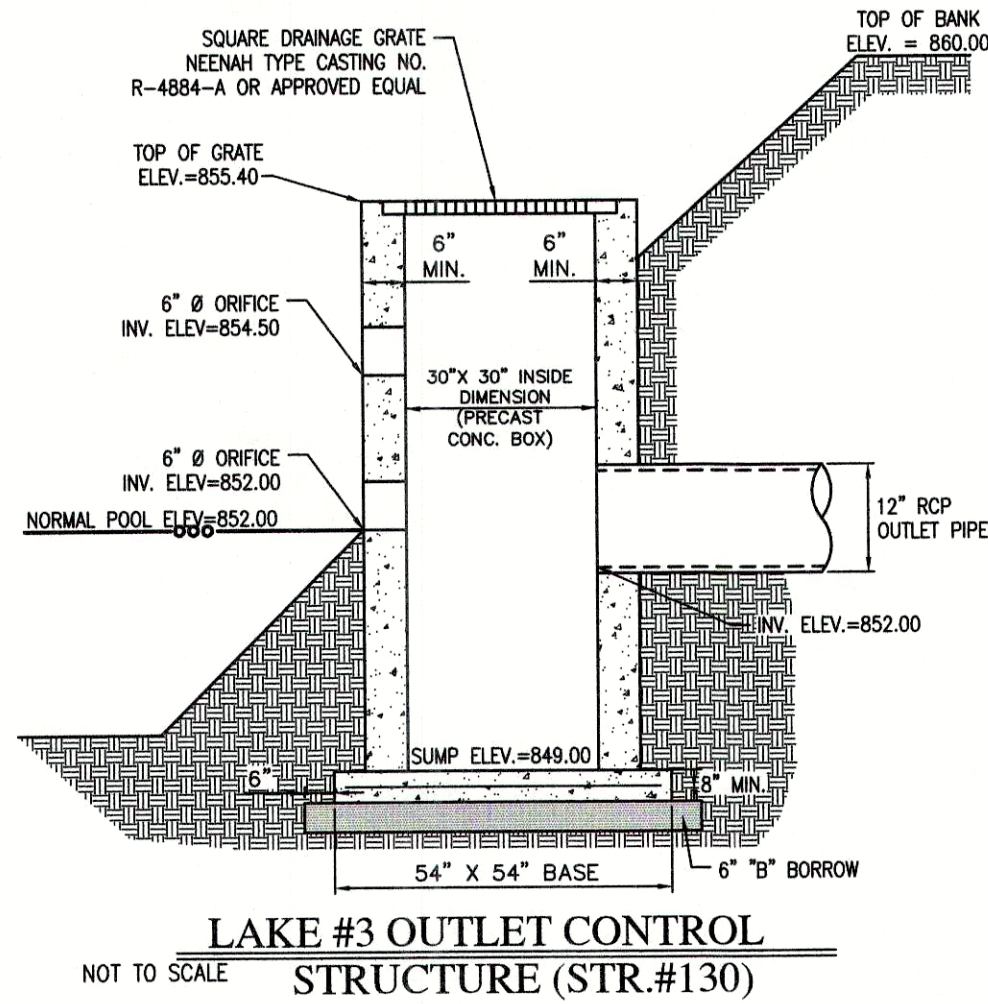
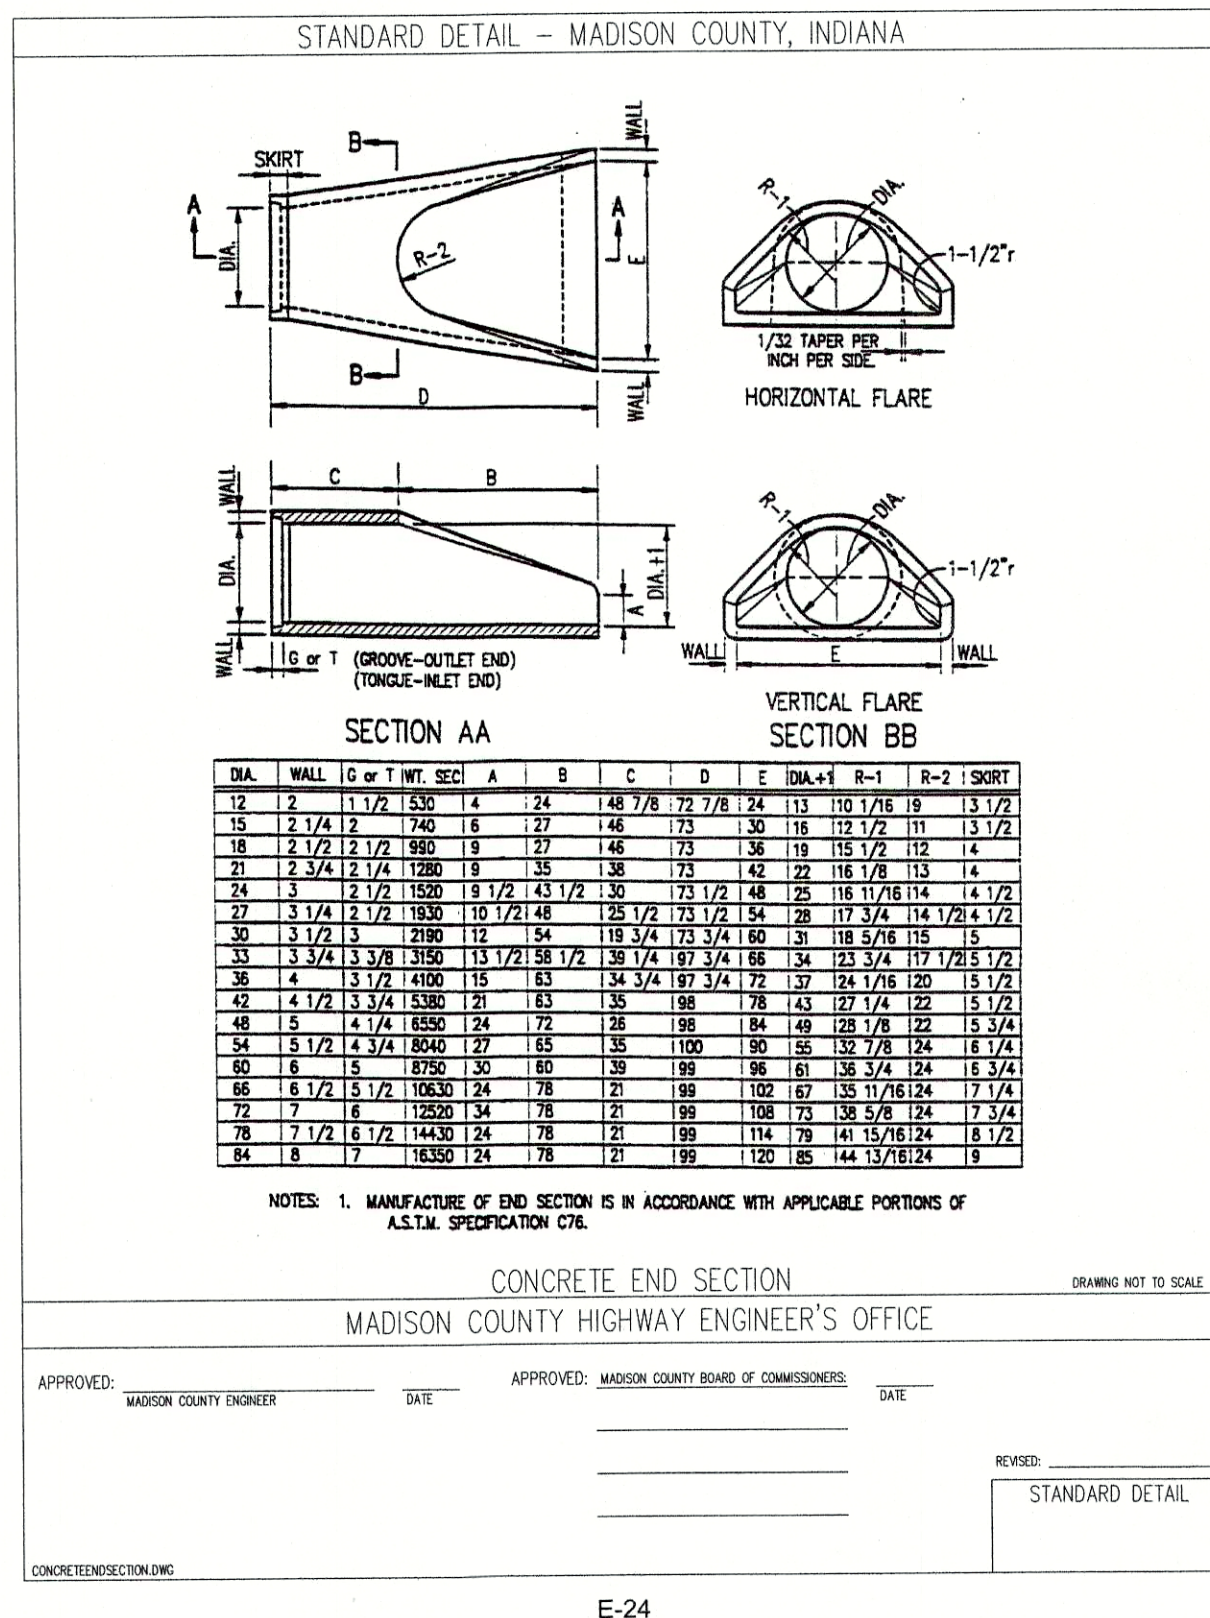
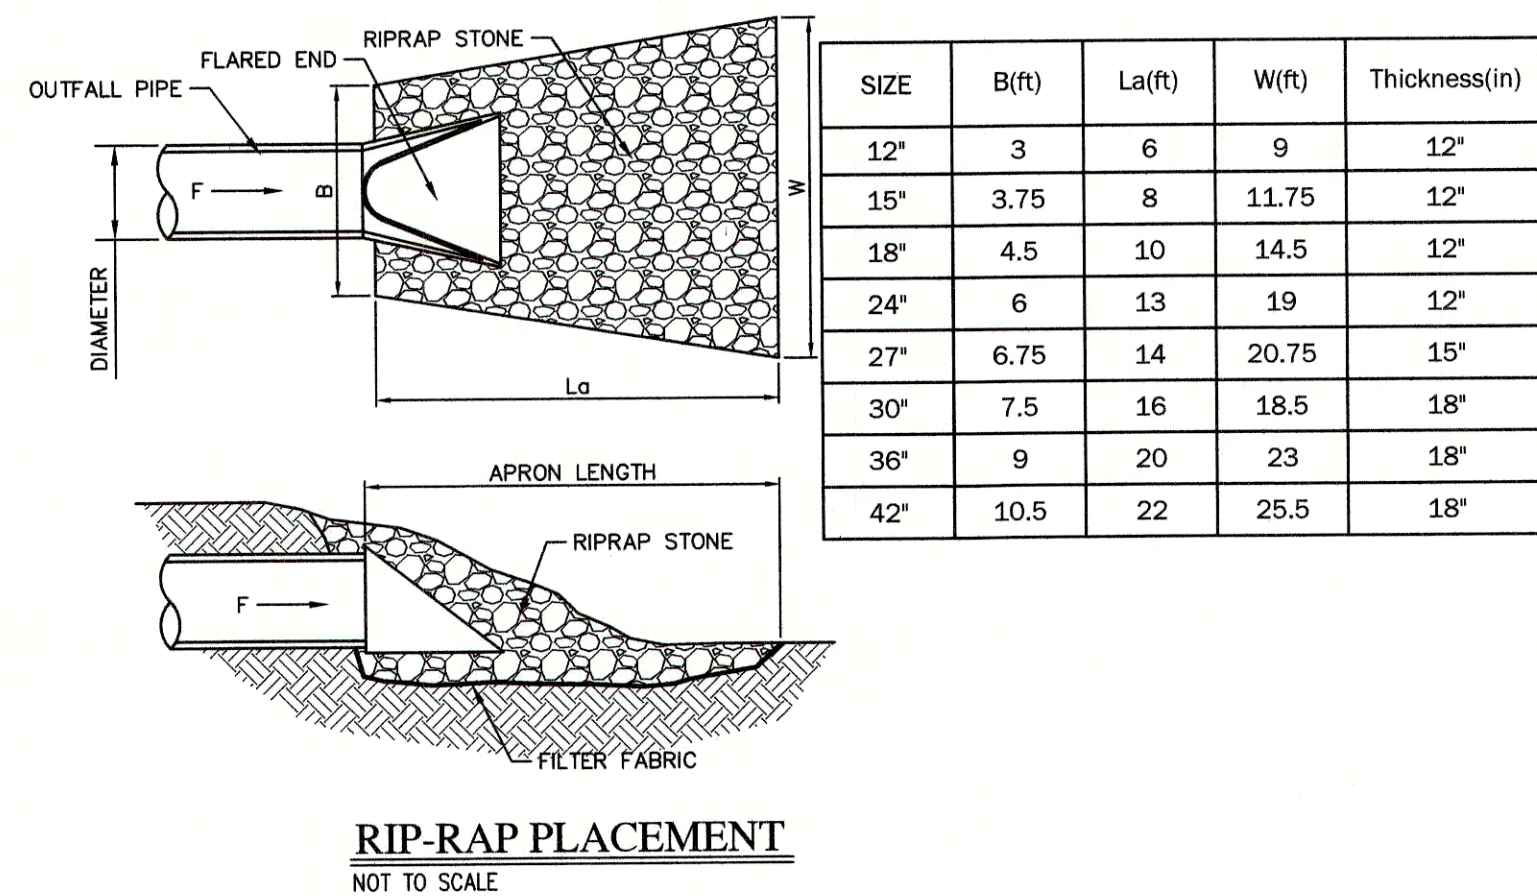
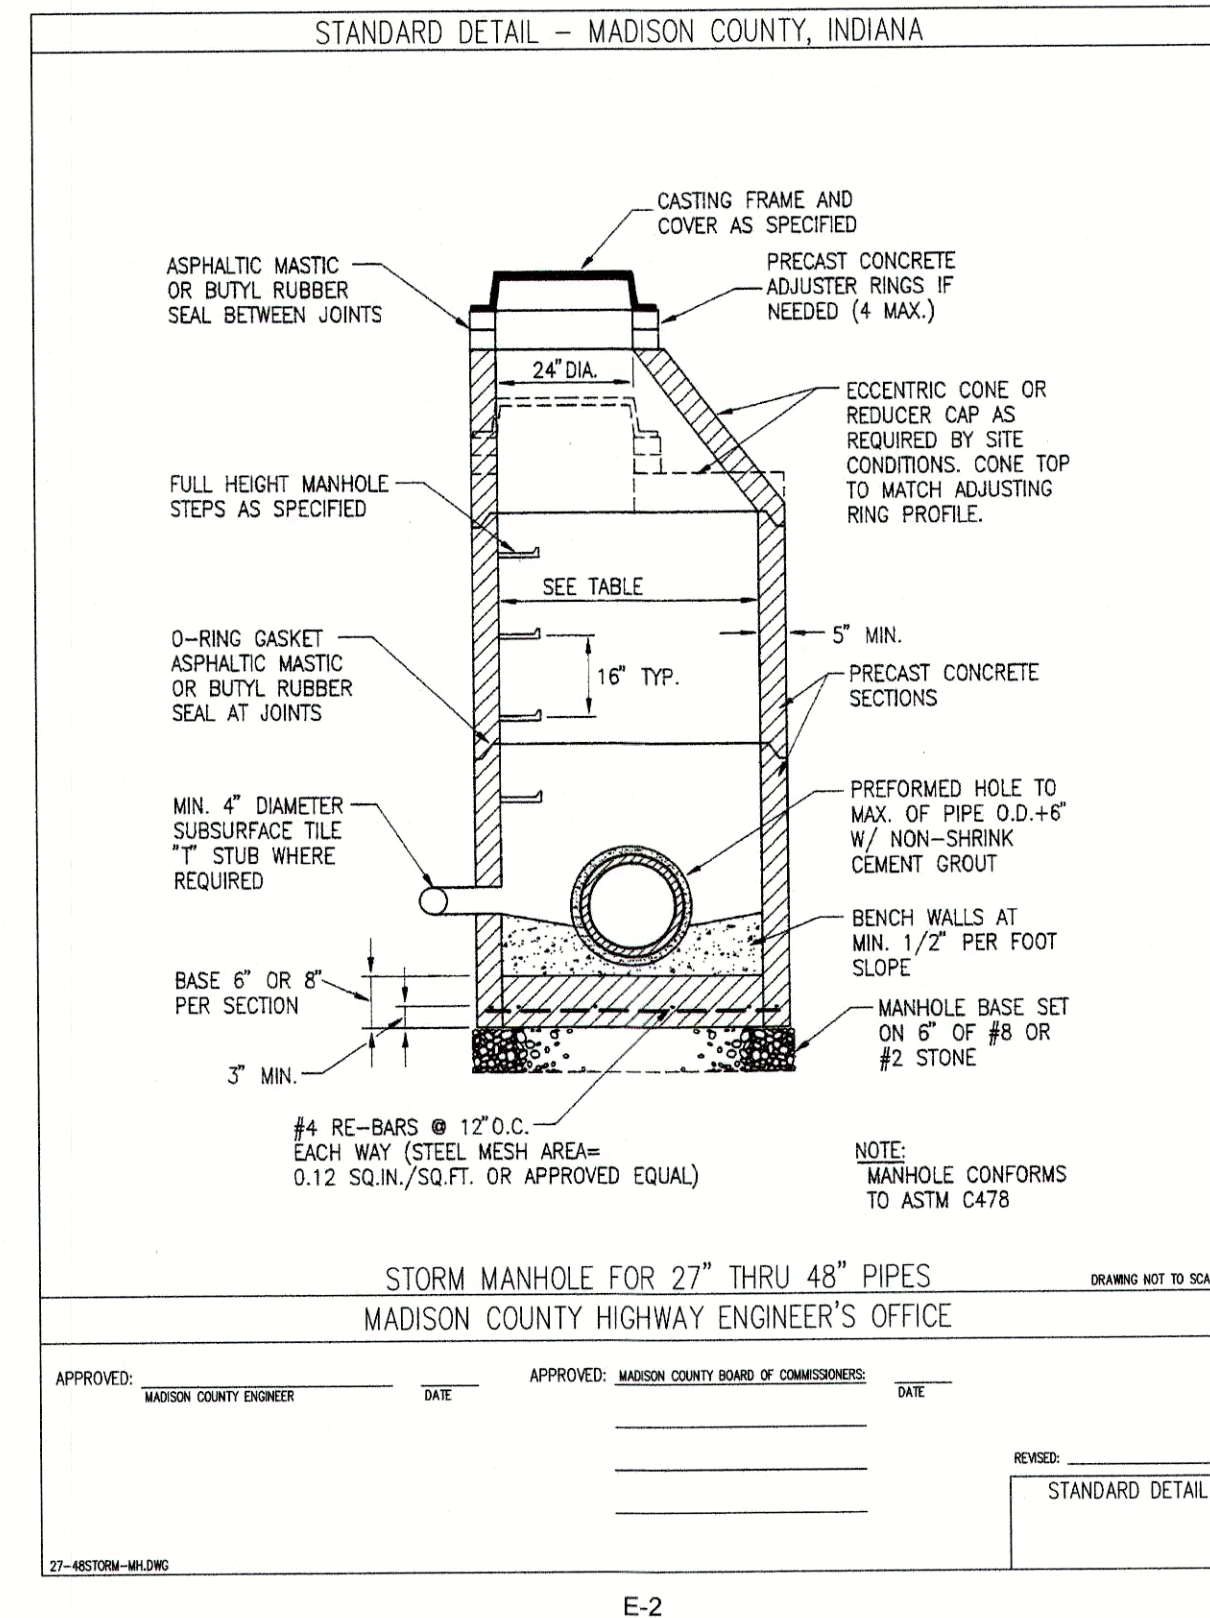


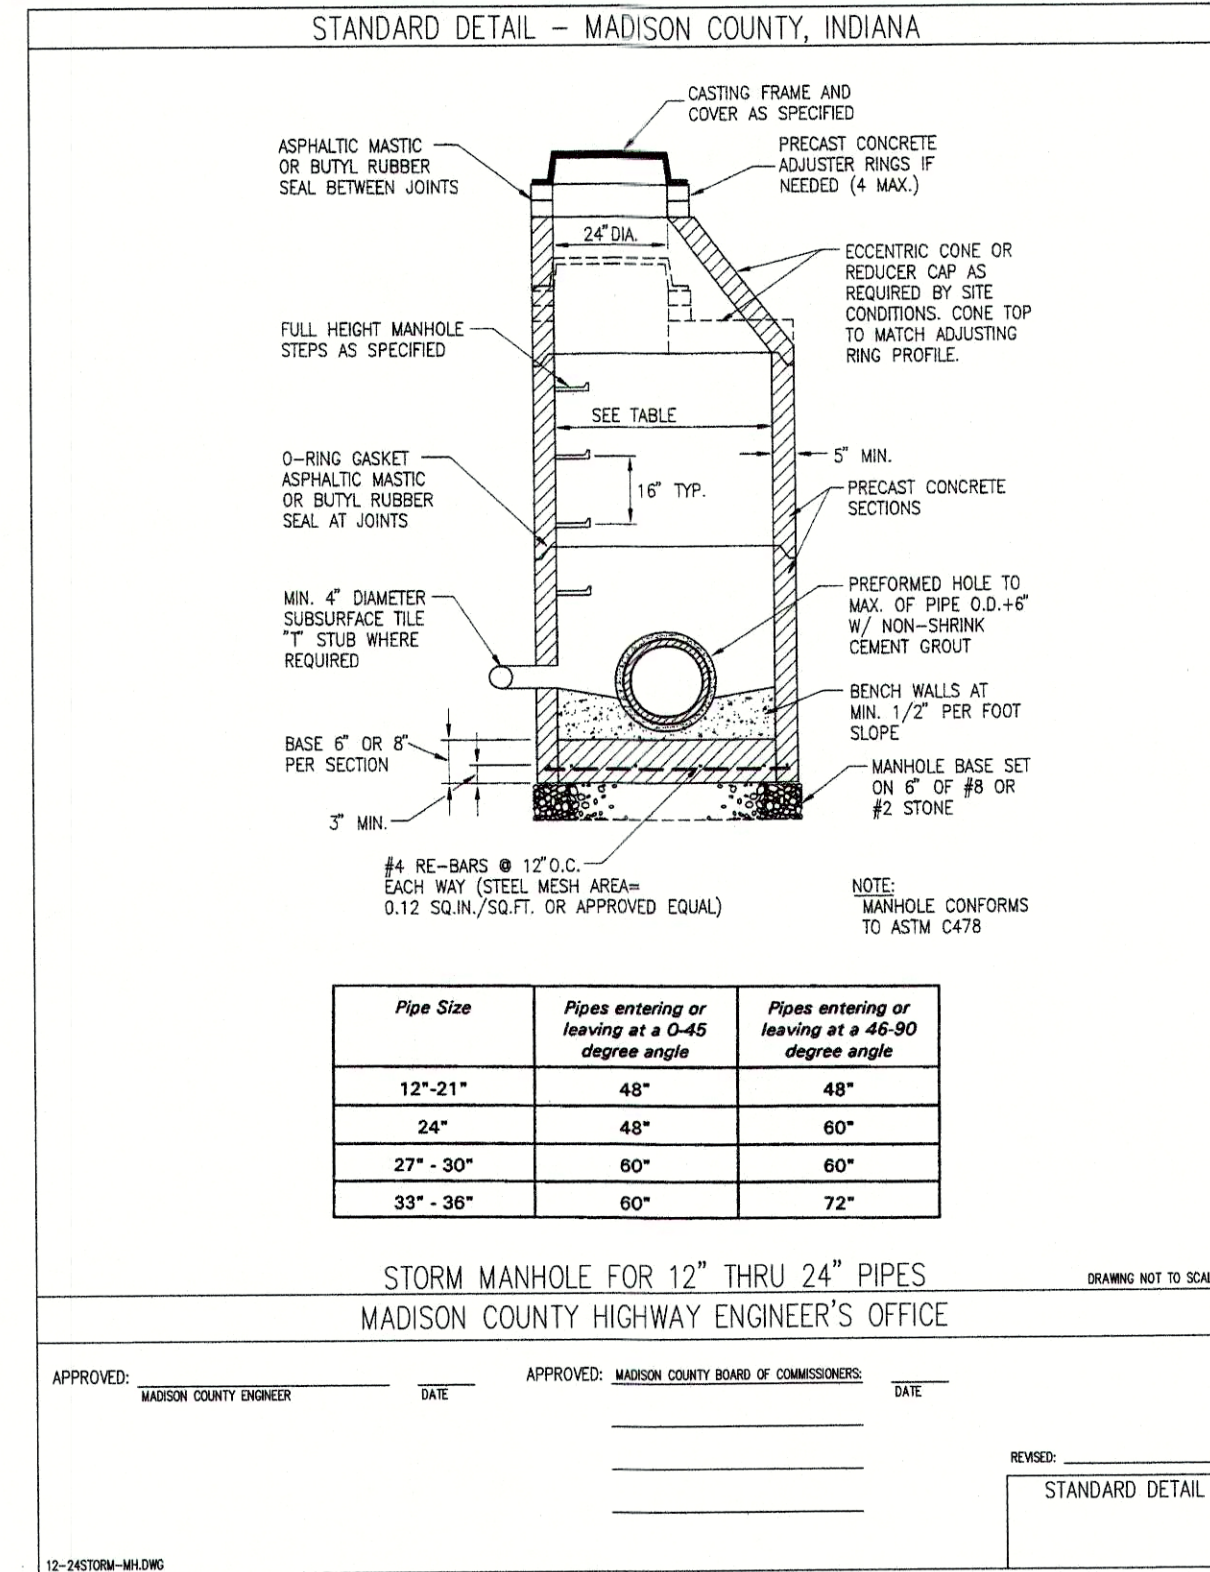

DOUBLE ROLL CURB INLET
NOT TO SCALE

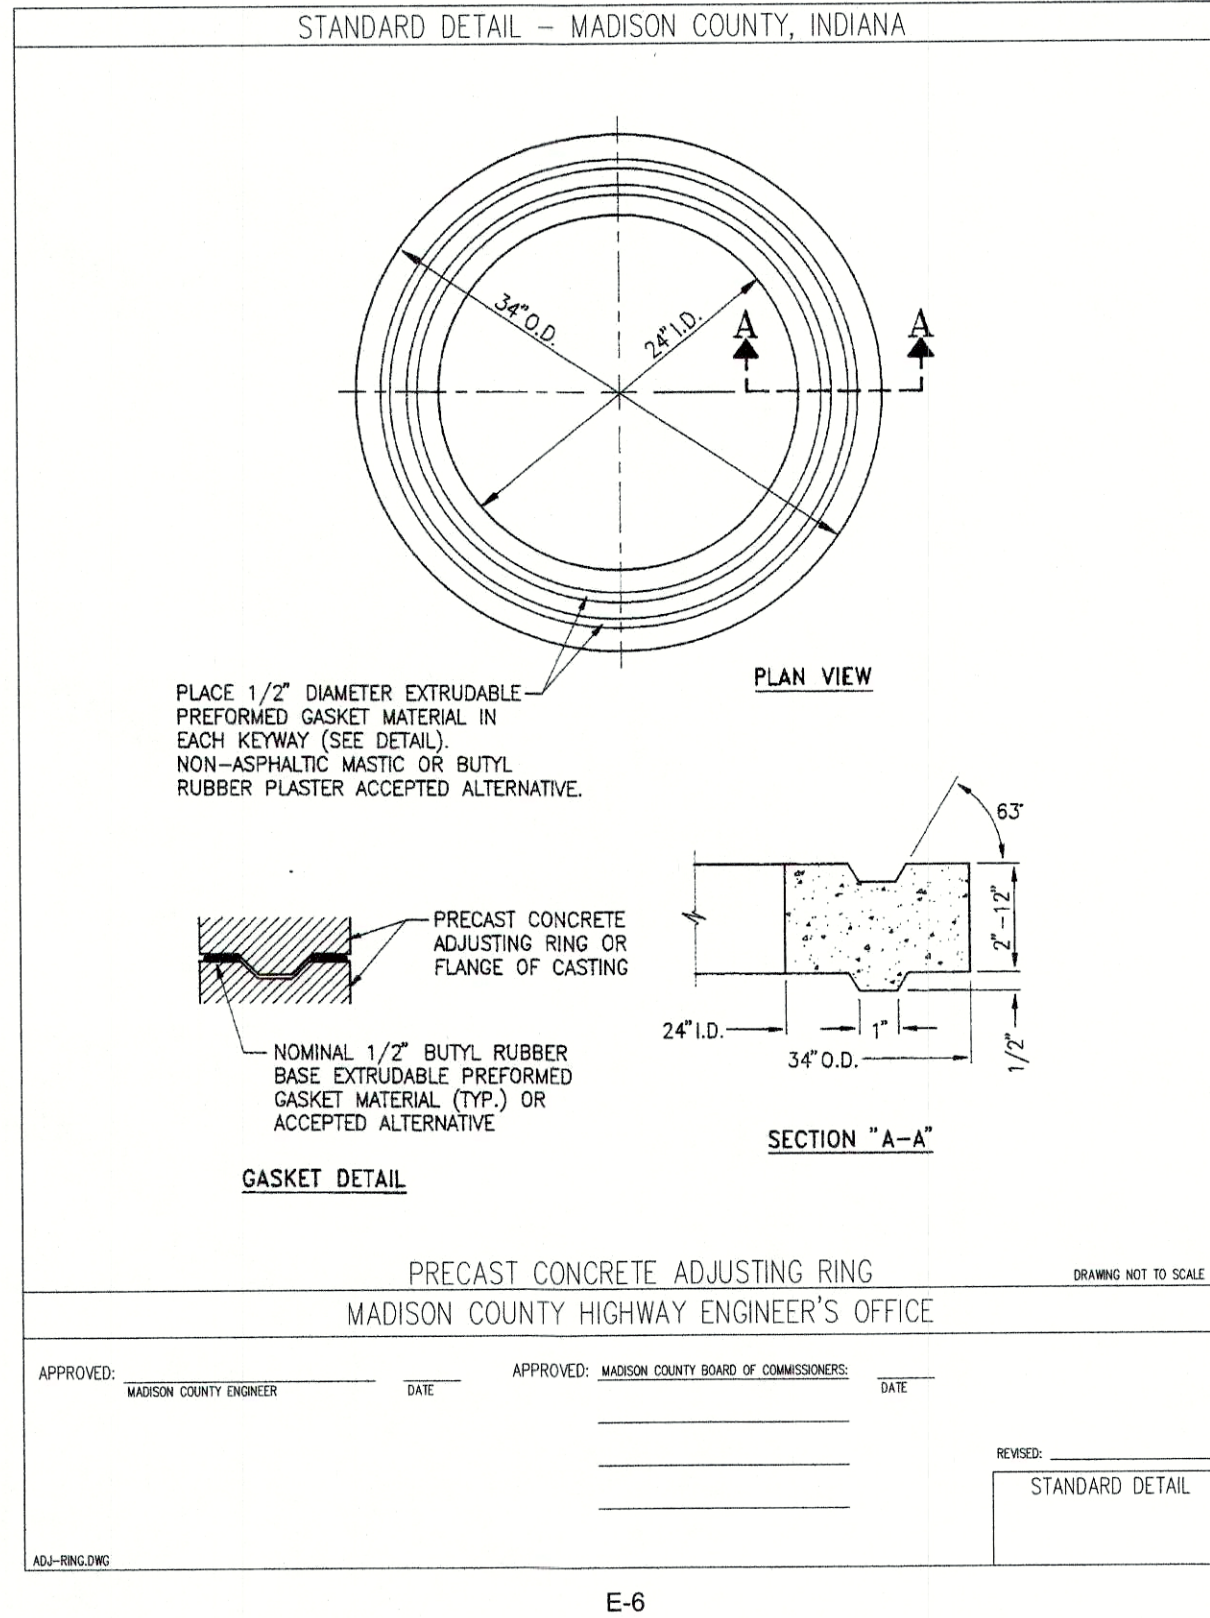


GENERAL NOTE FOR ALL STORM STRUCTURES:
BENCH WALLS SHALL BE SHAPED AND FORMED FOR A CLEAN TRANSITION WITH PROPER HYDRAULICS TO ALLOW THE SMOOTH TRANSITION OF FLOW THROUGH THE MANHOLE OR BOX INLET. THE BENCH WALL SHALL FORM A DEFINED CHANNEL, TO A MINIMUM HEIGHT OF 80-PERCENT OF THE INSIDE DIAMETER OF THE INLET AND OUTLET PIPES TO FORM A 1/2" SHAPED CHANNEL, CONSTRUCTED AT A MINIMUM 1/4" EACH PER FOOT SLOPE TO THE MANHOLE WALL.

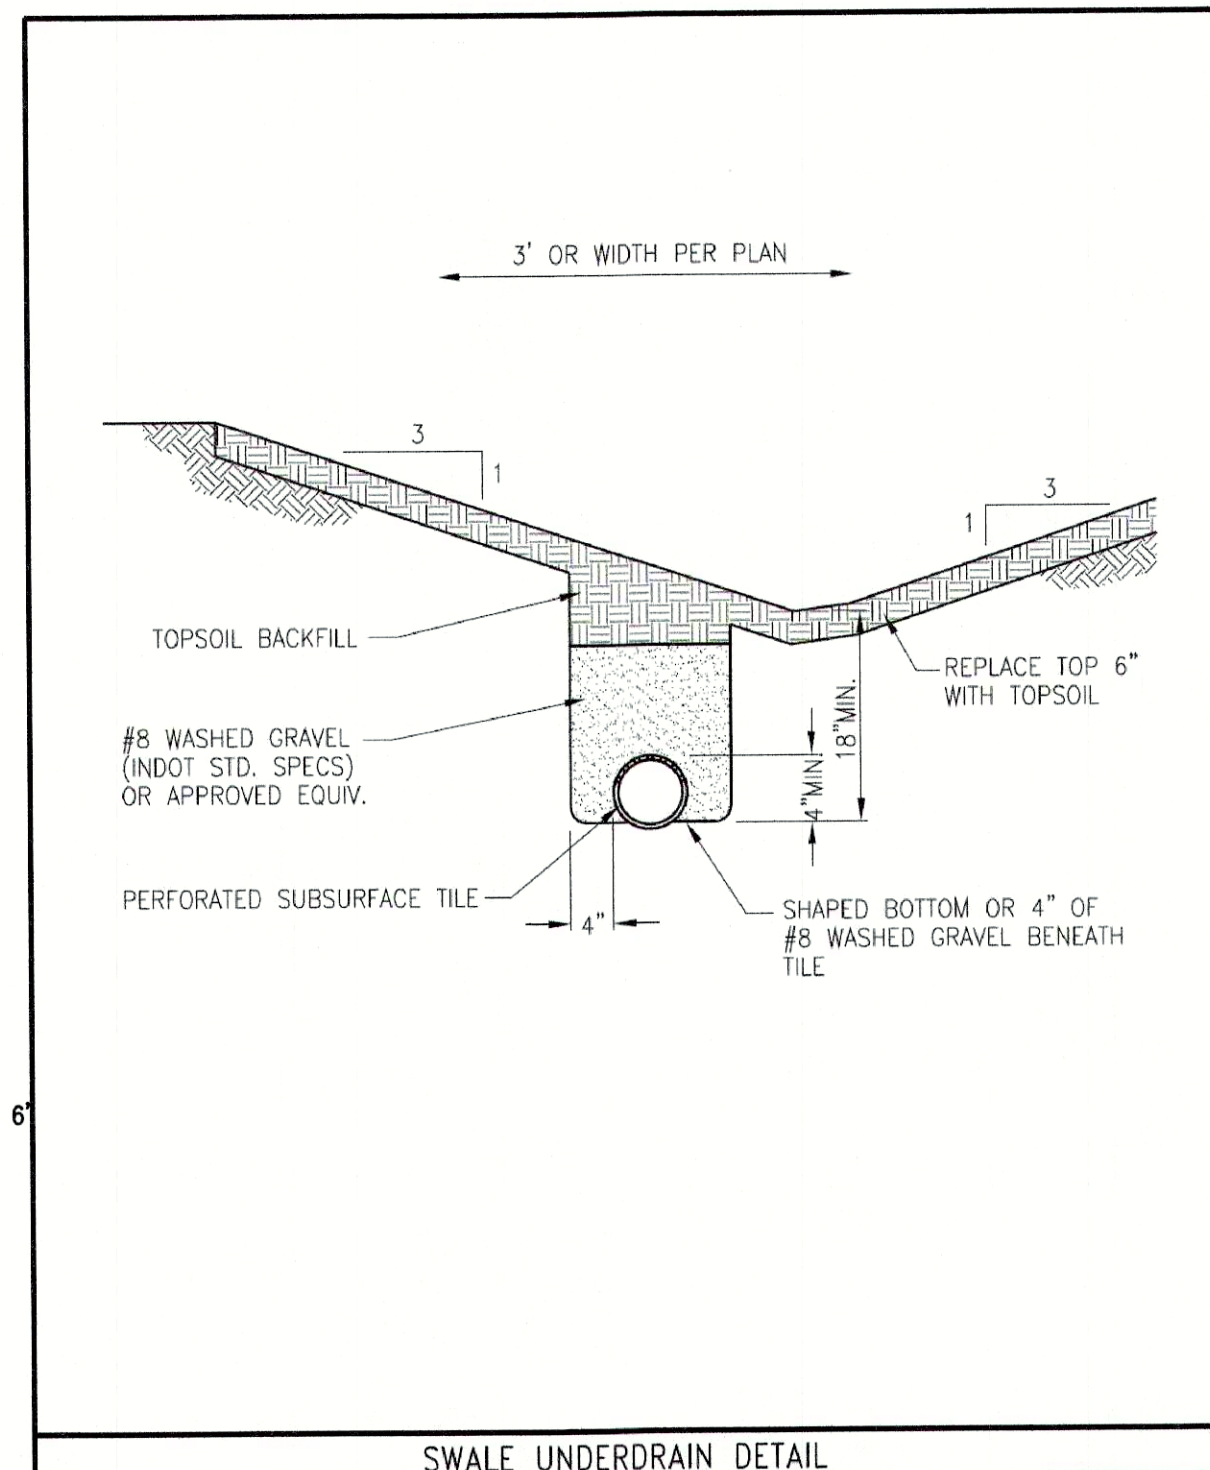

REVISIONS		
DATE	DESCRIPTION	BY



SPRINGBROOK
SECTION 6
CONSTRUCTION DETAILS

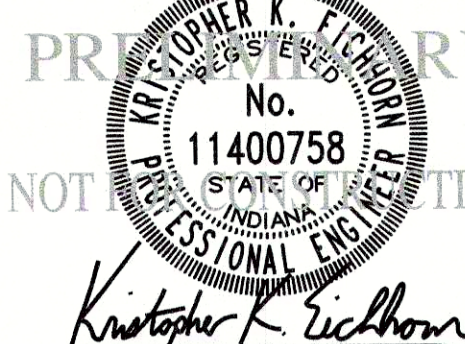

DRAWN BY: TS/TO/GM/EW
CHECKED BY: KE
DATE: SEPTEMBER 14, 2021
SCALE: AS SHOWN
SHEET

JOB NUMBER: 2017-271-F

C8.4
CONSTRUCTION DETAILS