


CABINET TO BE CONNECTED TO A GOOD GROUND.
 230VOLTS SINGLE PHASE 60 HZ DUPLEX

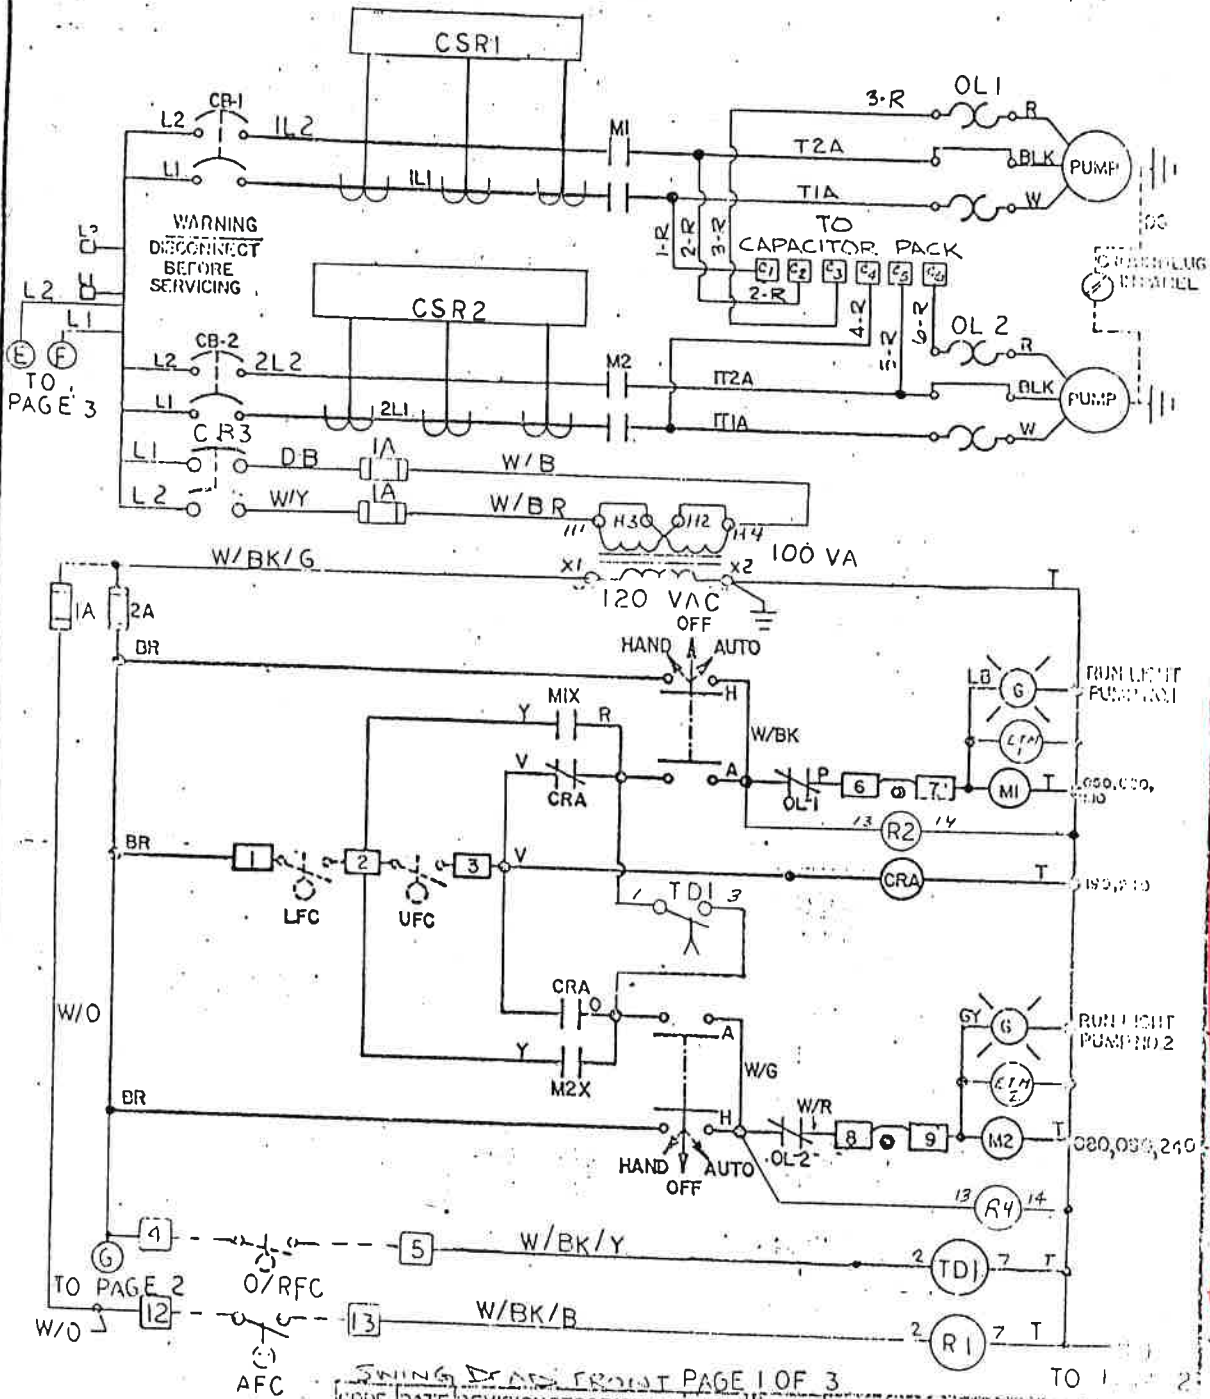

SWING DATE FROM PAGE 1 OF 3

CODE	DATE	REVISION	DESCRIPTION	INITIAL	CODE	DATE	REVISION	DESCRIPTION	INITIAL
A	6-1-74	REL.	SPR 2821	JEC					
B	7-2-85	CHG	R2 & R4	WJW					

NOTES:
 LFC LOW WATER FLOAT CONTROL NO. 3900
 UFC UNDER FLOAT CONTROL NO. 3900
 AFC ABOVE FLOAT CONTROL NO. 3900
 O/RFC OVER FLOAT CONTROL NO. 3900

W/BK - COLORS USED
 (X) REMOVE JUMPER FOR HEAT SENSOR

HYDR-O-MATIC	
LINE VOLTAGE	230
CONTROL VOLTAGE	12
HORSEPOWER RANGE	
TYPE OF BOX	MA 4
CONTROL BOX	HP
TYPE OF PUMP	
PUMP MODEL	
DRAWN	DATE 6-1-74
CHECKED	DATE 7-2-85

RMHP / 550 / Falcon H.

FROM PAGE 1





-  - SEAL FAILURE PROBE
HOOK-UP (PUMP 1)
-  - SEAL FAILURE PROBE
HOOK UP (PUMP 2)

SWING DEAD FRONT

PAGE 2 OF 3

[illegible]

HYDRA-O-MATIC
PUMPS

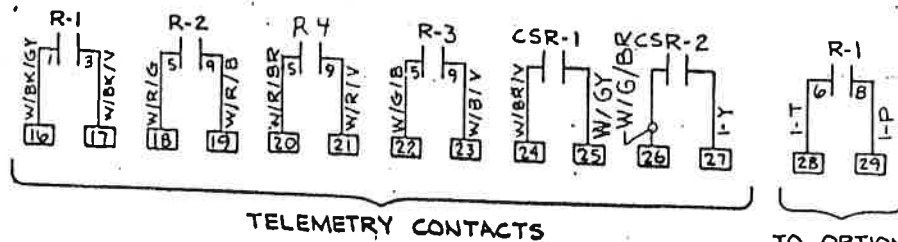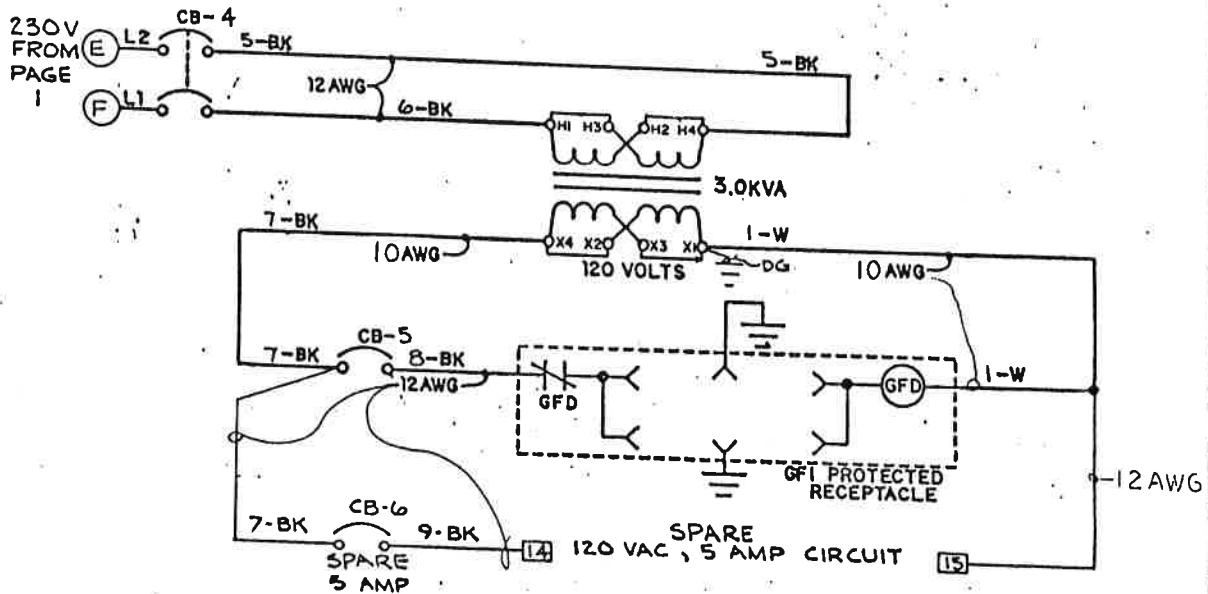

TELEMETRY LEGEND

RELAY	FUNCTION
R-1	HIGH WATER ALARM
R-2	NO.1 PUMP CALL
R-4	NO.2 PUMP CALL
R-3	SEAL FAILURE (COMMON)
CSR-1	PUMP NO.1 RUN
CSR-2	PUMP NO.2 RUN

SWING DEAD FRONT PAGE 3 OF 3

CODE	DATE	REVISION	DESCRIPTION	INITIALS	CODE	DATE	REVISION	DESCRIPTION	INITIALS
A	5-9-84	REL. SPR	2821	JEC					
B	9-3-85	CHG R-2 & R-4	CONNECT	WGC					

LINE VOLTAGE	230	1 PHASE
CONTROL VOLTAGE	120	
HORSEPOWER RANGE		
TYPE OF HOX-NEMA	1	SIZE
CONTROL BOX N°		
TYPE OF PUMP		
PUMP MODEL		
DRAWN	JEC	DATE 5-7-84
CHECKED	SN	DATE 5-14-84

35970-002-1