


NOTES:

- ① FLOAT TERMINALS ARE FOR FUTURE USE.
- ② REMOVE WIRE FROM TERMINALS 2 AND 17 FOR FLOAT OPERATION.


REV. NO.	REVISION	BY	DATE	DESIGNED BY:	DATE	BBC
		CHK'D		NB	7/11	
				DRAWN BY:	DATE	PUMP AND EQUIPMENT COMPANY, Inc. 1125 W. 16th St. P.O. BOX 22098 Indianapolis, Indiana 46222 317/636-1111
				KS	00	
				CHECKED BY:	DATE	DESCRIPTION FALL CREEK RWD MADISON TRACE
				SCALE		DWG. NO. AAC 16111
						JOB NO.

NEMA 4X STAINLESS STEEL ENCLOSURE
60"H x 36"W x 12"DP
OUTER DOOR NOT SHOWN

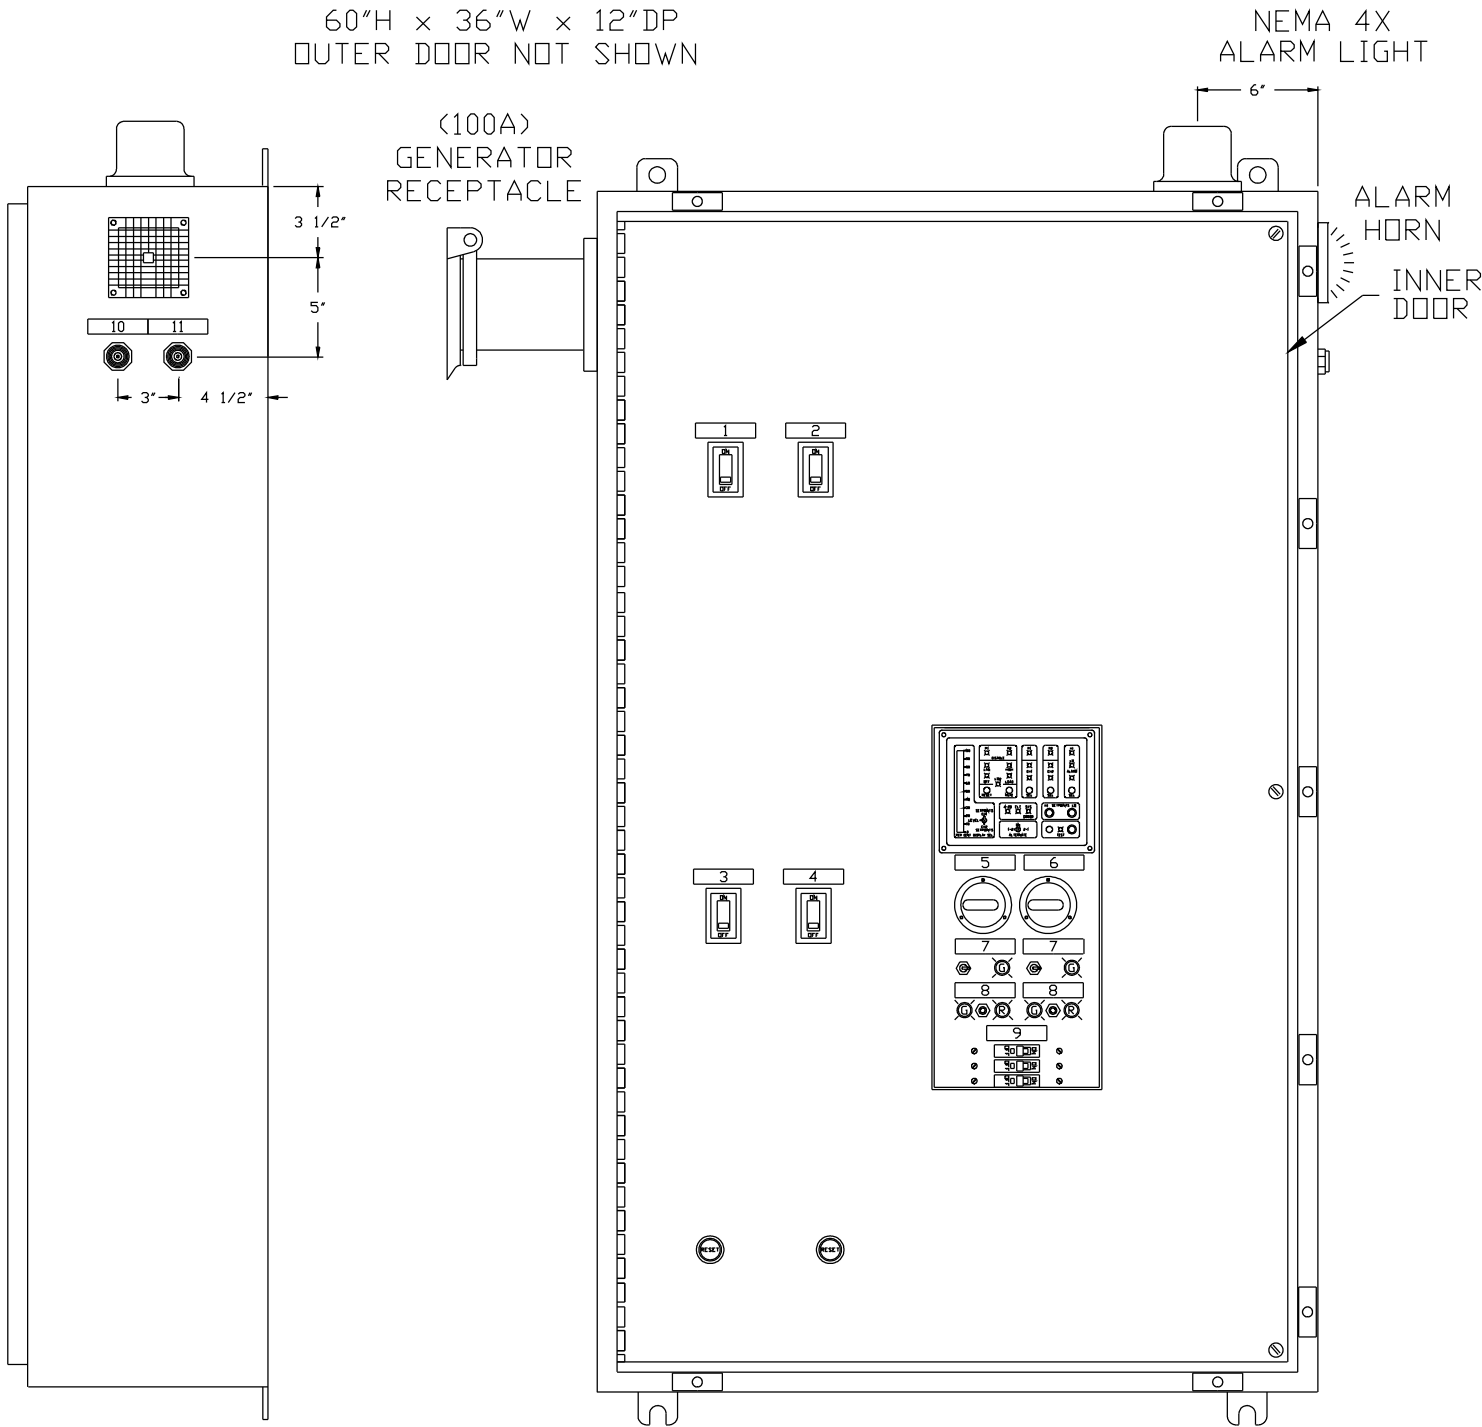

SIDE VIEW

BACK PANEL LAYOUT
57"H x 33"W

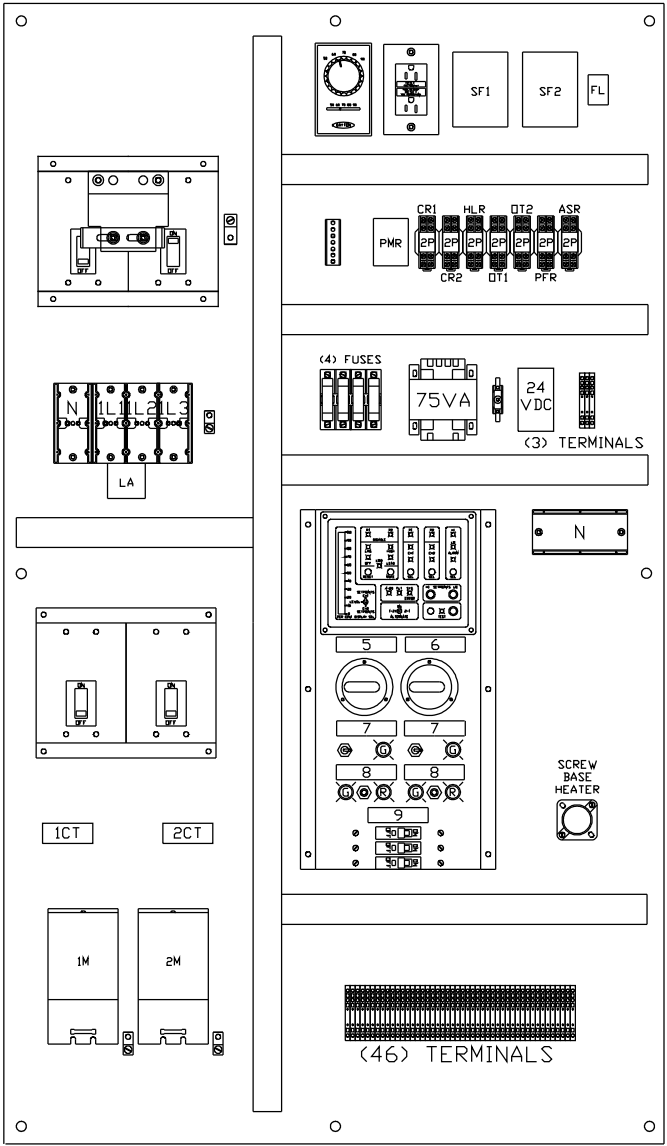

NAMEPLATE LEGEND

- 1. EMERGENCY
- 2. NORMAL
- 3. PUMP 1
- 4. PUMP 2
- 5. PUMP 1 RTM
- 6. PUMP 2 RTM
- 7. HOA RUN
- 8. NORAML TEST FAIL
- 9. CONTROL/CONVENIENCE/TELEMETRY
- 10. ALARM TEST
- 11. ALARM SILENCE

REV. NO.	REVISION	BY	DATE	DESIGNED BY:	DATE	<div><div>BBC</div><div>PUMP AND EQUIPMENT COMPANY, Inc. 1125 W. 16th St. P.O. BOX 22098 Indianapolis, Indiana 46222 317/636-1111</div></div>		
		CHK'D		NB	7/11			
				DRAWN BY:	DATE			
				KS	00			
				CHECKED BY:	DATE	DESCRIPTION		
						FALL CREEK RWD MADISON TRACE		
				SCALE		DWG. NO.	PNL 16111	JOB NO.

USEMCO, Inc.
Bill of Material
16111/1

7/11/00 1:02 PM
Page 2

16111/1
Fall Creek RWD-Madison Trace

Detail	Quantity
----423441.1 BLOCK 3PL LINE #2/0 LOAD #4 2 LINE 6 LOAD MARATHON #1433555	1.00
----423480.2 SOCKET RD 8 PIN IDEC SR2P-06	1.00
----423484 SOCKET MIDGET 2P IDEC SH2B-05	7.00
----423502 THERMOSTAT 15A SPDT WWG #2E158	1.00
----423835 OVERLOAD SQD #AR35 AMBIENT COMPENSATED	6.00
----424164 INTERLOCK CIRCUIT BREAKER-FAL	1.00
----425079 FLASHER 120VAC SSAC #FS127	1.00
----425204 RTM REDINGTON 120VAC #711-0165	2.00
----425363 TRNSFMR 75VA SQD 9070 T75D13 120 VAC PRIMARY 12/24 VAC SECONDARY	1.00
----425390 TRNSFMR CURRENT SQD 2NR500 50:5 RATIO	2.00
----426000 FUSE 250V ONE-TIME 1 AMP CLASS K5 50,000 A.I.R. 2" LONG x 9/16" DIAMETER (BUSSMANN NON-1) (LITTELFUSE NLN-1) (GOULD-SHAWMUT OT-1)	3.00
----426104 FUSE 250V TIME-DELAY 3 AMP CLASS RK5 200,000 A.I.R. 2" LONG x 9/16" DIAMETER (BUSSMANN FRN-R3) (LITTELFUSE FLN-R3) (GOULD-SHAWMUT TR-3R)	1.00
----426521 BLOCK FUSE MARATHON F30A1S	1.00
----426522 BLOCK FUSE MARATHON F30A3S	1.00
----426525 BLOCK FUSE LITTELFUSE 354812GY	1.00
----428905.1 WIRE DUCT BASE 1.5" X 3"	8.00
----428908.1 WIRE DUCT COVER 1.5"	8.00
----429094.04 DECAL USEMCO 2"x3" MADE IN USA	1.00
----429105 DECAL USEMCO LIMITED WARRANTY	1.00
----445040.1 FUSE SLO BLO 2A 250V LITTELFUSE #313002 3AG	1.00
----460600 NIPPLE CHASE T&B 842 1/2"	1.00
----461022 BSHNG KNOCKOUT T&B #3210 1/2"	1.00
----462003 BOX JUNCTION 2x4 RACO 670 OR STEEL CITY 583711/2 GRAINGER # 4A239	1.00
----462006 BOX C/AL 2x4 RED DOT IH3-1-LM	1.00
----462340.20 RECEIPT CROUSE-HINDS AR1041-S22 100 AMP 4 WIRE 4 POLE	1.00

USEMCO, Inc.
Bill of Material
16111/1

7/11/00 1:02 PM
Page 3

16111/1

Fall Creek RWD-Madison Trace

Detail	Quantity
----462357 RECEPT GFI 15A 120V P&S 1591RI	1.00
----462851 ENCL N4X SNGL HOF A60H3612SSLP	1.00
----463224 ENCL BP HOF A60P36	1.00
----469004 LUG ALUM SOLDERLESS MAX. #2	4.00
ILSCO TA-2, BLACKBURN ADR-2, BRUNDY KA2U OR EQUAL	
----469070 HEATER PANEL 120V CHRO SCB-100	1.00
----469071 LAMPHOLDER PORCELAIN KEYLESS	1.00
ANGELLO #22273	
----470401 SWITCH TOG SPDT 3 POS #91-0003	2.00
10 AMP ON OFF ON MC GILL	
----470500.1 SWITCH PB SQD 9001 SKR-1U	2.00
----470561 SWITCH PB NO CARLINGSWITCH #172	2.00
OR SELECTA SWITCH #SS228BG	
----472081 BLOCK CONTACT SQD 9001 KA2	2.00
----480110.10 LIGHT IND #930-505X-710RN-120	2.00
SCREW TYPE LUG LITTELFUSE	
----480111.10 LIGHT IND #930-505X-710GN-120	4.00
SCREW TYPE LUG LITTELFUSE	
----500549.606 FLANGE, INNER DOOR 55"x 3.5"	1.00
----500570 INNERDOOR 60x36x08 N4&12 12"DP	1.00
----500584.17 STANDOFF 2FAL3P FOR 8" DEPTH	1.00
----500584.20 STANDOFF FAL INTERLOCK - 8"	1.00
----500587.05 STANDOFF "INDY" DIGITAL FOR 8" DEPTH	1.00