




NEMA 4X STAINLESS STEEL ENCLOSURE 42"H X 30"W X 10"DP DUTER DOOR NOT SHOWN

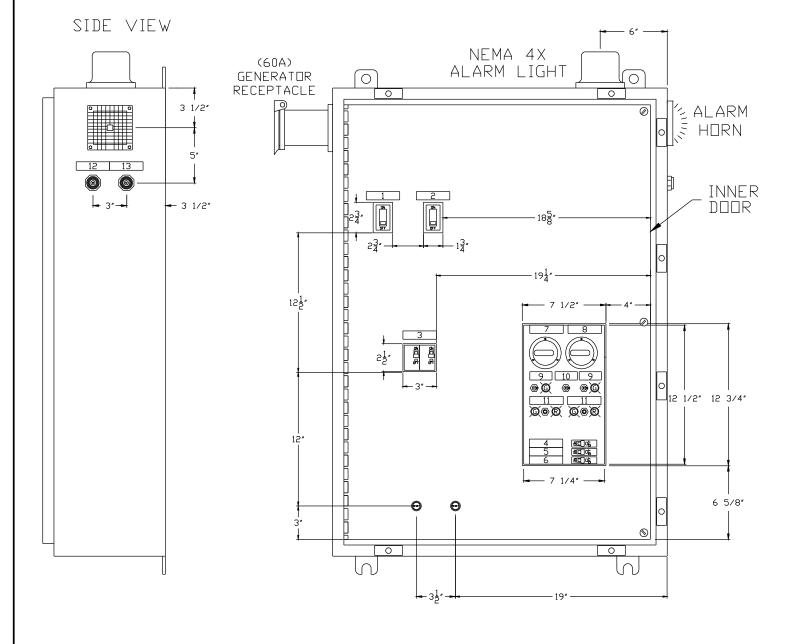

BACK PANEL LAYOUT 39"H X 27"W

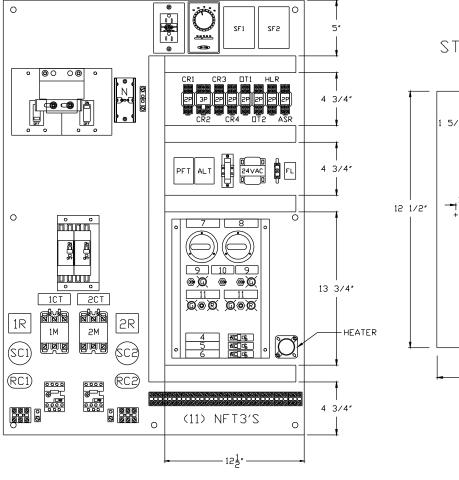

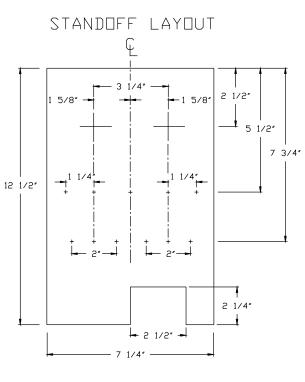

NAMEPLATE LEGEND

- 1. EMERGENCY
- 2. NORMAL

- 9. HOA RUN
- 3. PUMP 1 PUMP 2
- 10.1-2 AUTO 2-1

8. PUMP 2 RTM

- 4. CONTROL
- 11. NORMAL TEST FAIL
- 5.120 CONVENIENCE 12. ALARM TEST

- 6. REMOTE MONITOR 13. ALARM SILENCE
- 7. PUMP 1 RTM

REV. N□.	REVISION	BY CHK'D	DATE	DESIGNED BY:		BBC
1	CHANGED GEN. RECEPT. TO 60A		5/10	MH Drawn by:	4/28 DATE	PUMP AND EQUIPMENT COMPANY, Inc. 1125 W. 16th St. P.O. BOX 22098
	CHINGED GEN. REGELT. TE GOTT	МН	95	SP	95	Indianapolis, Indiana 46222 317/636-1111
				CHECKED BY:	DATE	BBC #1595-23861
						FALL CREEK P.O.#9522
				SCALE		DWG. PNL 14432 JOB NO.

ITEM	PIECE	OTY	SCRAP	SCRAP BOM EFFEC		UZM	ITĒŴ	
14432	FALL CREEK REG. WASTE	PER	Ø11	RATE REV DATE	DATE CODE (REV)	T" A		SET
	88C PO# 1595-23861 FALL CREEK PO# 9522 DUPLEX CONTROL 3HP 240V 1PH					EA	0	
322268	HORN 120VAC FARADAY 6110							
	CAT. #6110-4-120G	1.0000	0.0000	0.000		EA	5	0
322276.2	LIGHT ALARM AC-DC #BL5R-120VAC							
365285	NUTSERT 83858 1/4-20	1.0000	0.0000	0.000		EA	5	0
365290		3.0000	0.0000	0.000		EA	5	0
365291		3.0000	0.0000	0.000		EA	5	0
420410.3	ROD RESET SQD CLASS 9066 Z93	3.0000	0.0000	0.000		EA	5	0
421102		2.0000	0.0000	0.000		EA	7	0
421503		2.0000	0.0000	0.000		EA	7	0
	BREAKER DOOR MOUNT SQD QOU-115	2.0000	0.0000	0.000		EA	7	0
421506	BREAKER DOOR MOUNT SQD QOU-120	1.0000	0.0000	0.000		EA	7	0
421516	BREAKER DOOR MOUNT SQD QOU-235	2.0000	0.0000			EA	7	0
421636	BREAKER 2 PL MLD CA FAL 22100	1.0000	0.0000			EA	7	
421824	BREAKER 3 PL MLD CA FAL 32060	1.0000	0.0000				·	
422307.1	RELAY 10A BLTEC 8302-T-120VAC					EA	7	, i
	20,000 OHM - 2 N.O. CONTACTS	2.0000	0.0000	0.000		EA	1	0
422339.10	RELAY 10A IDEC RH2B-U-AC120V							
422339.12	RELAY 10A IDEC RH2B-U-AC24V	5.0000	0.0000	0.000		EA	7	0
422339.22		2.0000	0.0000	0.000		EA	7	0
422345		1.0000	0.0000	0.000		EA	7	0
423384.1		1.0000	0.0000	0.000		EA	1	0
Thusberser Till die		1.0000	0.0000	0.000		EA	3	0

RED JACKET #104-017-5

USEMCO INCORPORATED BILL OF MATERIAL REPORT MULTI LEVEL BILL OF MATERIAL DATE: 05/15/95 PAGE: 2

EFFECTIVITY DATE: 05/15/95

(LITTLEFUSE FLN-R3)

:M	PIECE	OTY PER		SCRAP BOM	EFFECT	DISCONT	EFF U/N		
23409.1	BLOCK TERMINAL CONNECTRON NFT3			RATE REV	DATE	DATE	CODE		SET
23410	BLOCK TERMINAL CONCTRN NON 111	1.0000	0.0000				EA	56	
23444.1	BLOCK 1PL LINE #2/0 LOAD #4	2.0000	0.0000				EA	1	
	2 LINE 6 LOAD	1.0000	0.0000	0.000			EA	7	0
	MARATHON #1431555								
23480.2	SOCKET RD 8 PIN IDEC SR2P-06	2.0000	0.0000	0.000			EA	7	0
23484	SOCKET MIDGET 2P IDEC SH28-05	7.0000	0.0000				EA	7	V
23485	SOCKET MIDGET 3P IDEC SH38-05	1.0000	0.0000					- /	
23502	THERMOSTAT 15A SPDT WWG #2E158						EA		0
23564	OVERLOAD TELE LR2 D13 22	1.0000	0.0000				EA	7	0
	17 TO 25 AMPS	2.0000	0.0000	0.000			EA	7	0
24164	INTERLOCK CIRCUIT BREAKER-FAL								
24168	MOUNTING KIT TELE LAZ D1064	1.0000	0.0000	0.000			EA	1	0
25012.00	TIMER 120VAC DIV. TBC-120-ABA	2.0000	0.0000	0.000			EA	7	0
		1.0000	0.0000	0.000			EA	14	0
25079	FLASHER 120VAC SSAC FS127								
25200.0		1.0000	0.0000	0.000			EA	5	0
25337		2.0000	0.0000	0.000			EA	56	0
2000/		1.0000	0.0000	0.000			EA	7	0
PCETTON PA IL	GRAINGER STOCK #2A245								
25390	TRNSFMR CURRENT SØD 2NR-500	2.0000	0.0000	0.000			EA	14	0
25393	TRNSFMR MOUNTING BRKT MB-1	2.0000	0.0000				EA	14	
26104	FUSE 250V TIME-DELAY 3 AMP	1.0000	0.0000				EA	7	0
	DUAL-ELEMENT, SLO-BLO CLASS RK5 200,000 A.I.R. 2" LONG × 9/16" DIAMETER (BUSSMAN FRN-RZ)	1	V # VVVV	VIVVV			E.Fi	/	V

ITEM	PIECE	OTY PER		SCRAP BOM	EFFECT	DISCONT	EFF U/M	ITEM	
LU	(GOULD-SHAWMUT TR-3R)	FER	OTY	RATE REV	DATE	DATE	CODE	LT	SEI
426521	BLOCK FUSE MARATHON F30A1S	4 0000							
426525	BLOCK FUSE LITTLEFUSE 3548126Y	1.0000	0.0000				EA	7	0
428905.1	WIRE DUCT BASE TYTON SL-1.5x3G	1.0000	0.0000				EA	1.	0
428908.1	WIRE DUCT COVER TYTON TC1.5-G	7.0000	0.0000				FT	14	0
429000.007	RELAY MTR START 260-275 #6X555	7.0000	0.0000				FT	14	0
429002.006	CAP MTR/ST MFD 161-193 #4X659	2.0000	0.0000				EA	7	0
429003002	CAP MTR RUN MFD 10 #6X656	2.0000	0.0000				EA	7	0
429105	DECAL USEMCO LIMITED WARRANTY	2.0000	0.0000	0.000			EA	7	0
445041	FUSE SLO BLO 2.5A 250V	1.0000	0.0000	0.000			EA	5	0
	LITTLEFUSE #31302.5 3AG	1.0000	0.0000	0.000			EA	7	0
461022	BSHNG KNOCKOUT T&B #3210 1/2								
462003	BOX JUNCTION 2X4 RACO 670	2.0000	0.0000	0.000			EA	7	0
462340.08	RECEPT CROUSE-HINDS AR631-S22	2.0000	0.0000	0.000			EA	7	0
10201V#VU	60 AMP 3 WIRE 3 POLE	1.0000	0.0000	0.000			EA	28	0
462357.1									
	RECEPT GF1 20A 120V AH GF5342I	1.0000	0.0000	0.000			EΑ	7	0
4628493	ENCL N4X SNGL HOF A42H3010SSLP	1.0000	0.0000	0.000			EA	14	0
463219	ENCL BP HOF A42P30	1.0000	0.0000	0.000			EA	1.4	0
469004	LUG ALUM SOLDERLESS MAX. #2	3.0000	0.0000				EΑ	7	0
4690050004	LUG POWER KIT SQD #PDC3FA2	1.0000	0.0000				EA	7	0
	CLASS 690		010000	0 8 0 0 0			Lift	,	V
469070	HEATER PANEL 120V CHRD SCB-100	1.0000	Λ ΛΛΛΛ	Λ ΛΛΛ			F° A	E?	Α.
469071	LAMPHOLDER PORCELAIN KEYLESS		0.0000				EA	5	0
	CLEAT MEDIUM EDISON SCREW BASE CHALLENGER #226 80845-0	1.0000	0.0000	0.000			EA	5	0

DATE: 05/15/95 PAGE: 4

ITEM	PIECE OTY PER	SCRAP	SCRAP BOM EFFECT DISCONT RATE REV DATE DATE	EFF U/M	ITEM	OFF
	VE #EAGLE 657	911	MALE NEW DATE DATE	GUDE.	CT :	ot I
470401	SWITCH TOG SPDT 3 POS #91-0003	0.0000	0.000	F" A	44	
	20 AMP ON OFF ON	0.0000	0.000	EA	7	0
470406	SW1TCH TOG SP3T 3 POS 26E64-73	^ ^^^	0.000			
470500.1	SWITCH PB SQD 9001 SKR-1U 1.0000	0.0000		EA	7	0
	NEMA 4X CORROSION RESISTANT	0.0000	0.000	EA	7	0
470561	SWITCH PB C-H 8411K12 NO					
472081	BLOCK CONTACT SQD 9001 KA-2	0.0000		EA	7	0
480110.1	LIGHT IND #930-405X-710RN-120 2.0000	0.0000		EA	7	0
	LITTELFUSE 2.0000	0.0000	0.000	EA	1	()
480111.1	LIGHT IND #930-405X-710GN-120					
	LITTELFUSE 4.0000	0.0000	0.000	EA	1	0
500563	INNERDOOR 42x30x08 N4&12 10"DP					
140800.99	SHEET STL HR 14GA A36-GENERIC 1.0000	0.0000		EA	1	0
328000.0001	HINGE CONTINUOUS #1205	0.0000		L.B	1	0
500578	JEG. INNER DOOR 8" HIGH	0.0000		IN	5	0
141300.036	STRIP STL HR .125X1	0.0000		EA	1	0
500583.07	STANDOFF QOUS FOR 8" DEPTH 0.3807	0.0000		LB	1	0
140800.99	SHEET STL HR 14GA A36-GENERIC	0.0000	0.000	EΑ	5	0
500584.20	STANDOFF FAL INTERLOCK - 8"	0.0000	0.000	LB	1	0
140800.99	SHEET STL HR 14GA A36-GENERIC	0.0000	0.000	EA	5	0
500587.01	STANDOFF "INDY" FOR 8" DEPTH	0.0000	0.000	LB	1	0
140800.99	SHEET STL HR 14GA A36-GENERIC 1.0000	0.0000	0.000	EA	5	0
	6.6566	0.0000	0.000	L.B	1	0