

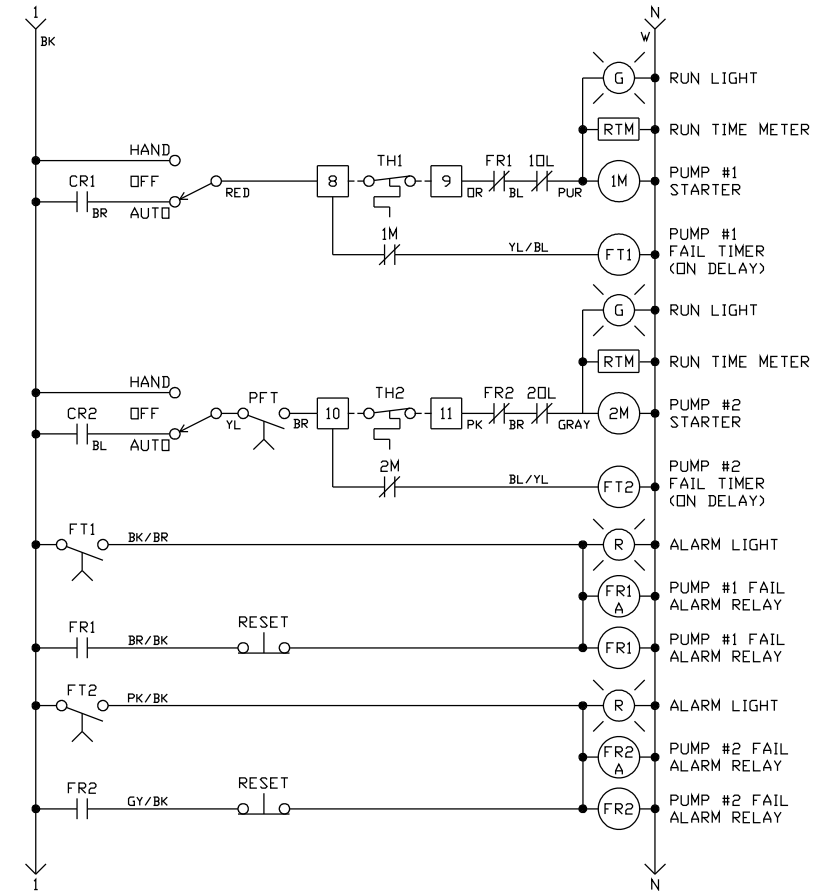
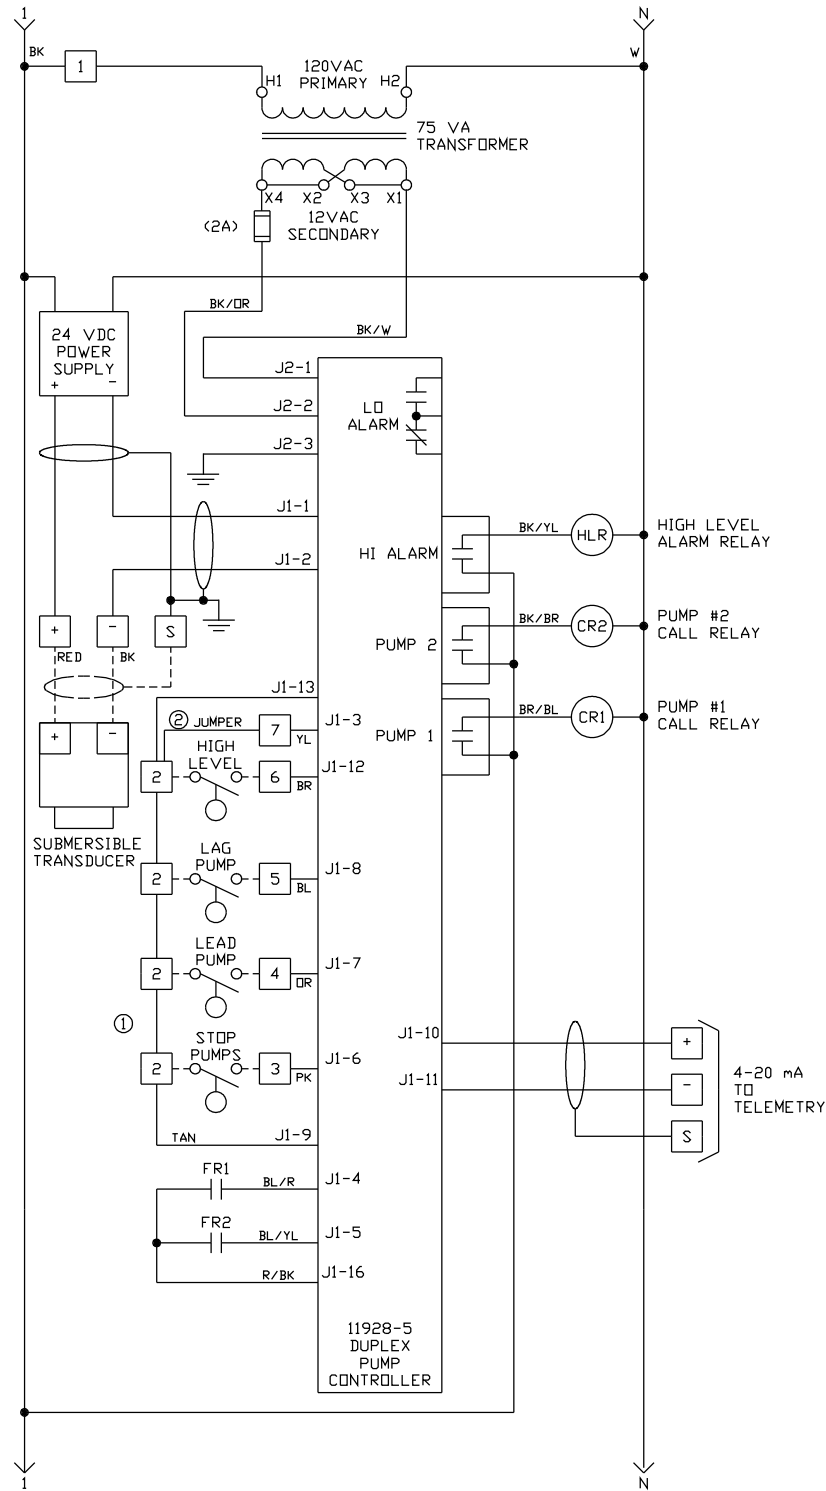
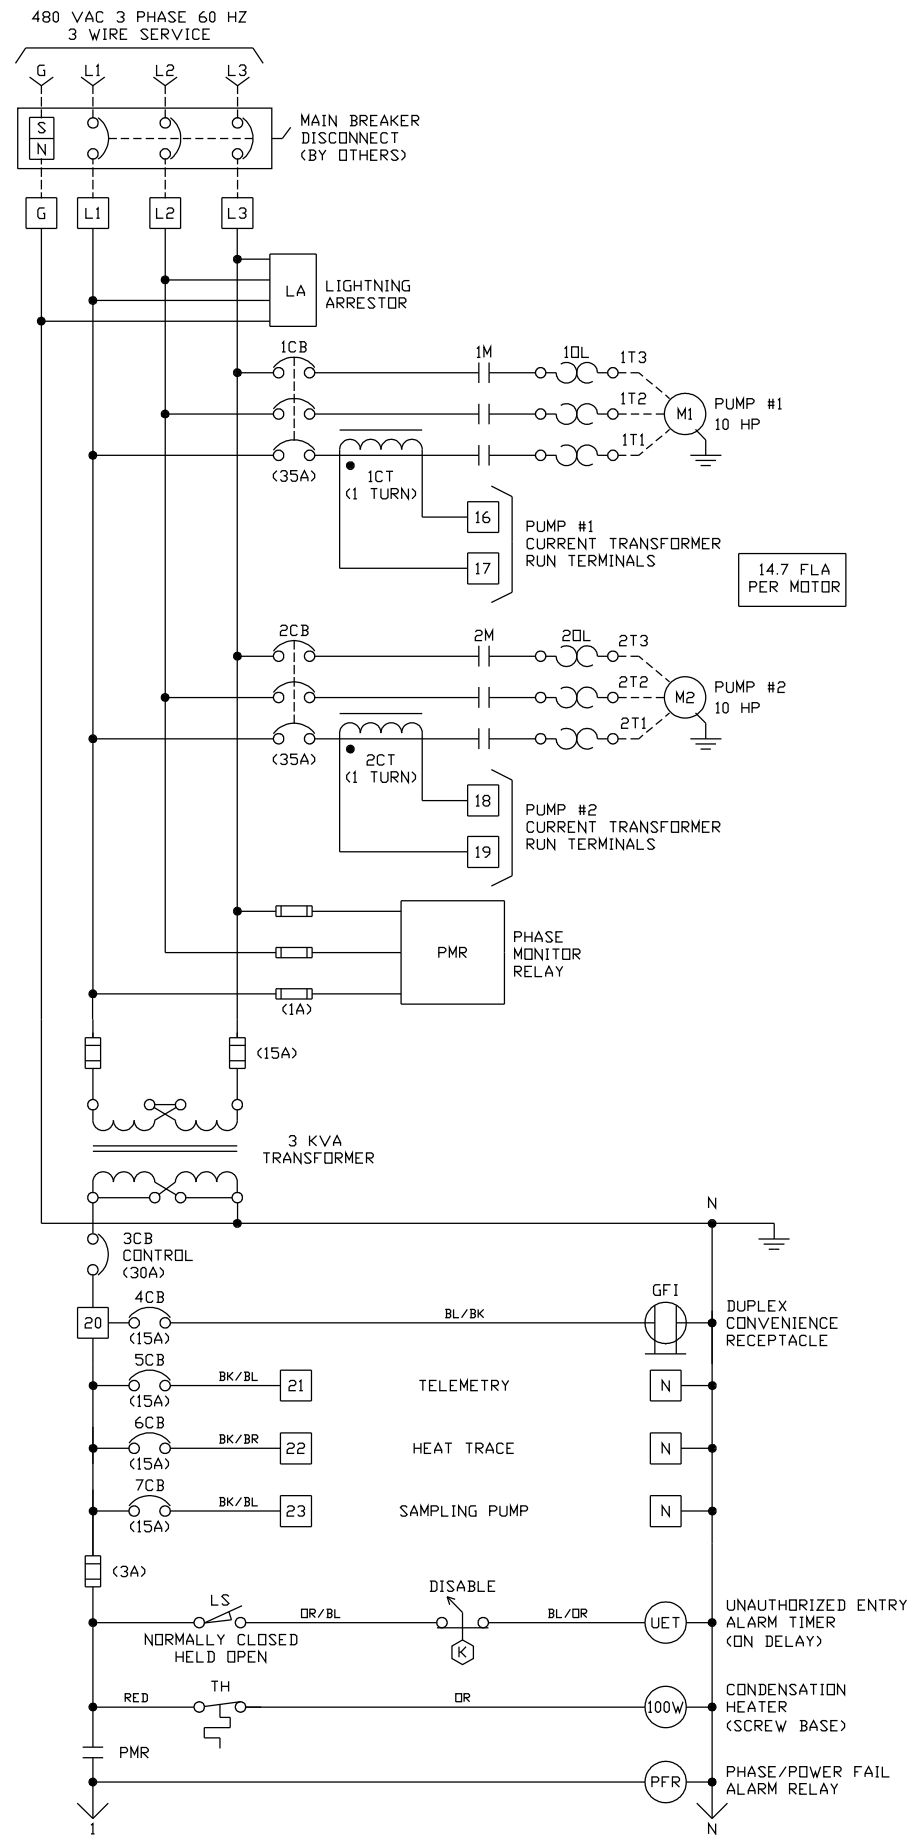


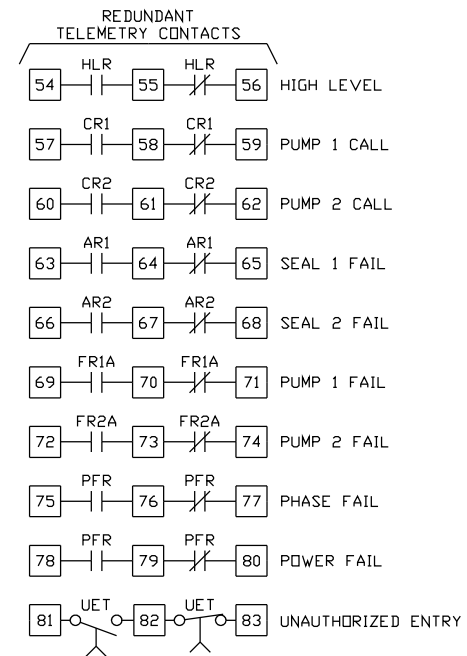

NOTES:


- ① FLOAT TERMINALS ARE FOR FUTURE USE.
- ② REMOVE JUMPER FROM TERMINALS 2 AND 7 FOR FLOAT OPERATION.

REV. NO.	REVISION	BY	DATE	DESIGNED BY:	DATE	BBC
1	GENERAL REVISIONS	CHK'D	3/16	NB	11/23	
		J.B.	99	DRAWN BY:	DATE	PUMP AND EQUIPMENT COMPANY, Inc. 1125 W. 16th St. P.O. BOX 22098 Indianapolis, Indiana 46222 317/636-1111
		N.B.		SP	98	
				CHECKED BY:	DATE	DESCRIPTION KREAGER / HWY 67 CORRECTIONAL BBC #1598-36444
				SCALE	DWG. NO.	JOB NO.
					AC 15557A	

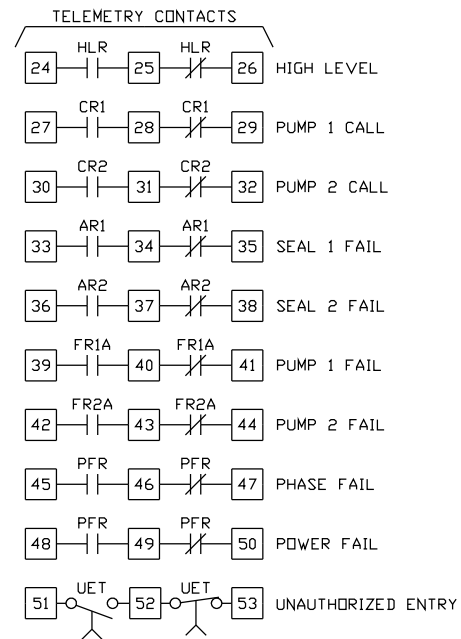

REV. NO.	REVISION	BY CHK'D	DATE	DESIGNED BY:	DATE		
1	GENERAL REVISIONS	J.B.	3/16	NB	11/23	PUMP AND EQUIPMENT COMPANY, Inc. 1125 W. 16th St. P.O. BOX 22098 Indianapolis, Indiana 46222 317/636-1111	
		N.B.	99	DRAWN BY:	DATE		
				SP	98		
				CHECKED BY:	DATE	DESCRIPTION	
						KREAGER / HWY 67 CORRECTIONAL	
						BBC #1598-36444	
				SCALE		DWG. NO.	JOB NO.
						AC 15557B	

NEMA 4X STAINLESS STEEL ENCLOSURE
60"H x 36"W x 12"DP
OUTER DOOR NOT SHOWN

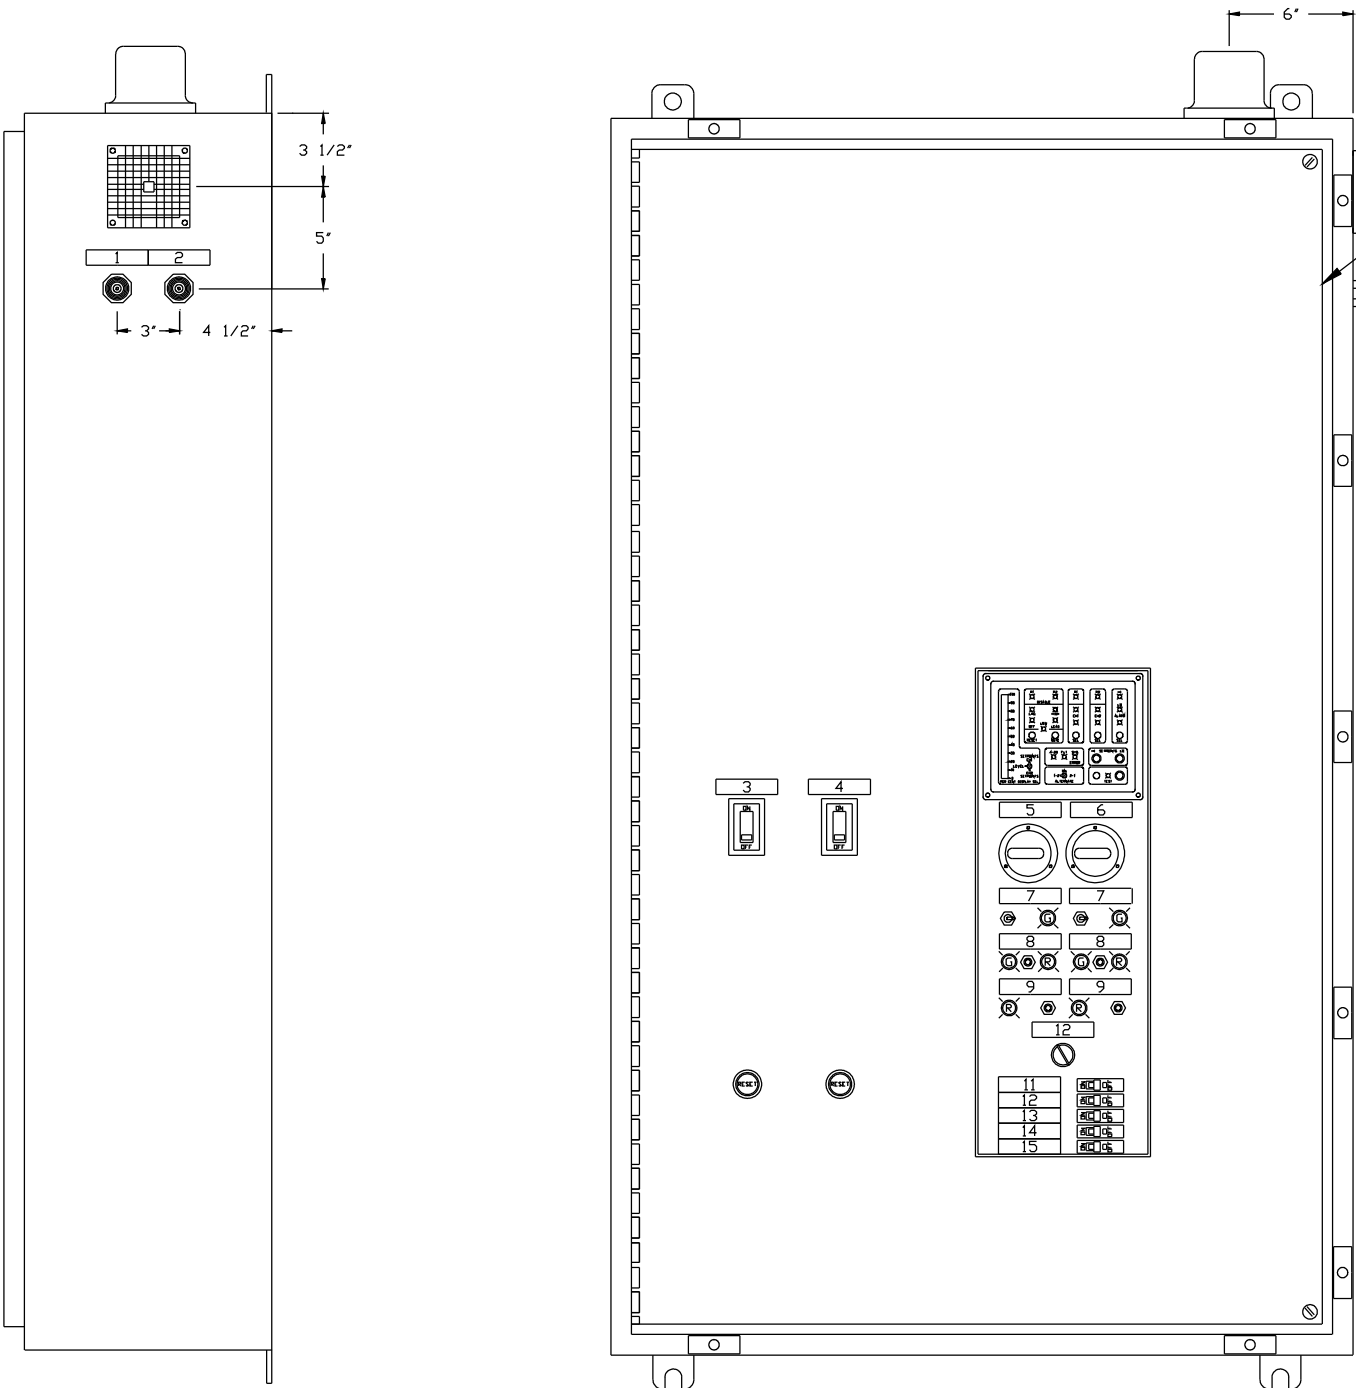


SIDE VIEW

NEMA 4X
ALARM LIGHT

ALARM
HORN
INNER
DOOR

BACK PANEL LAYOUT
57"H x 33"W

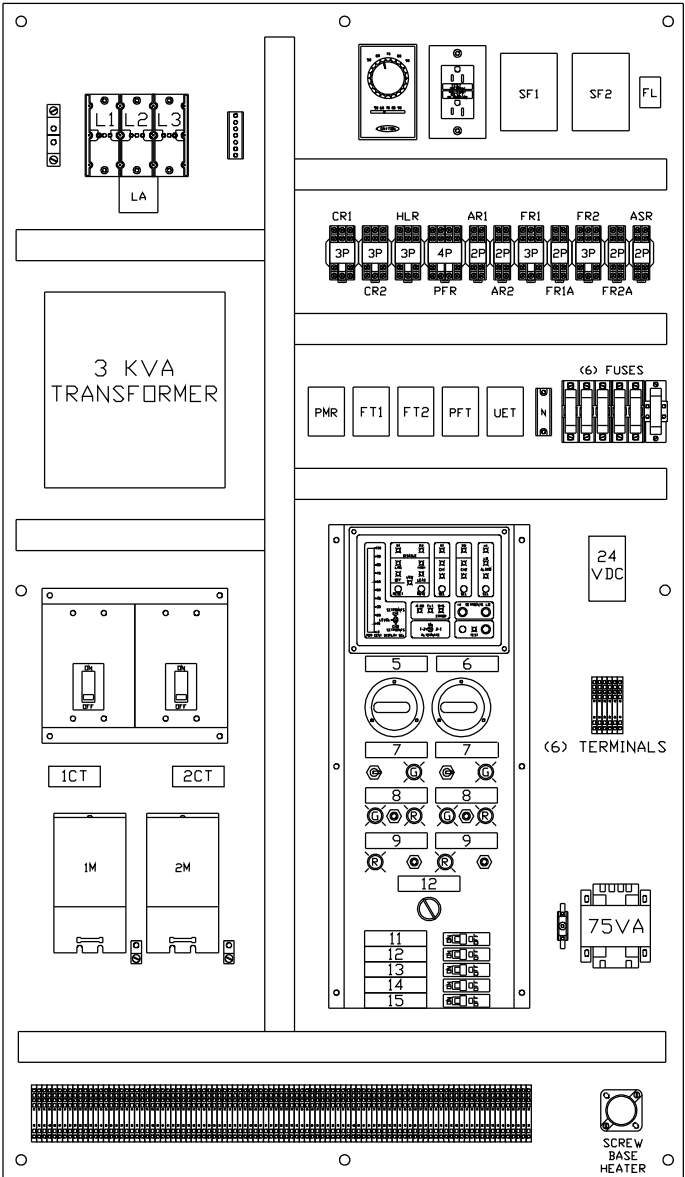

NAMEPLATE LEGEND

1. ALARM TEST
2. ALARM SILENCE
3. PUMP 1
4. PUMP 2
5. CONTROL
6. CONVENIENCE
7. TELEMETRY
8. PUMP 1 RTM
9. PUMP 2 RTM
10. HOA RUN
11. NORMAL TEST FAIL
12. DISABLE

REV. NO.	REVISION	BY CHK'D	DATE	DESIGNED BY:	DATE	BBC PUMP AND EQUIPMENT COMPANY, Inc. 1125 W. 16th St. P.O. BOX 22098 Indianapolis, Indiana 46222 317/636-1111	
1	GENERAL REVISIONS	J.B.	3/16	NB	11/23		
		N.B.	99	DRAWN BY:	DATE	DESCRIPTION KREAGER / HWY 67 CORRECTIONAL BBC #1598-36444	
				SP	98		
				CHECKED BY:	DATE	DWG. NO. PNL 15326	
				SCALE		JOB NO.	

USEMCO, Inc.
Bill of Material
15557/1

4/30/99 1:18 PM
Page 1

15557/1

KREAGER / HWY 67 CORRECTIONAL BBC# 1598-36444

Detail	Quantity
----ZZ15557 WIP COST - 15557	1.00
----322268 HORN 120VAC FARADAY 6110 CAT. #6114L-0-15-120-60	1.00
----322276.2 LIGHT ALARM AC-DC #BL5R-120VAC	1.00
----365294 LATCH SPRING W/KNURLED KNOB #57-10-201-10	2.00
----420317.10 STARTER SQD 8536 SCO3V02-H10S 3 POLE NEMA SIZE 1 WITH SOLID STATE CLASS 10 OVERLOADS	2.00
----420410 ROD RESET SINGLE SQD 9066 RA-1	2.00
----421494.07 BAR GROUND KIT SQD PK7GTA	1.00
----421503 BREAKER DOOR MOUNT SQD QOU-115	4.00
----421512 BREAKER DOOR MOUNT SQD QOU-130	1.00
----421813 BREAKER 3 PL MLD CA FAL 34035	2.00
----422307.3 RELAY 10A BLTEC 8301-120VAC 20,000 OHM - 1 N.O. CONTACT	2.00
----422339.10 RELAY 10A IDEC RH2B-U-AC120V	5.00
----422339.20 RELAY 10A IDEC RH3B-U-AC120V	5.00
----422339.30 RELAY 10A IDEC RH4B-U-AC120V	1.00
----422348.1 RELAY PH MNTR DIV #SUA-440-ASA	1.00
----422427 LUG EXTENDER KIT SQD 9999 LBO FOR SOLID STATE OVERLOAD RELAYS SIZE 0 & 1	2.00
----423381.00 POWER SUPPLY IDEC PS5R-B/15W .6 AMPS @ 24 VDC REGULATED	1.00
----423385.1 ARRESTOR LIGHTNING 4W 480V RED JACKET #104-018-5	1.00
----423419 BLOCK TERMINAL ENTRELEC-GRAY ENTRELEC PART #115 116.07	35.00
----423419.1 BLOCK TERMINAL ENTRELEC-GREEN/YELLOW ENTRELEC PART #165 113.16 ELECTRICALLY GROUNDED TO DIN RAIL	2.00
----423419.0 BLOCK TERMINAL ENTRELEC-BLUE ENTRELEC PART #125 116.01	2.00
----423419.2 BLOCK TERMINAL ENTRELEC-YELLOW ENTRELEC PART #105 116.16	62.00
----423419.4 END STOP ENTRELEC-GRAY BAM ENTRELEC PART #103 002.26	4.00
----423419.5 END SECTION FEM6 COVER ENTRELEC ENTRELEC PART #118 368.16	2.00

USEMCO, Inc.
Bill of Material
15557/1

4/30/99 1:19 PM
Page 2

15557/1

KREAGER / HWY 67 CORRECTIONAL BBC# 1598-36444

Detail	Quantity
-----423440.01 BLOCK 1PL LINE #2 LOAD #10 1 LINE 4 LOAD MARATHON #1411400	1.00
-----423441.0 BLOCK 3PL LINE #2/0 LOAD #4 1 LINE 4 LOAD MARATHON #1423570	1.00
-----423480.1 SOCKET RD 8 PIN DIV #RB-08 RATED 10 AMP AT 600 VOLT	1.00
-----423480.2 SOCKET RD 8 PIN IDEC SR2P-06	4.00
-----423484 SOCKET MIDGET 2P IDEC SH2B-05	5.00
-----423485 SOCKET MIDGET 3P IDEC SH3B-05	5.00
-----423486 SOCKET MIDGET 4P IDEC SH4B-05	1.00
-----423502 THERMOSTAT 15A SPDT WWG #2E158	1.00
-----424180.5 INTERLOCK ELEC SQD #9999 SX-7 ONE NORMALLY CLOSED CONTACT	2.00
-----425012.00 TIMER 120VAC DIV. TBC-120-ABA ON DELAY - 1.0 to 1023 SECONDS	4.00
-----425079 FLASHER 120VAC SSAC #FS127	1.00
-----425204 RTM REDINGTON 120VAC #7111-0165	2.00
-----425305 TRNSFMR 3KVA SQD #3S1F	1.00
-----425363 TRNSFMR 75VA SQD 9070 T75D13	1.00
-----425389 TRNSFMR CURRENT SQD 2NR-101 100:5 RATIO	2.00
-----425393 TRNSFMR MOUNT BRACKET SQD MB-1	2.00
-----426104 FUSE 250V TIME-DELAY 3 AMP CLASS RK5 200,000 A.I.R. 2" LONG x 9/16" DIAMETER (BUSSMANN FRN-R3) (LITTELFUSE FLN-R3) (GOULD-SHAWMUT TR-3R)	1.00
-----426153 FUSE 600V TIME-DELAY 15 AMP CLASS RK5 200,000 A.I.R. 5" LONG x 13/16" DIAMETER (BUSSMANN FRS-R15) (LITTELFUSE FLS-R15) (GOULD-SHAWMUT TRS-15R)	2.00
-----426200 FUSE 600V FAST-ACTING 1 AMP 100,000 A.I.R. 1-1/2" LONG x 13/32" DIAMETER (BUSSMAN KTK-1) (LITTELFUSE KLK-1) (GOULD-SHAWMUT ATM-1)	3.00
-----426520.02 BLOCK FUSE MARATHON 6M30A3SQ	1.00
-----426521 BLOCK FUSE MARATHON F30A1S	1.00
-----426521.15 BLOCK FUSE MARATHON 6F30A2B	1.00
-----426525 BLOCK FUSE LITTELFUSE 354812GY	1.00

USEMCO, Inc.
Bill of Material
15557/1

4/30/99 1:19 PM
Page 3

15557/1

KREAGER / HWY 67 CORRECTIONAL BBC# 1598-36444

Detail	Quantity
-----428905.1 WIRE DUCT BASE 1.5" X 3" PANDUIT F1.5X3LG6 OR TYTON SL-1.5X3G	8.00
-----428908.1 WIRE DUCT COVER 1.5" PANDUIT C1.5LG6 OR TYTON TC1.5G	8.00
-----445040.1 FUSE SLO BLO 2A 250V LITTELFUSE #313002 3AG	1.00
-----460600 NIPPLE CHASE T&B 842 1/2"	2.00
-----461022 BSHNG KNOCKOUT T&B #3210 1/2"	2.00
-----462003 BOX JUNCTION 2X4 RACO 670 OR STEEL CITY 583711/2 GRAINGER #4A239	1.00
-----462006 BOX C/AL 2X4 RED DOT IH3-1-LM	1.00
-----462357 RECEPT GFI 15A 120V P&S 1591RI	1.00
-----462851 ENCL N4X SNGL HOF A60H3612SSLP	1.00
-----463224 ENCL BP HOF A60P36	1.00
-----469002 LUG ALUM SOLDERLESS MAX. 1/0 ILSCO TA-O, BLACKBURN ADR-11, BURNDY KA264 OR EQUAL	4.00
-----469070 HEATER PANEL 120V CHRO SCB-100	1.00
-----469071 LAMPHOLDER PORCELAIN KEYLESS ANGELLO #22273	1.00
-----470401 SWITCH TOG SPDT 3 POS #91-0003 10 AMP ON OFF ON MC GILL	2.00
-----470500.1 SWITCH PB SQD 9001 SKR-1U NEMA 4X CORROSION RESISTANT	2.00
-----470560 SWITCH PB C-H 8411K7 NC	2.00
-----470561 SWITCH PB C-H 8411K12 NO	2.00
-----470649 SWITCH SEL 2 POS TELE ZB2 BG2 KEY OPERATED RONIS #455 KEY	1.00
-----470701 SWITCH LIMIT SQD 9007 C54B2	1.00
-----470783 ARM LEVER SQD 9007 FA5	1.00
-----472081 BLOCK CONTACT SQD 9001 KA2	2.00
-----472082.4 BASE W/CONTACT TELE ZB2 BZ102 ONE NORMALLY CLOSED CONTACT	1.00
-----480110.10 LIGHT IND #930-505X-710RN-120 SCREW TYPE LUG LITTELFUSE	4.00
-----480111.10 LIGHT IND #930-505X-710GN-120 SCREW TYPE LUG LITTELFUSE	4.00
-----500549.606 FLANGE, INNER DOOR 56.5"x 3.5"	1.00
-----500570 INNERDOOR 60x36x08 N4&12 12"DP	1.00
-----500584.17 STANDOFF 2FAL3P FOR 8" DEPTH	1.00
-----500587.01 STANDOFF "INDY" FOR 8" DEPTH	1.00