

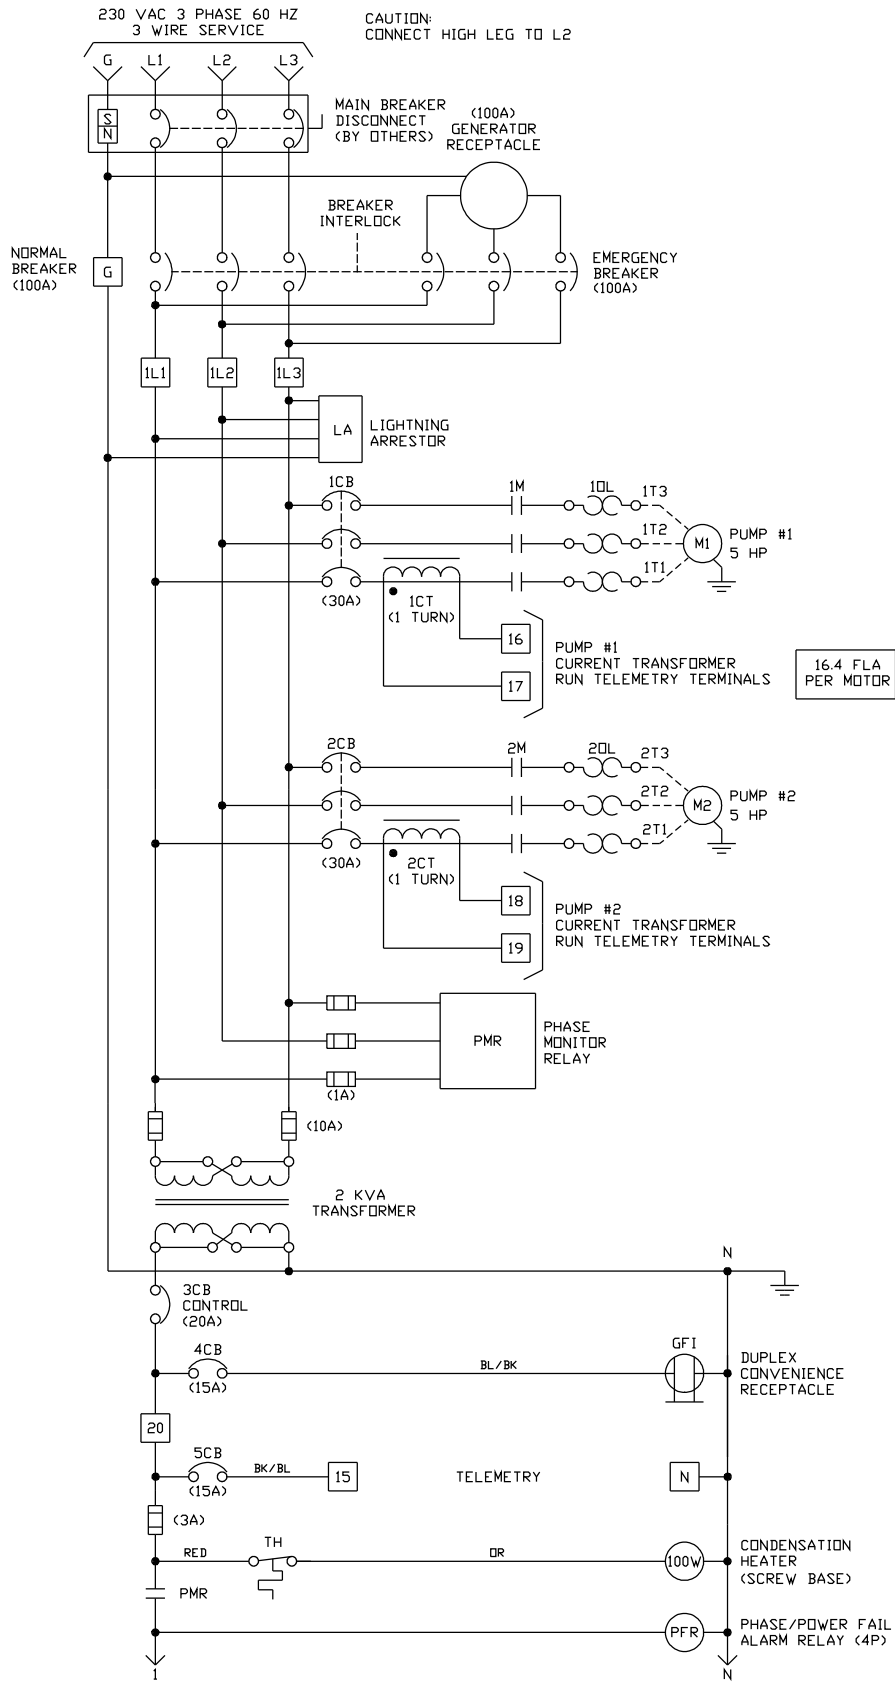
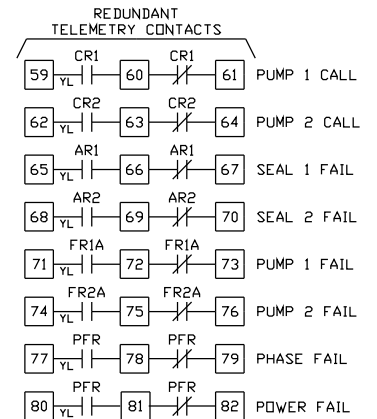
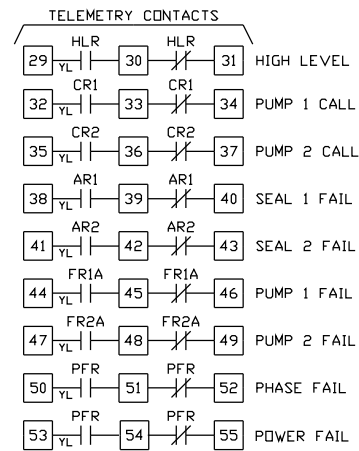


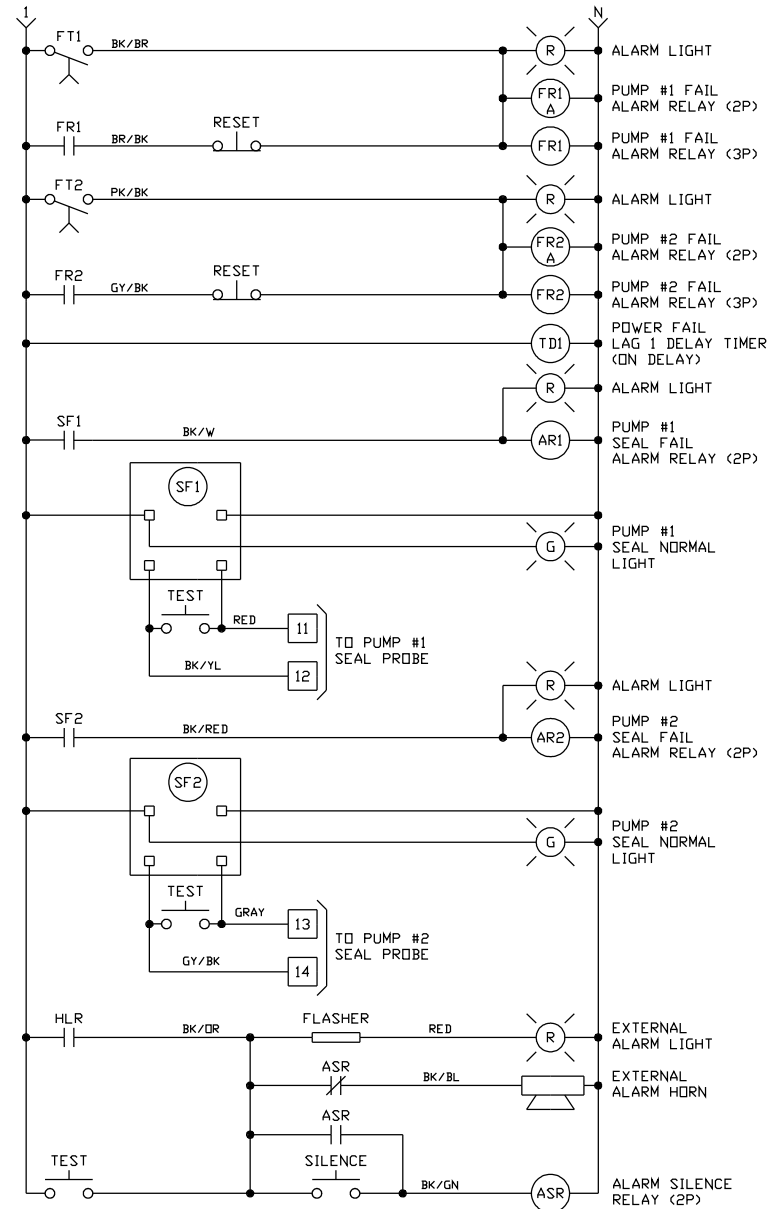


- NOTES:
- ① FLOAT TERMINALS ARE FOR FUTURE USE.
- ② REMOVE WIRE FROM TERMINALS 2 AND 21 FOR FLOAT OPERATION.

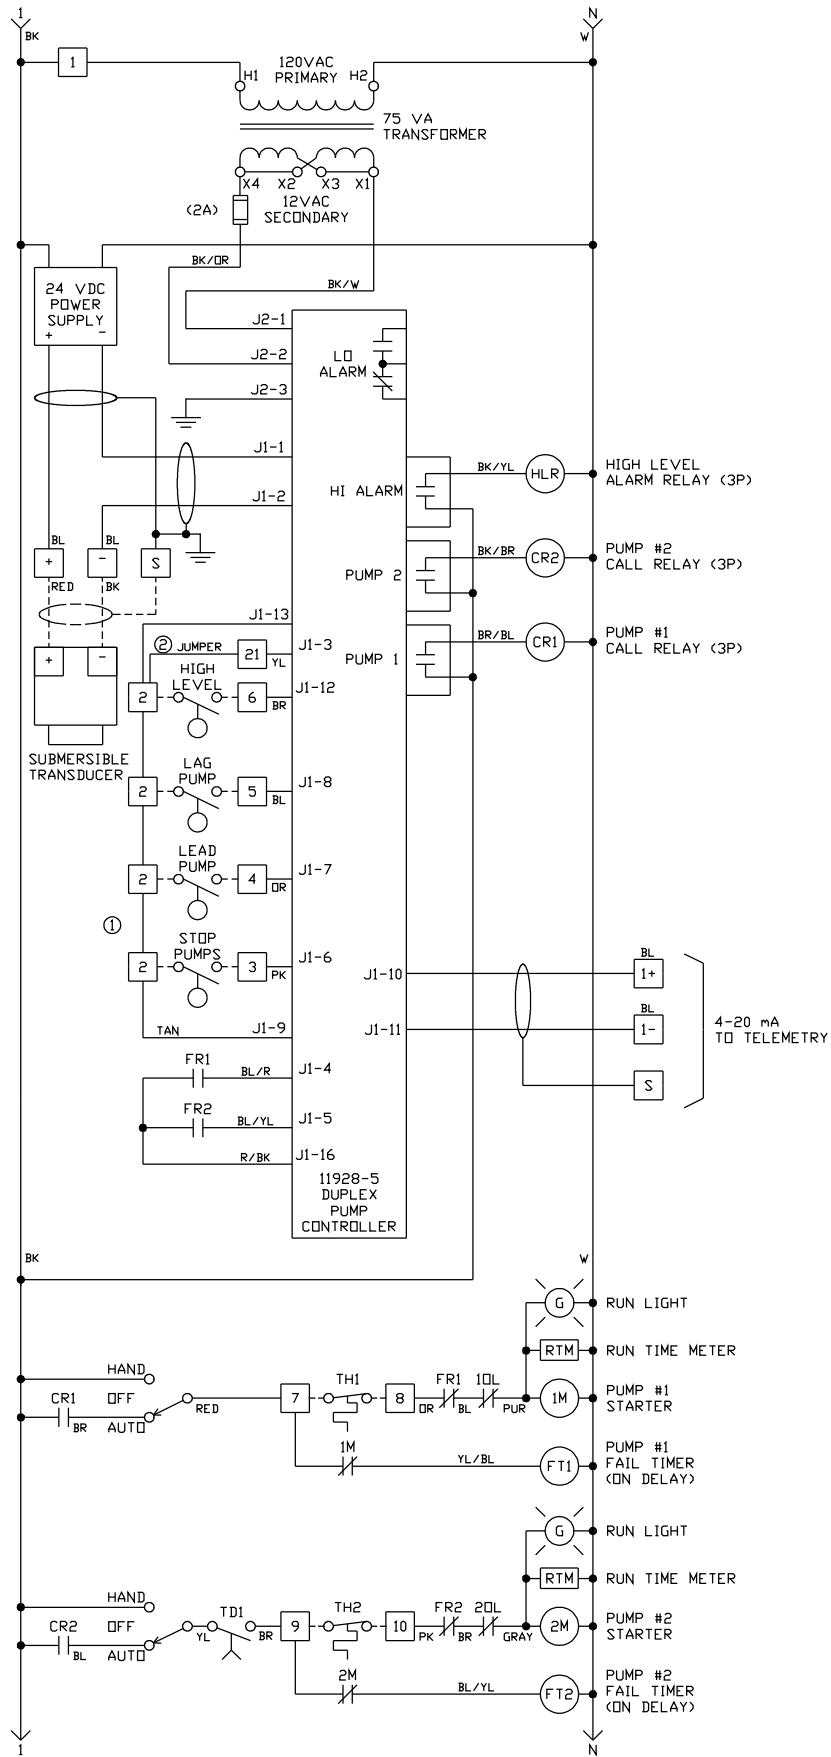


REV. NO.	REVISION	BY CHK'D	DATE	DESIGNED BY:	DATE	DATE	BBC
1	GENERAL REVISIONS	KS	1/20	RL	12/29		PUMP AND EQUIPMENT COMPANY, Inc. 1125 W. 16th St. P.O. BOX 22098 Indianapolis, Indiana 46222 317/636-1111
		RL	00	DRAWN BY:	DATE		
				KS	99		
				CHECKED BY:	DATE		DESCRIPTION MADDOX/FALL CREEK, PENDELTON AVE. BBC# 1599-38727
							DWG. NO. AAC 15956
							BBC NO.

NEMA 4X STAINLESS STEEL ENCLOSURE
60"H x 36"W x 12"DP
OUTER DOOR NOT SHOWN

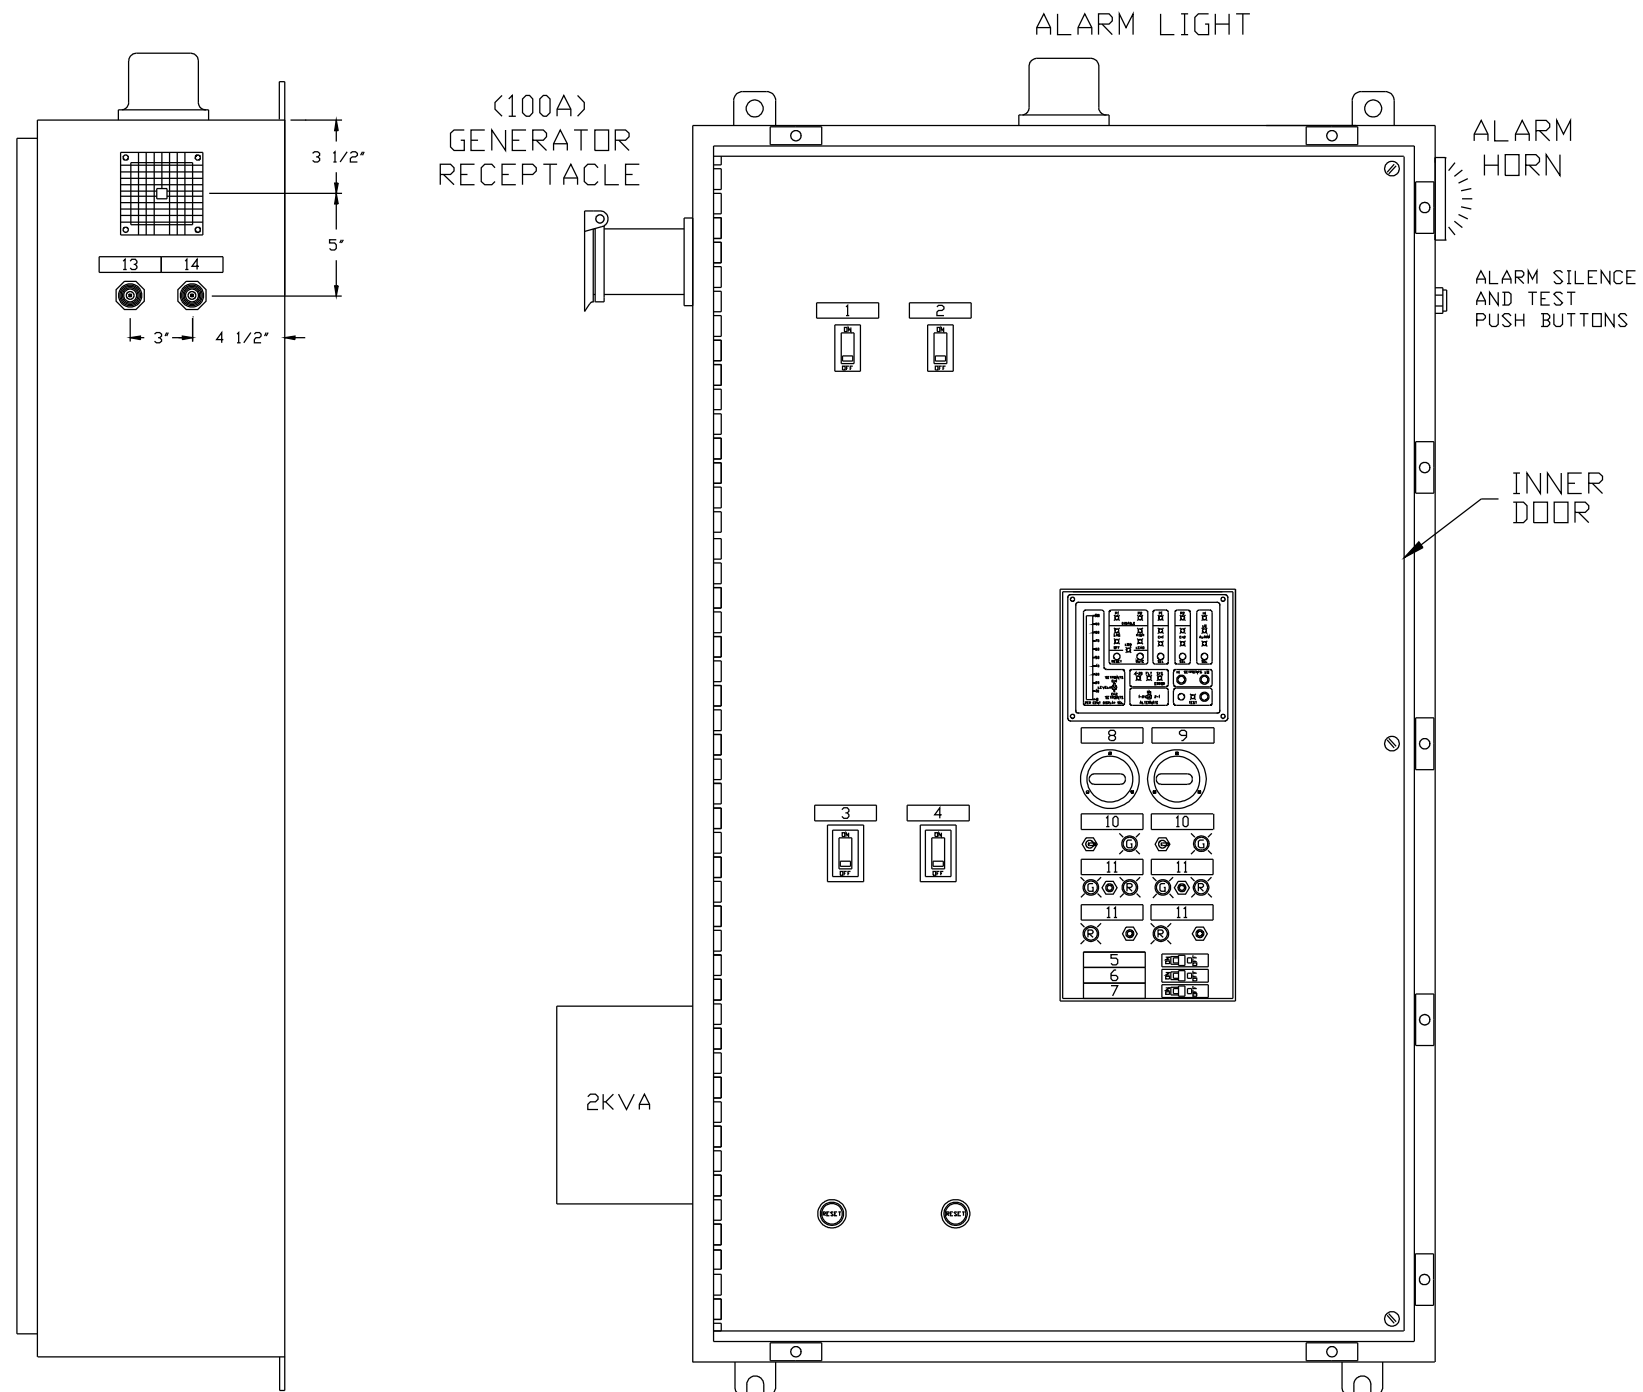

SIDE VIEW

BACK PANEL LAYOUT
57"H x 33"W

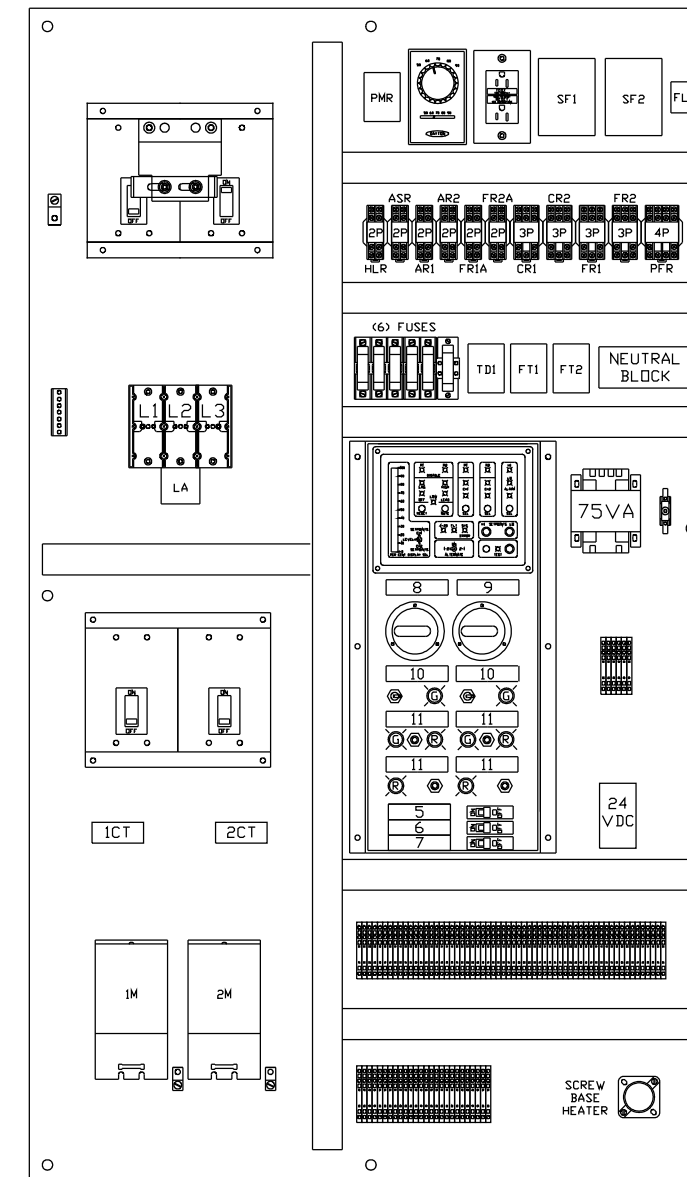

NAMEPLATE LEGEND

1. EMERGENCY
2. SERVICE DISCONNECT
3. PUMP 1
4. PUMP 2
5. CONTROL
6. CONVENIENCE
7. TELEMETRY
8. PUMP 1 RTM
9. PUMP 2 RTM
10. HOA RUN
11. NORMAL TEST FAIL
12. FAIL RESET
13. ALARM TEST
14. ALARM SILENCE

REV. NO.	REVISION	BY	DATE	DESIGNED BY:	DATE	BBC PUMP AND EQUIPMENT COMPANY, Inc. 1125 W. 16th St. P.O. BOX 22098 Indianapolis, Indiana 46222 317/636-1111	
		CHK'D					
				RL	12/29		
				DRAWN BY:	DATE		
				KS	99		
				CHECKED BY:	DATE	DESCRIPTION MADDOX/FALL CREEK, PENDELTON AVE. BBC# 1599-38727	
				SCALE	DWG. NO.	PNL 15956	BBC NO.

USEMCO, Inc.
Bill of Material
15956/1

1/20/00 8:24 AM
Page 1

15956/1

Maddox/Fall Creek, Pendelton Ave; BBC#15

Detail

	Quantity	
----140605 SHEET STL CR 14GAX48X120 PRIME STANDOFF "INDY" FOR 8" DEPTH	9.00	LBS
----260724 ELBOW MALE POLY 1/4"ODX1/4"MPT	0.00	
----261173 NIPPLE THRD GALV 1/2" X 1 1/2"	1.00	EA
----322268 HORN 120VAC FARADAY 6110 CAT. #6114L-0-15-120-60	1.00	EA
----322276.2 LIGHT ALARM AC-DC #BL5R-120VAC	1.00	EA
----365294 LATCH SPRING W/KNURLED KNOB #57-10-201-10	3.00	EA
----420317.1 STARTER SQD 8536 SCO3V02BS 3 POLE NEMA SIZE 1 WITH AMBIENT COMPENSATED BIMETALLIC OVERLOAD RELAYS	2.00	EA
----420410 ROD RESET SINGLE SQD 9066 RA-1	2.00	EA
----421494.07 BAR GROUND KIT SQD PK7GTA	1.00	EA
----421498.2 NEUTRAL ASSEMBLY SQD SN12125	1.00	EA
----421503 BREAKER DOOR MOUNT SQD QOU-115	2.00	EA
----421506 BREAKER DOOR MOUNT SQD QOU-120	1.00	EA
----421809 BREAKER 3 PL MLD CA FAL 32030	2.00	EA
----421836 BREAKER 3 PL MLD CA FAL 32100	2.00	EA
----422307.3 RELAY 10A BLTEC 8301-120VAC 20,000 OHM - 1 N.O. CONTACT	2.00	EA
----422339.10 RELAY 10A IDEC RH2B-U-AC120V	6.00	EA
----422339.20 RELAY 10A IDEC RH3B-U-AC120V	4.00	EA
----422339.30 RELAY 10A IDEC RH4B-U-AC120V	1.00	EA
----422348 RELAY PH MNTR DIV #SLA-230-ASA	1.00	EA
----423381.00 POWER SUPPLY IDEC PS5R-B/24 .6 AMPS @ 24 VDC REGULATED	1.00	EA
----423385.1 ARRESTOR LIGHTNING 4W 480V RED JACKET #104-018-5	1.00	EA
----423419 BLOCK TERMINAL ENTRELEC-GRAY ENTRELEC PART #115 116.07	24.00	EA
----423419 BLOCK TERMINAL ENTRELEC-GRAY	0.00	
----423419.0 BLOCK TERMINAL ENTRELEC-BLUE ENTRELEC PART #125 116.01	4.00	EA
----423419.1 BLOCK TERMINAL ENTRELEC-GREEN/YELLOW ENTRELEC PART #165 113.16 ELECTRICALLY GROUNDED TO DIN RAIL	3.00	EA
----423419.2 BLOCK TERMINAL ENTRELEC-YELLOW ENTRELEC PART #105 116.16	60.00	EA

USEMCO, Inc.Bill of Material
15956/1

1/20/00

8:24 AM

Page

2

15956/1

Maddox/Fall Creek, Pendelton Ave; BBC#15**Detail**

	Quantity	
----423419.4 END STOP ENTRELEC-GRAY BAM ENTRELEC PART #103 002.26	6.00	EA
----423419.5 END SECTION FEM6 COVER ENTRELEC ENTRELEC PART #118 368.16	3.00	EA
----423419.7 JUMPER 10 POLE ENTRELEC ENTRELEC PART #168 973.07	1.00	EA
----423441.1 BLOCK 3PL LINE #2/0 LOAD #4 2 LINE 6 LOAD MARATHON #1433555	1.00	EA
----423480.2 SOCKET RD 8 PIN IDEC SR2P-06	4.00	EA
----423484 SOCKET MIDGET 2P IDEC SH2B-05	6.00	EA
----423485 SOCKET MIDGET 3P IDEC SH3B-05	4.00	EA
----423486 SOCKET MIDGET 4P IDEC SH4B-05	1.00	EA
----423502 THERMOSTAT 15A SPDT WWG #2E158	1.00	EA
----423827 OVERLOAD SQD #AR27 AMBIENT COMPENSATED	6.00	EA
----424164 INTERLOCK CIRCUIT BREAKER-FAL	1.00	EA
----424180.5 INTERLOCK ELEC SQD #9999 SX-7 ONE NORMALLY CLOSED CONTACT	2.00	EA
----425012.00 TIMER 120VAC DIV. TBC-120-ABA ON DELAY - 1.0 to 1023 SECONDS	3.00	EA
----425079 FLASHER 120VAC SSAC #FS127	1.00	EA
----425204 RTM REDINGTON 120VAC #711-0165	2.00	EA
----425300 TRNSFMR 2KVA SQD #2S1F	1.00	EA
----425362 TRNSFMR 75VA HONEY AT175A1008 120/208/240 VAC PRIMARY 24 VAC SECONDARY NEC CLASS 2	1.00	EA
----425390 TRNSFMR CURRENT SQD 2NR500 50:5 RATIO	2.00	EA
----425393 TRNSFMR MOUNT BRACKET SQD MB-1	2.00	EA
----426000 FUSE 250V ONE-TIME 1 AMP CLASS K5 50,000 A.I.R. 2" LONG x 9/16" DIAMETER (BUSSMANN NON-1) (LITTELFUSE NLN-1) (GOULD-SHAWMUT OT-1)	3.00	EA
----426104 FUSE 250V TIME-DELAY 3 AMP CLASS RK5 200,000 A.I.R. 2" LONG x 9/16" DIAMETER (BUSSMANN FRN-R3) (LITTELFUSE FLN-R3) (GOULD-SHAWMUT TR-3R)	1.00	EA

USEMCO, Inc.Bill of Material
15956/1

1/20/00 8:24 AM

Page 3

15956/1

Maddox/Fall Creek, Pendelton Ave; BBC#15**Detail**

	Quantity	
----426111 FUSE 250V TIME-DELAY 10 AMP CLASS RK5 200,000 A.I.R. 2" LONG x 9/16" DIAMETER (BUSSMAN FRN-R10) (LITTELFUSE FLN-R10) (GOULD-SHAWMUT TR-10R)	2.00	EA
----426522 BLOCK FUSE MARATHON F30A3S	2.00	EA
----426525 BLOCK FUSE LITTELFUSE 354812GY	1.00	EA
----428905.1 WIRE DUCT BASE 1.5" X 3" PANDUIT F1.5X3LG6 OR TYTON SL-1.5X3G	8.00	FT
----428908.1 WIRE DUCT COVER 1.5" PANDUIT C1.5LG6 OR TYTON TC1.5G	8.00	FT
----445040.1 FUSE SLO BLO 2A 250V LITTELFUSE #313002 3AG	1.00	EA
----460480 RING SEAL TB5262 1/2"	2.00	EA
----460481 RING SEAL TB5263 3/4"	0.00	
----460600 NIPPLE CHASE T&B 842 1/2"	1.00	EA
----460605 NIPPLE CHASE T&B 847 2"	1.00	EA
----461000 BSHNG FIBER TB 222 1/2" OR REGAL #931	2.00	EA
----461005 BSHNG FIBER TB 227 2"	1.00	EA
----461022 BSHNG KNOCKOUT T&B #3210 1/2"	1.00	EA
----461401 NUT LOCK STL REGAL #801 1/2"	2.00	EA
----461406 NUT LOCK STL REGAL #806 2"	1.00	EA
----462003 BOX JUNCTION 2 X 4 RACO 670 OR STEEL CITY 583711/2 GRAINGER # 4A239	1.00	EA
----462006 BOX C/AL 2X4 RED DOT IH3-1-LM	1.00	EA
----462340.21 RECEPT CROUSE-HINDS AR1042-S22 100 AMP 3 WIRE 4 POLE STYLE 2	1.00	EA
----462357 RECEPT GFI 15A 120V P&S 1591RI	1.00	EA
----462851 ENCL N4X SNGL HOF A60H3612SSLP	1.00	EA
----463224 ENCL BP HOF A60P36	1.00	EA
----465087 WIRE THHN STRANDED #3/0 BLACK	0.00	
----469004 LUG ALUM SOLDERLESS MAX. #2 ILSCO TA-2, BLACKBURN ADR-2, BRUNDY KA2U OR EQUAL	2.00	EA
----469070 HEATER PANEL 120V CHRO SCB-100	1.00	EA
----469071 LAMPHOLDER PORCELAIN KEYLESS ANGELLO #22273	1.00	EA
----470401 SWITCH TOG SPDT 3 POS #91-0003 10 AMP ON OFF ON MC GILL	2.00	EA
----470500.1 SWITCH PB SQD 9001 SKR-1U	2.00	EA

USEMCO, Inc.
Bill of Material
15956/1

1/20/00 8:24 AM
Page 4

15956/1

Maddox/Fall Creek, Pendelton Ave; BBC#15

Detail

	Quantity	
----470560 SWITCH PB NC CARLINGSWITCH #170	2.00	EA
----470561 SWITCH PB NO CARLINGSWITCH #172	2.00	EA
----472081 BLOCK CONTACT SQD 9001 KA2	2.00	EA
----480110.10 LIGHT IND #930-505X-710RN-120 SCREW TYPE LUG LITTELFUSE	4.00	EA
----480111.10 LIGHT IND #930-505X-710GN-120 SCREW TYPE LUG LITTELFUSE	4.00	EA
----500549.606 FLANGE, INNER DOOR 55"x 3.5"	1.00	EA
----500570 INNERDOOR 60x36x08 N4&12 12"DP	1.00	EA
----500584.17 STANDOFF 2FAL3P FOR 8" DEPTH	1.00	EA
----500584.20 STANDOFF FAL INTERLOCK - 8"	1.00	EA