

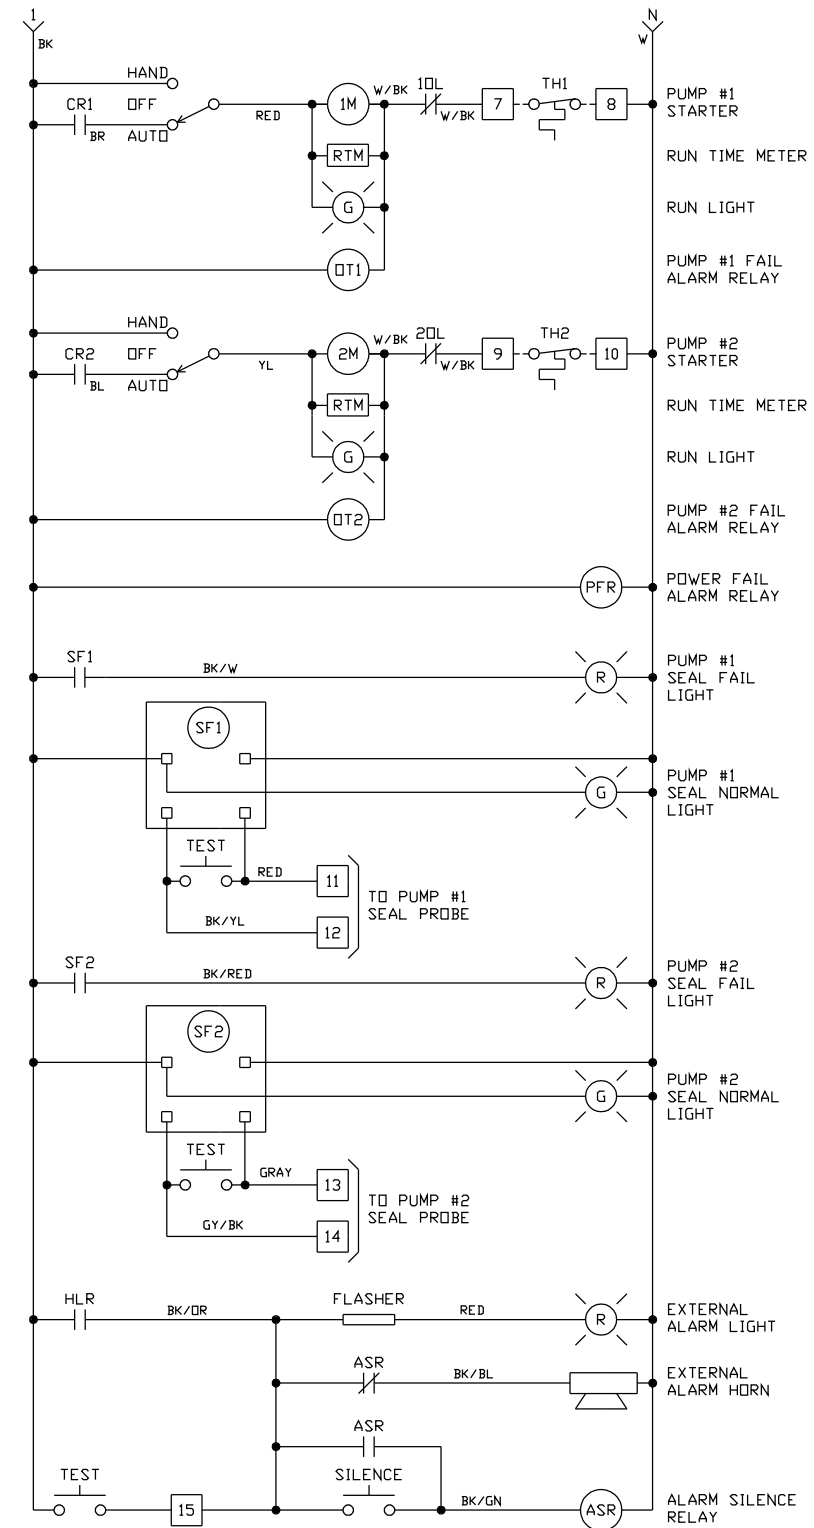
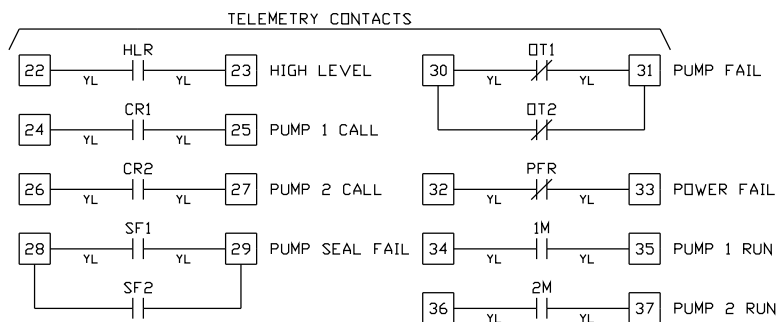
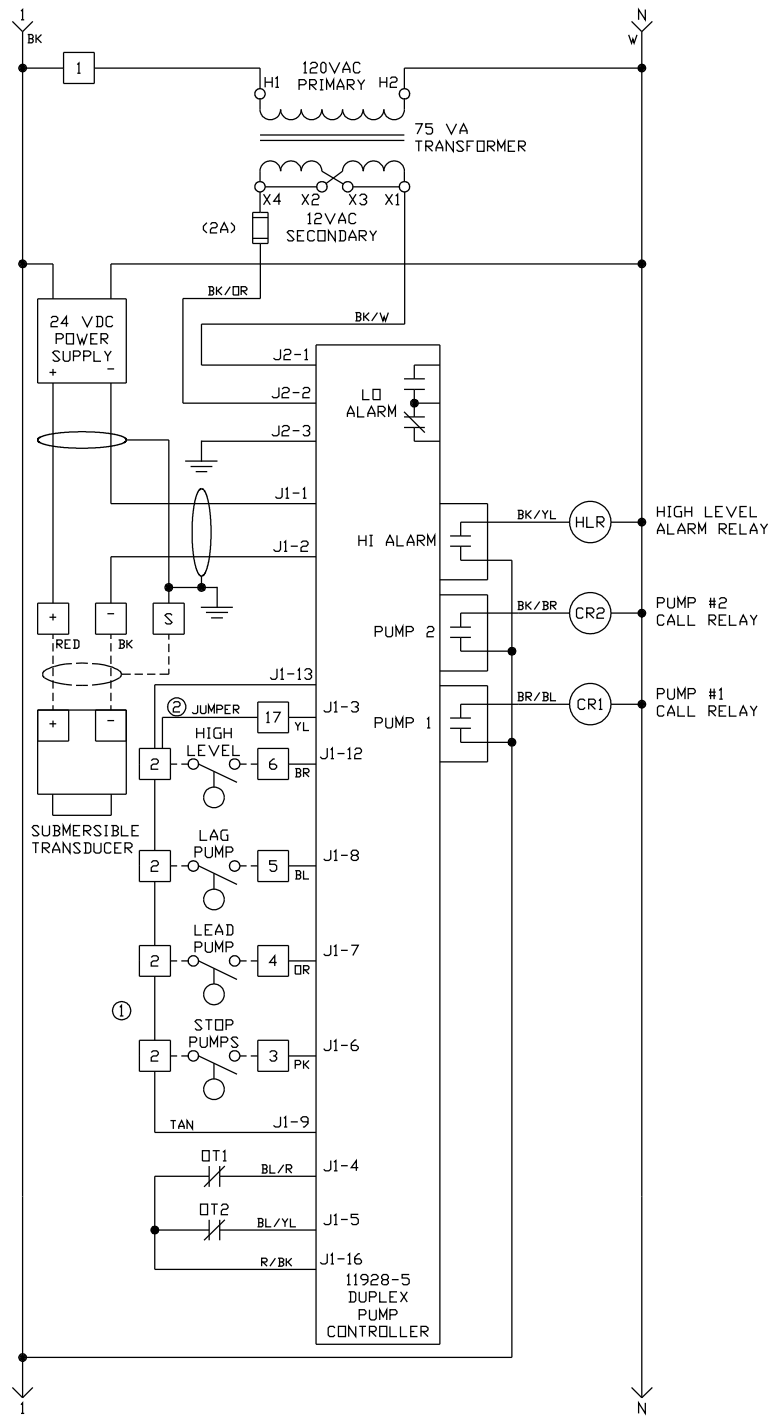


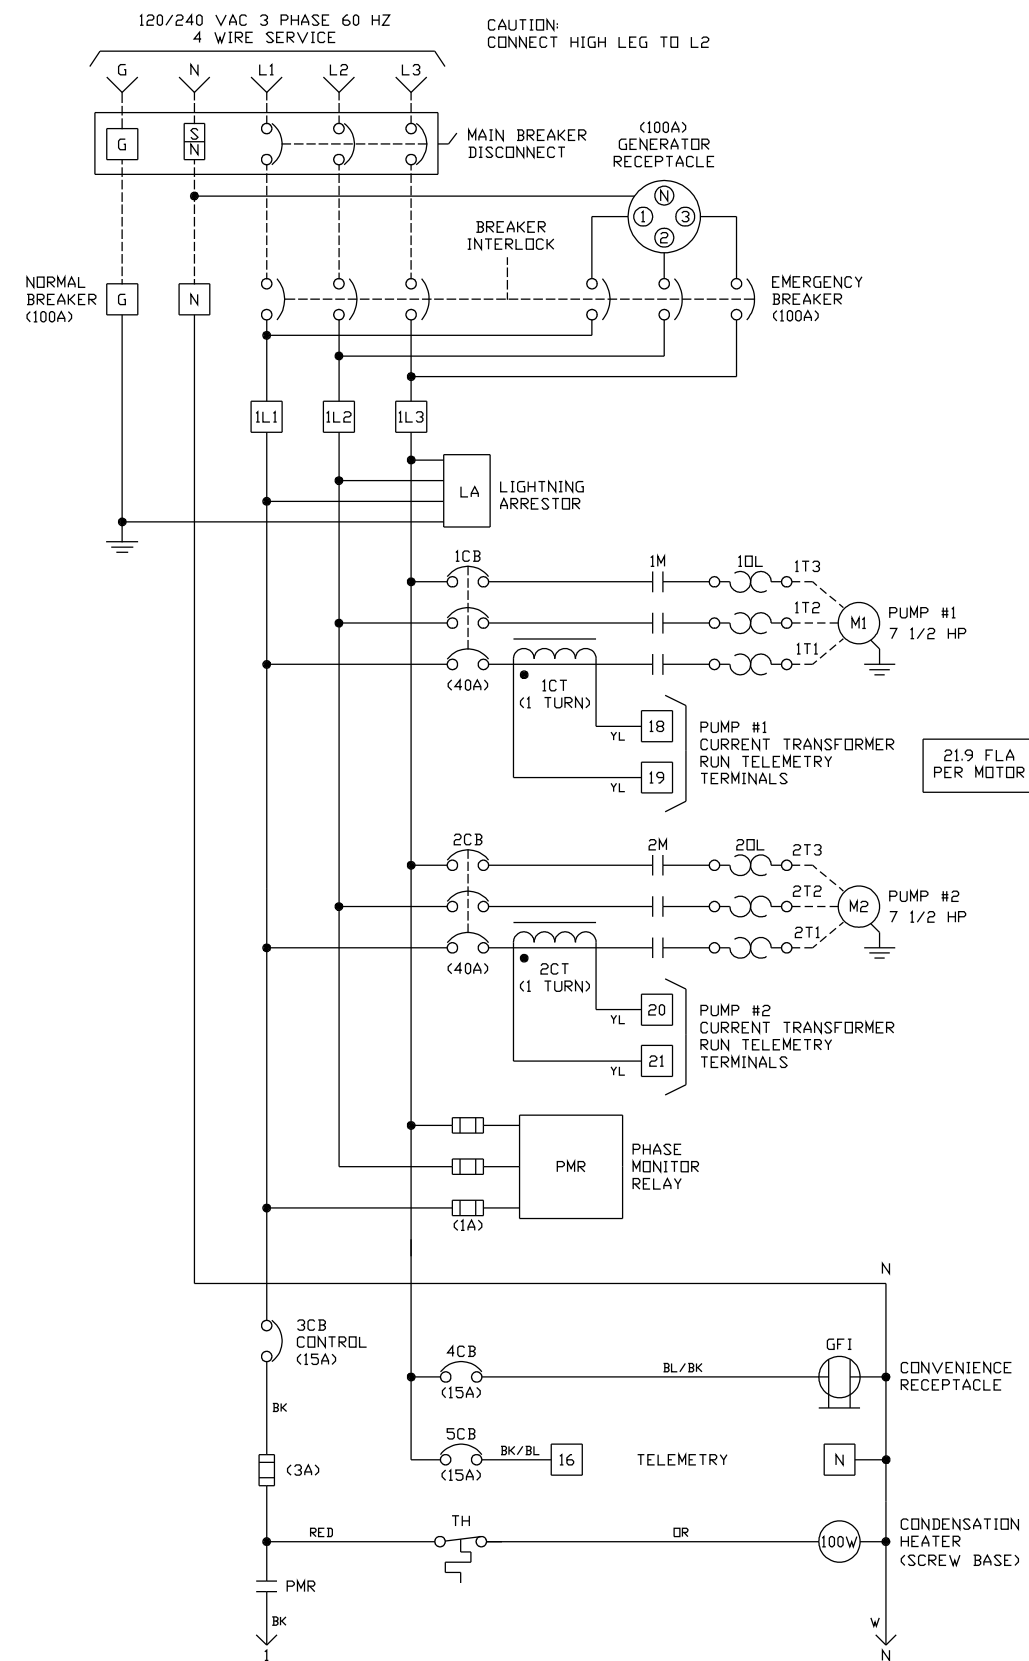

- NOTES:
- ① FLOAT TERMINALS ARE FOR FUTURE USE.
- ② REMOVE WIRE FROM TERMINALS 2 AND 17 FOR FLOAT OPERATION.


REV. NO.	REVISION	BY CHK'D	DATE	DESIGNED BY: MH	DATE 8/27	BBC	
				DRAWN BY: MH	DATE 01	PUMP AND EQUIPMENT COMPANY, Inc. 1125 W. 16th St. P.O. BOX 22098 Indianapolis, Indiana 46222 317/636-1111	
				CHECKED BY:	DATE	DESCRIPTION WALKER & SON / FALLS POINTE BBC #1501-46742	
				SCALE		DWG. NO. AAC 16421	JOB NO.

NEMA 4X STAINLESS STEEL ENCLOSURE
60"H x 36"W x 12"DP
OUTER DOOR NOT SHOWN

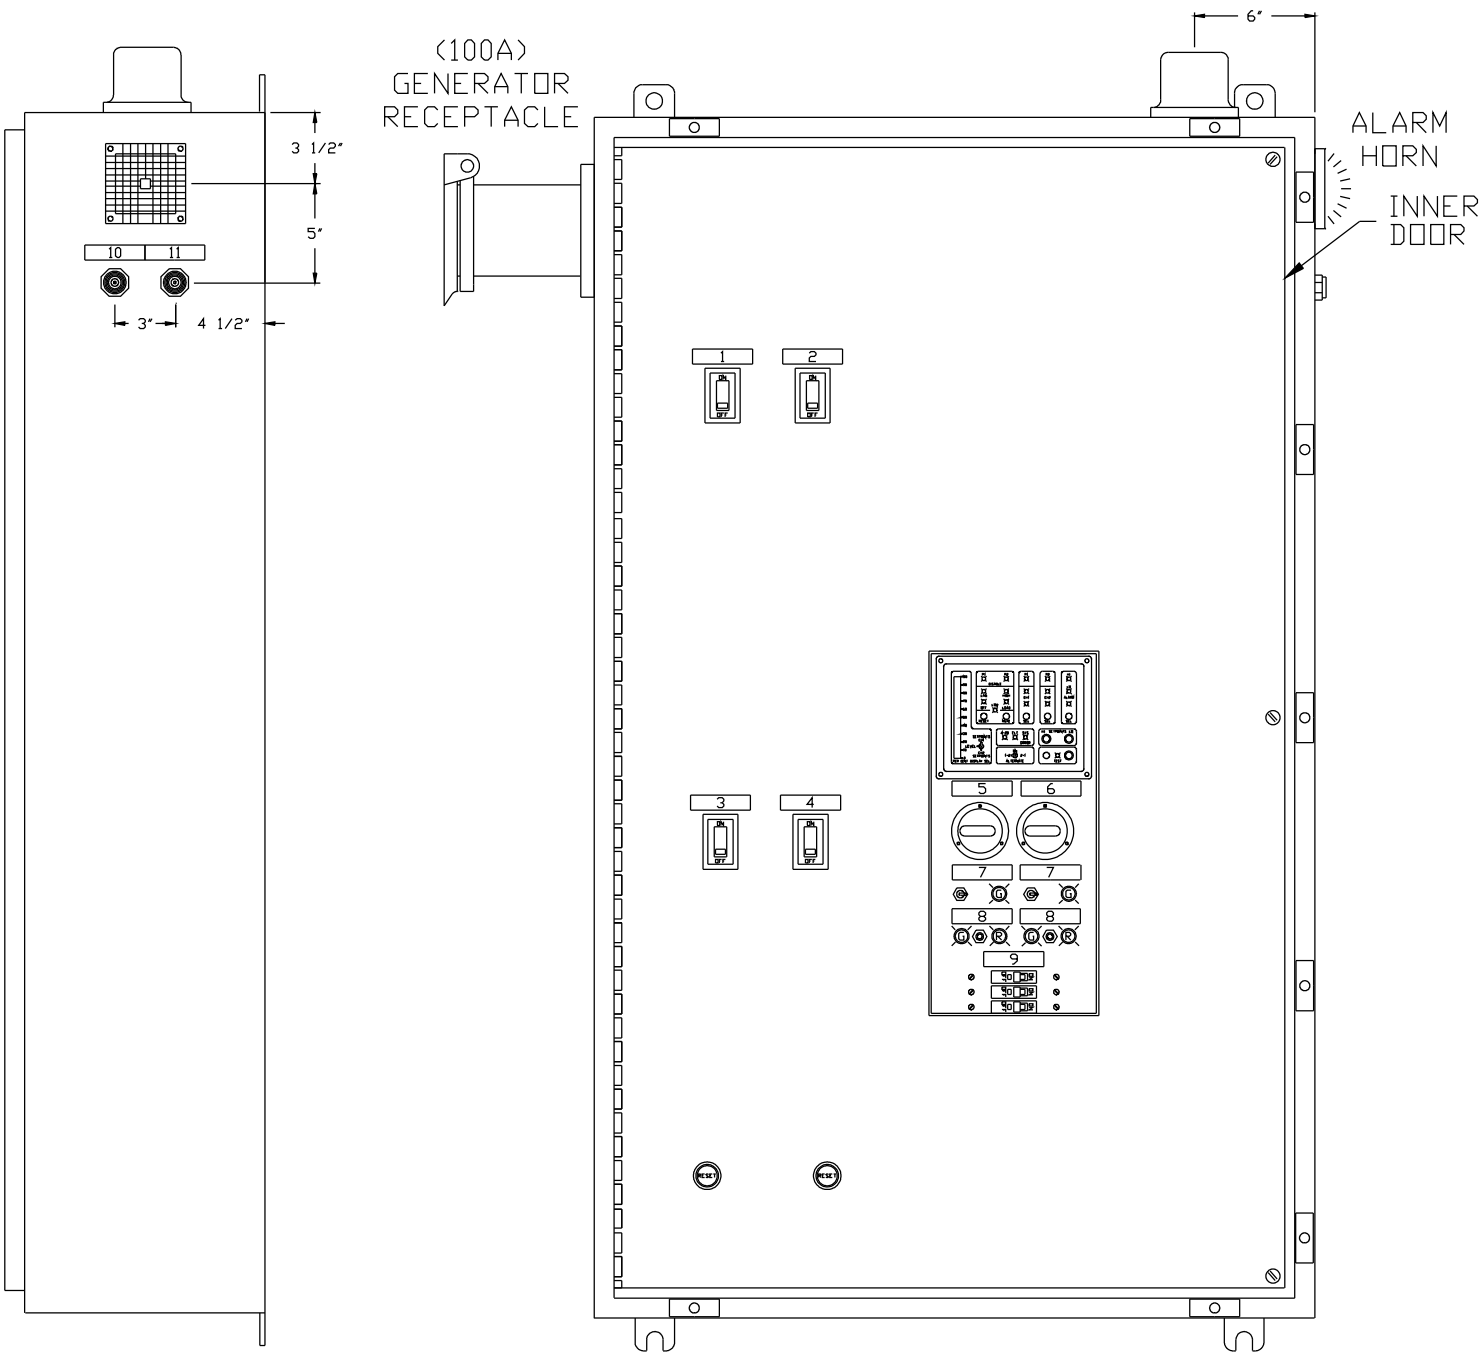

SIDE VIEW

BACK PANEL LAYOUT
57"H x 33"W

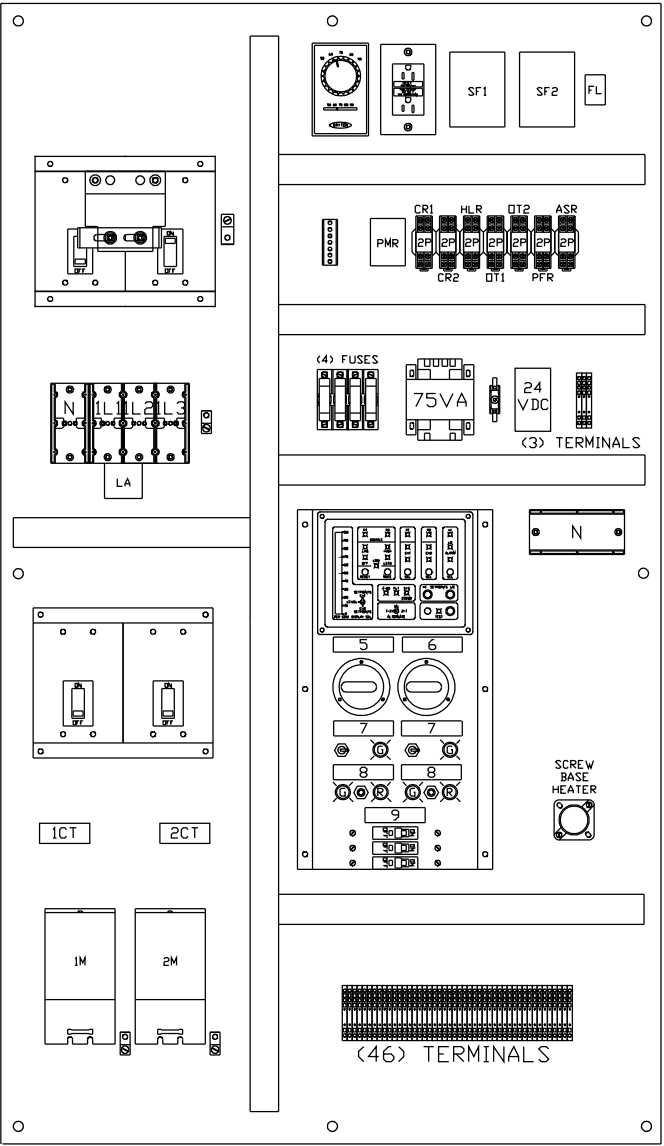

NAMEPLATE LEGEND

- 1. EMERGENCY
- 2. NORMAL
- 3. PUMP 1
- 4. PUMP 2
- 5. PUMP 1 RTM
- 6. PUMP 2 RTM
- 7. HOA RUN
- 8. NORAML TEST FAIL
- 9. CONTROL/CONVENIENCE/TELEMETRY
- 10. ALARM TEST
- 11. ALARM SILENCE

REV. NO.	REVISION	BY CHK'D	DATE	DESIGNED BY:	DATE	BBC PUMP AND EQUIPMENT COMPANY, Inc. 1125 W. 16th St. P.O. BOX 22098 Indianapolis, Indiana 46222 317/636-1111
				MH	8/27	
				DRAWN BY:	DATE	DESCRIPTION WALKER & SON / FALLS POINTE BBC #1501-46742
				MH	01	
				CHECKED BY:	DATE	DWG. NO. PNL 16421
				SCALE		JOB NO.

USEMCO, Inc.
Bill of Material
M 16421

8/27/01 10:14 AM
Page 1

M 16421 - 16421 - WALKER & SON / FALLS POINTE
BBC #1501-46742

Detail	Quantity
----322268 HORN 120VAC FARADAY 6110 CAT.#6114L-0-15-120-60	1.00
----322276.2 LIGHT ALARM AC-DC #BL5R-120VAC	1.00
----365294 LATCH SPRING W/KNURLED KNOB #57-10-201-10	3.00
----420317.1 STARTER SQD 8536 SCO3V02BS 3 POLE NEMA SIZE 1 WITH AMBIENT COMPENSATED BIMETALLIC OVERLOAD RELAYS	2.00
----420410 ROD RESET SINGLE SQD 9066 RA-1	2.00
----421494.07 BAR GROUND KIT SQD PK7GTA	1.00
----421498.2 NEUTRAL ASSEMBLY SQD SN12125	1.00
----421503 BREAKER DOOR MOUNT SQD QOU-115	3.00
----421815 BREAKER 3 PL MLD CA FAL 32040	2.00
----421836 BREAKER 3 PL MLD CA FAL 32100	2.00
----422307.1 RELAY 10A BLTEC 8302-T-120VAC 20,000 OHM - 2 N.O. CONTACTS	2.00
----422339.10 RELAY 10A IDEC RH2B-U-AC120V	7.00
----422348 RELAY PH MNTR DIV #SLA-230-ASA	1.00
----423381.00 POWER SUPPLY IDEC 15 WATT .6 AMPS @ 24 VDC REGULATED	1.00
----423385.1 ARRESTOR LIGHTNING 4W 480V RED JACKET #104-018-5	1.00
----423419 BLOCK TERMINAL ENTRELEC-GRAY ENTRELEC PART #115 116.07	30.00
----423419.0 BLOCK TERMINAL ENTRELEC-BLUE ENTRELEC PART #125 116.01	2.00
----423419.1 BLOCK TERMINAL ENTRELEC-GREEN/YELLOW ENTRELEC PART #165 113.16 ELECTRICALLY GROUNDED TO DIN RAIL	1.00
----423419.2 BLOCK TERMINAL ENTRELEC-YELLOW ENTRELEC PART #105 116.16	16.00
----423419.4 END STOP ENTRELEC-GRAY BAM ENTRELEC PART #103 002.26	6.00
----423419.5 END SECTION FEM6 COVER ENTRELEC ENTRELEC PART #118 368.16	3.00
----423441.04 BLOCK 1PL LINE #2/0 LOAD #4 2 LINE 6 LOAD MARATHON #1431555	1.00
----423441.1 BLOCK 3PL LINE #2/0 LOAD #4 2 LINE 6 LOAD MARATHON #1433555	1.00

USEMCO, Inc.
Bill of Material
M 16421

8/27/01 10:14 AM
Page 2

M 16421 - 16421 - WALKER & SON / FALLS POINTE
BBC #1501-46742

Detail	Quantity
----423480.2 SOCKET RD 8 PIN IDEC SR2P-06	1.00
----423484 SOCKET MIDGET 2P IDEC SH2B-05	7.00
----423502 THERMOSTAT 15A SPDT WWG #2E158	1.00
----423835 OVERLOAD SQD #AR35 AMBIENT COMPENSATED	6.00
----424164 INTERLOCK CIRCUIT BREAKER-FAL	1.00
----425079 FLASHER 120VAC SSAC #FS127	1.00
----425204 RTM REDINGTON 120VAC #711-0165	2.00
----425363 TRNSFMR 75VA SQD 9070 T75D13 120 VAC PRIMARY 12/24 VAC SECONDARY	1.00
----425390 TRNSFMR CURRENT SQD 2NR500 50:5 RATIO	2.00
----426000 FUSE 250V ONE-TIME 1 AMP CLASS K5 50,000 A.I.R. 2" LONG x 9/16" DIAMETER (BUSSMANN NON-1) (LITTELFUSE NLN-1) (GOULD-SHAWMUT OT-1)	3.00
----426104 FUSE 250V TIME-DELAY 3 AMP CLASS RK5 200,000 A.I.R. 2" LONG x 9/16" DIAMETER (BUSSMANN FRN-R3) (LITTELFUSE FLN-R3) (GOULD-SHAWMUT TR-3R)	1.00
----426521 BLOCK FUSE MARATHON F30A1S	1.00
----426522 BLOCK FUSE MARATHON F30A3S	1.00
----426525 BLOCK FUSE LITTELFUSE 354812GY	1.00
----428905.1 WIRE DUCT BASE 1.5" X 3"	8.00
----428908.1 WIRE DUCT COVER 1.5"	8.00
----429094.04 DECAL USEMCO 2"x3" MADE IN USA	1.00
----429105 DECAL USEMCO LIMITED WARRANTY	1.00
----445040.1 FUSE SLO BLO 2A 250V LITTELFUSE #313002 3AG	1.00
----460600 NIPPLE CHASE T&B 842 1/2"	1.00
----461022 BSHNG KNOCKOUT T&B #3210 1/2"	1.00
----462003 BOX JUNCTION 2x4 RACO 670 OR STEEL CITY 583711/2 GRAINGER #4A239	1.00
----462006 BOX C/AL 2x4 RED DOT IH3-1-LM	1.00
----462340.20 RECEIPT CROUSE-HINDS AR1041-S22 100 AMP 4 WIRE 4 POLE	1.00
----462357 RECEIPT GFI 15A 120V P&S 1591RI	1.00
----462851 ENCL N4X SNGL HOF A60H3612SSLP	1.00
----463224 ENCL BP HOF A60P36	1.00

USEMCO, Inc.
Bill of Material
M 16421

8/27/01 10:14 AM
Page 3

M 16421 - 16421 - WALKER & SON / FALLS POINTE
BBC #1501-46742

Detail	Quantity
----469004 LUG ALUM SOLDERLESS MAX. #2 ILSCO TA-2, BLACKBURN ADR-2, BRUNDY KA2U OR EQUAL	4.00
----469070 HEATER PANEL 120V CHRO SCB-100	1.00
----469071 LAMPHOLDER PORCELAIN KEYLESS ANGELLO #22273	1.00
----470401 SWITCH TOG SPDT 3 POS #91-0003 10 AMP ON OFF ON MC GILL	2.00
----470500.1 SWITCH PB SQD 9001 SKR-1U	2.00
----470561 SWITCH PB NO CARLINGSWITCH #172 OR SELECTA SWITCH #SS228BG	2.00
----472081 BLOCK CONTACT SQD 9001 KA2	2.00
----480110.10 LIGHT IND #930-505X-710RN-120 SCREW TYPE LUG LITTELFUSE	2.00
----480111.10 LIGHT IND #930-505X-710GN-120 SCREW TYPE LUG LITTELFUSE	4.00
----500549.606 FLANGE, INNER DOOR 55"x 3.5"	1.00
----500570 INNERDOOR 60x36x08 N4&12 12"DP	1.00
----500584.17 STANDOFF 2FAL3P FOR 8" DEPTH	1.00
----500584.20 STANDOFF FAL INTERLOCK - 8" DEPTH	1.00
----500587.05 STANDOFF "INDY" DIGITAL FOR 8" DEPTH	1.00
-----421836 BREAKER 3 PL MLD CA FAL 32100	1.00
-----421888 ENCL CKT BREAKER SQD #FA100DS	1.00
-----421890 NEUTRAL ASSEMBLY SQD SN100FA	1.00