


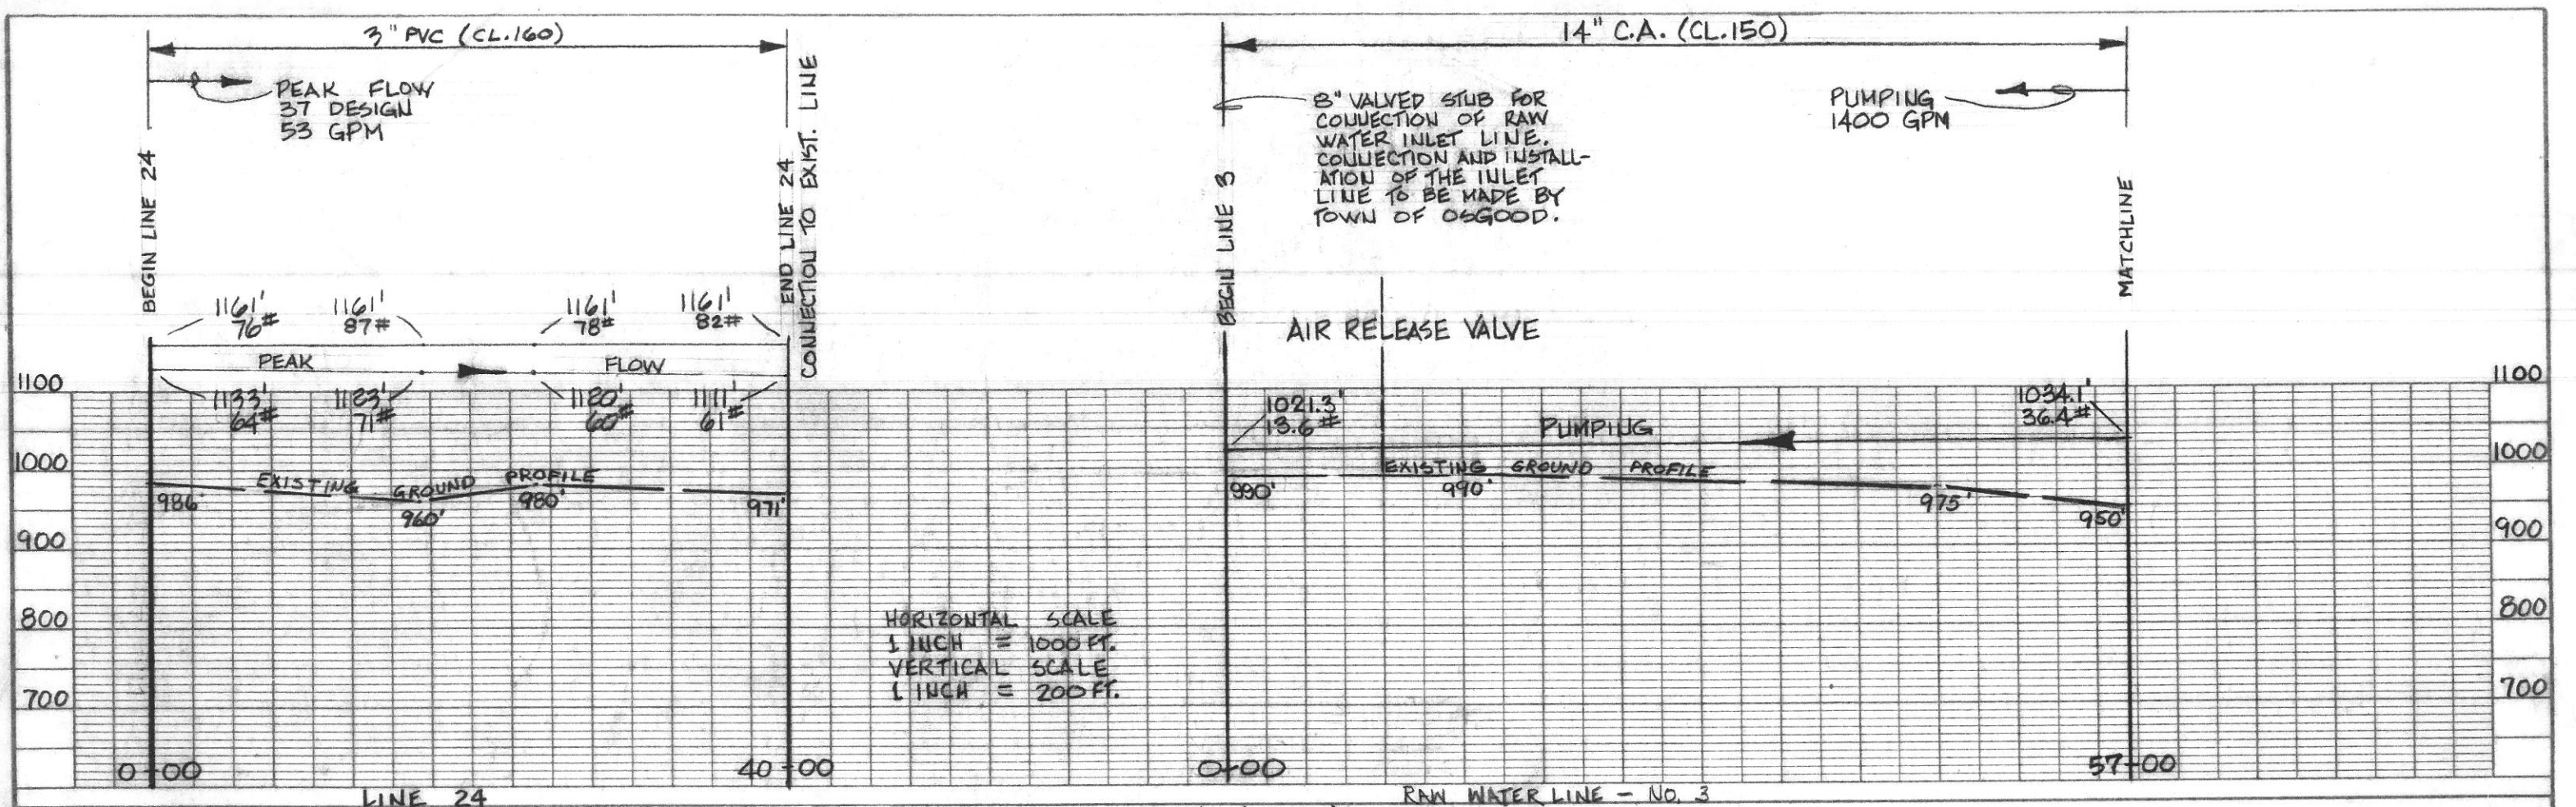


NOTE:
AIR RELEASE VALVES TO
BE LOCATED AT HIGH POINTS
TO SUIT FIELD CONDITIONS.

PUMPING
1400 GPM THRU 14" C.A. = 2.248' LOSS/1000'
19 x 2.248 = 42.7' TOTAL LOSS

PUMPING 1400 GPM

PROPOSED CONNECTION
TO THE TOWN OF
OSGOOD'S EXIST.
TREATMENT PLANT
DISCHARGE LINE.

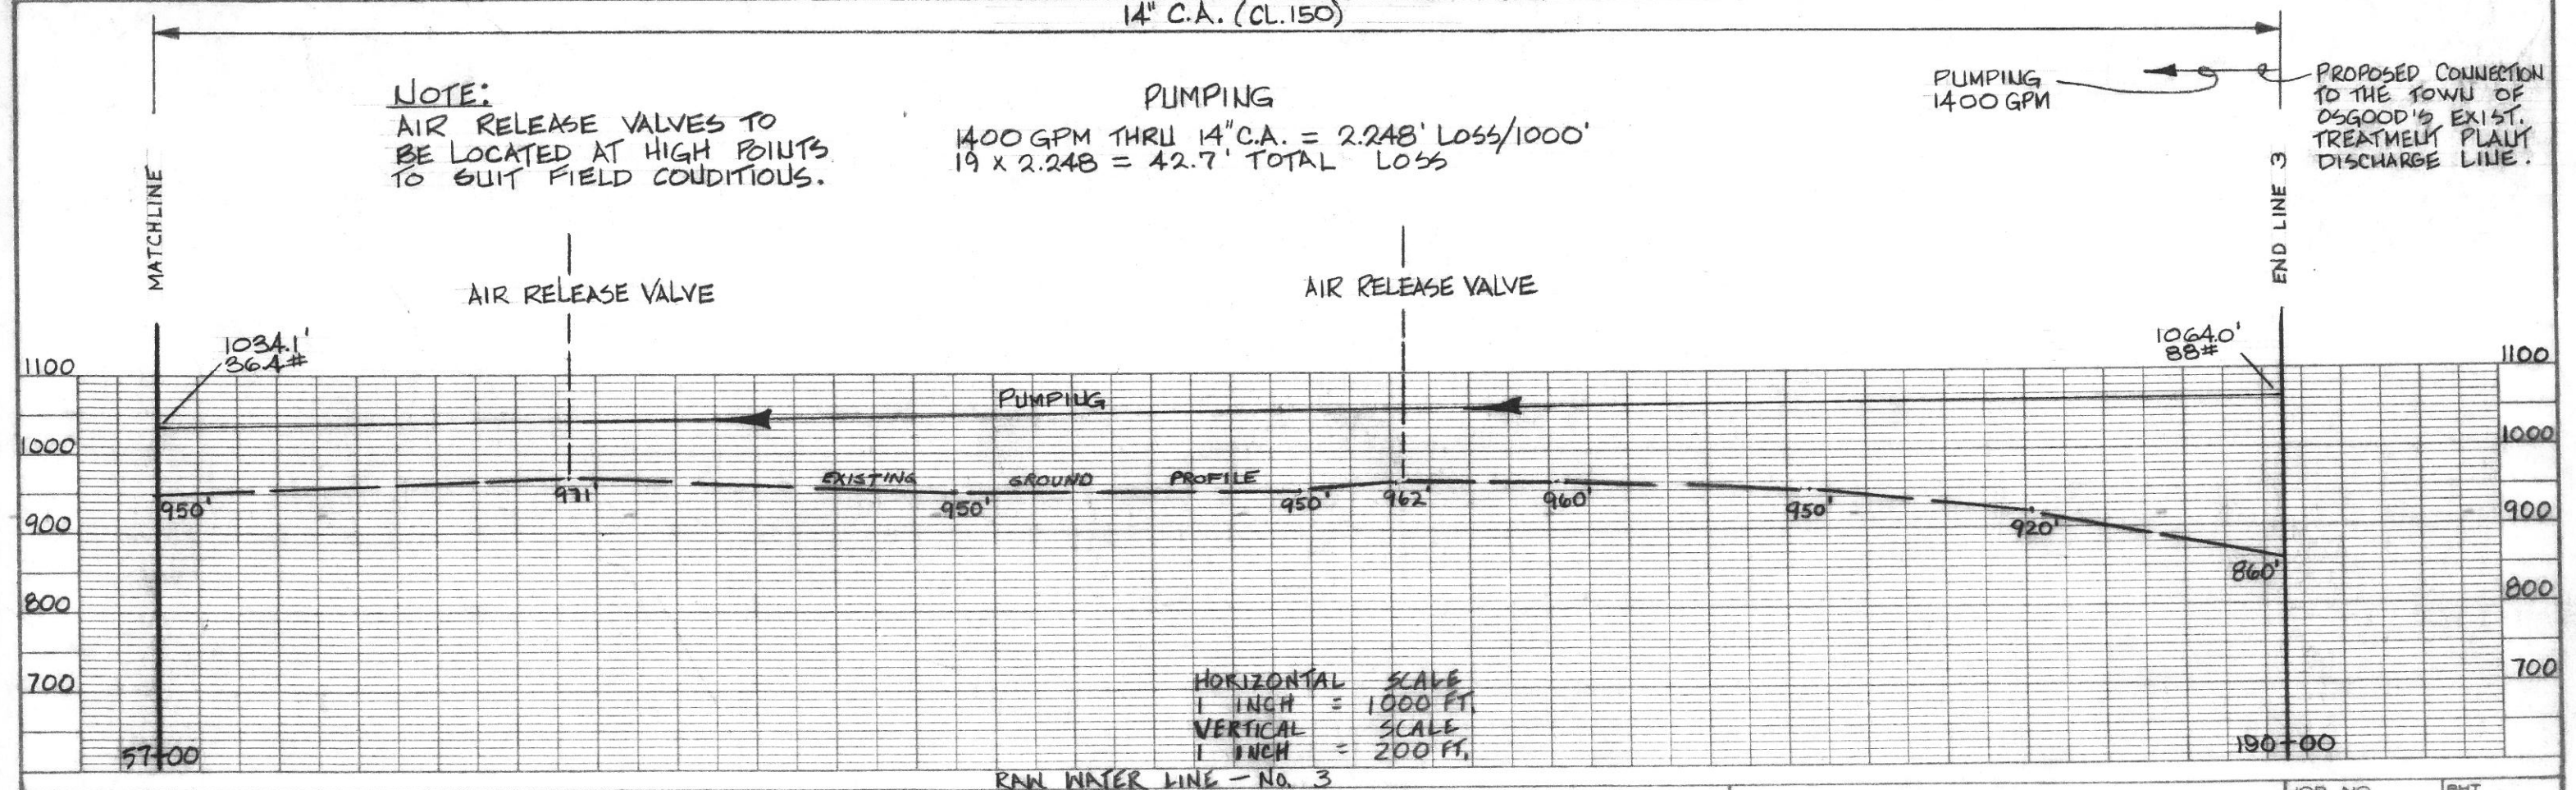

DRAWN BY
DATE
HYDRAULICS BY
DATE

CERTIFIED BY
DATE

SIECO, INC.
CONSULTING ENGINEERS,
ARCHITECTS, PLANNERS

ELROD WATER COMPANY, INC.
RIPLEY COUNTY, INDIANA

LINE(S): LINES 24, 3 - RAW WATER
DIVISION: "A"

JOB NO.
61140
SCALE:
AS SHOWN

SHT.
70
OF
89