

GROUND ELEV. = 980.0 ±
MAX. STATIC PRESS. = 77.9 PSI ±

WEST COUNTY LINE ROAD


GROUND ELEV. = 991.0 ±
MAX. STATIC PRESS. = 73.2 PSI ±



GROUND ELEV. = 991.0 ±
MAX. STATIC PRESS. = 73.2 PSI ±

WEST COUNTY LINE ROAD

GROUND ELEV. = 951.0 ±
MAX. STATIC PRESS. = 90.5 PSI ±

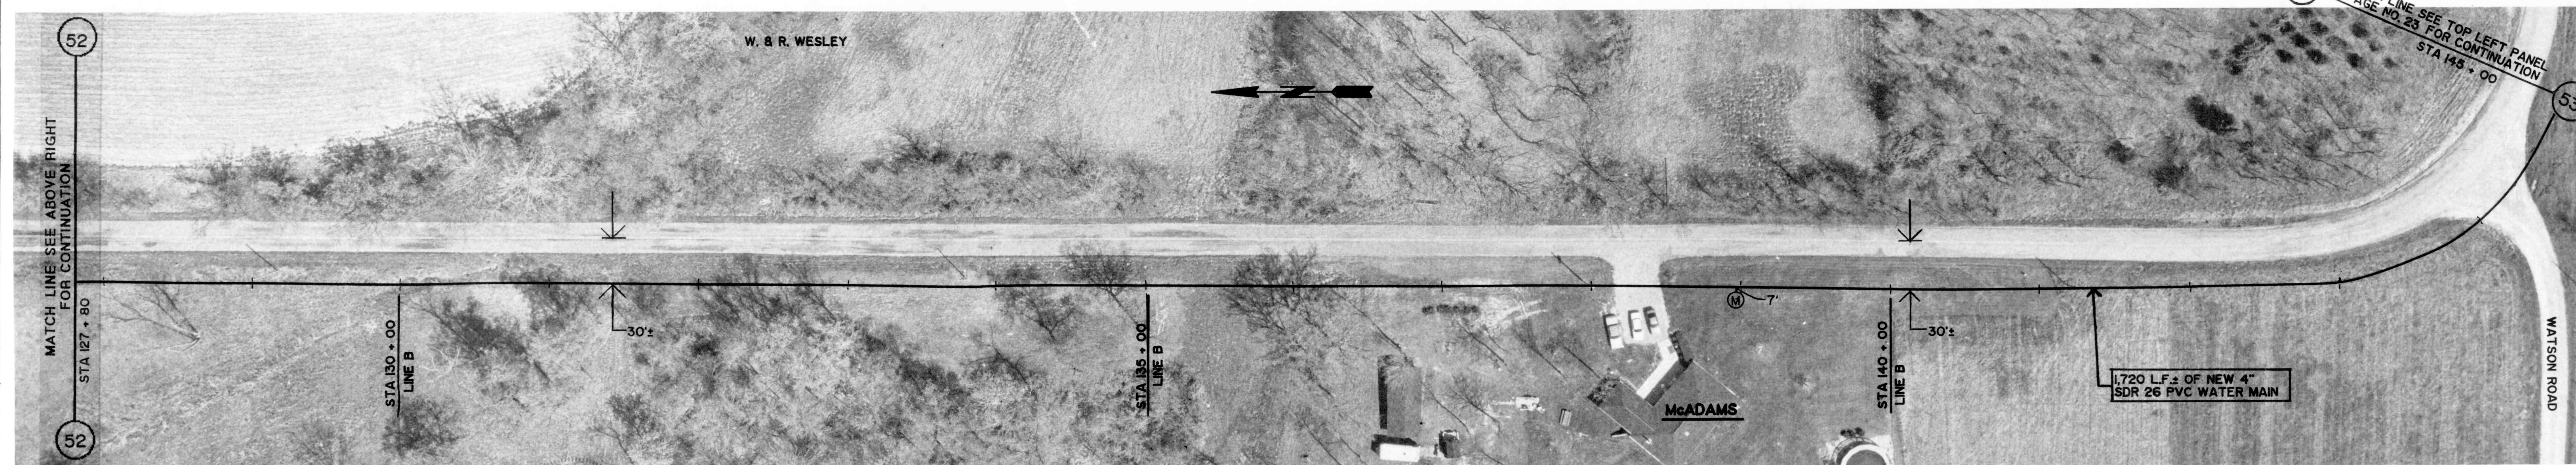

GROUND ELEV. = 951.0 ±
MAX. STATIC PRESS. = 90.5 PSI ±

WEST COUNTY LINE ROAD

GROUND ELEV. = 960.0 ±
MAX. STATIC PRESS. = 85.6 PSI ±

REVISIONS	DRAWN BY	Robert E. Curry	ROBERT E. CURRY & ASSOCIATES, INC. CONSULTING ENGINEERS	ELROD WATER COMPANY INC. DIVISION "D" DISTRIBUTION SYSTEM EXTENSIONS	4" PVC WATER MAIN EXTENSION ALONG WEST COUNTY LINE ROAD	JOB NO.	SHT.
	DATE	10/1/19				SCALE	OF
	CERTIFIED BY	REC				1" = 50'	43
	DATE	10/1/19					