



CALL BEFORE YOU DIG
 IT IS THE CONTRACTOR'S RESPONSIBILITY TO CONTACT UTILITY COMPANIES PRIOR TO ANY CONSTRUCTION. THE LOCATION OF UTILITIES SHOWN ON THESE PLANS ARE APPROXIMATE AND POSSIBLY INCOMPLETE. THEREFORE CERTIFICATION TO THE LOCATION OF ALL UNDERGROUND UTILITIES IS WITHHELD.

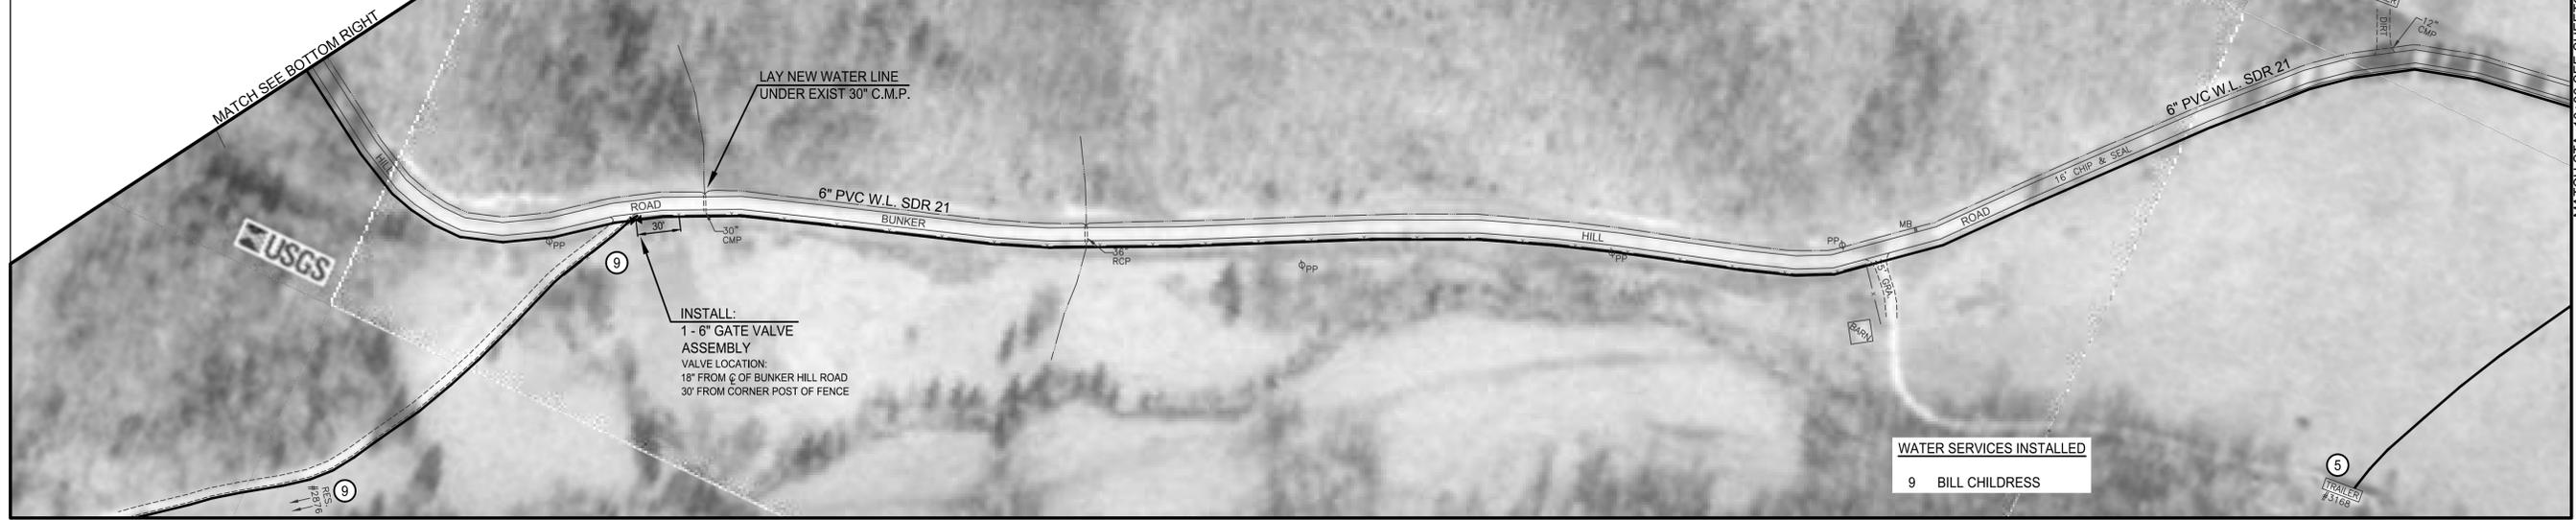

CONSTRUCTION NOTES:

- LAY WATER LINES WITH 2'-6" COVER APPROXIMATELY WHERE SHOWN ON PLANS.
- ALL WATERLINES SHALL BE PVC SDR 21 WITH DUCTILE IRON FITTINGS.



WATER SERVICES INSTALLED
 9 BILL CHILDRESS

MATCH STA. 10+86 SEE SHEET C-03

This document, originally issued, sealed, and signed by James W. Hilborn, Kentucky Professional Engineer, No. 16514, on March 14, 2011, shall not be used in lieu of a certified document.

GRW PROJECT NO. 3827-02
 ALL RIGHTS RESERVED. THIS DOCUMENT IS THE PROPERTY OF GRW ENGINEERS, INC. AND SHALL BE REPRODUCED IN WHOLE OR IN PART WITHOUT WRITTEN PERMISSION FROM GRW ENGINEERS, INC. OTHERWISE THAN THIS SPECIFIC PROJECT.



6" PVC BUNKER HILL RD. LINE (WEST)
2" PVC BUNKER HILL RD. LINE (WEST)
 WATER LINE EXTENSION
 CITY OF LOBELVILLE AND PERRY COUNTY TENNESSEE



PRINTED: 10/20/2014 @ 11:50AM
 FILE NAME: I:\3827-Lobelville\02-Deer Creek\Working Drawings\Deer Creek\RECORD Dwg\3827-C-09m.c-09.dwg

EROSION CONTROL NOTES:

- All work shall be done in accordance with the Storm Water Pollution Prevention Plan (SWPPP).
- No work may proceed until a Notice of Coverage (NOC) has been issued by the State of Tennessee Department of Environment and Conservation.
- SWPPP must be available at the site for review at all times.
- At a minimum, the Contractor shall install silt fence on the downhill side of the proposed water line construction area.
- Contractor shall provide ditch checks as required.
- Contractor shall furnish and install temporary erosion control blanket/matting on all slopes greater than 2.5:1
- All areas to remain bare more than 15 days must be temporarily stabilized in accordance with the current Best Management Practices (BMP's).
- Erosion controls shall be checked and repaired if necessary at least twice each calendar week in accordance with the SWPPP.
- All erosion control measures utilized within State of Tennessee ROW's shall meet or exceed the TDOT requirements.

CONSTRUCTION NOTES:

- LAY WATER LINES WITH 2'-6" COVER APPROXIMATELY WHERE SHOWN ON PLANS.
- ALL WATERLINES SHALL BE PVC SDR 21 WITH DUCTILE IRON FITTINGS.

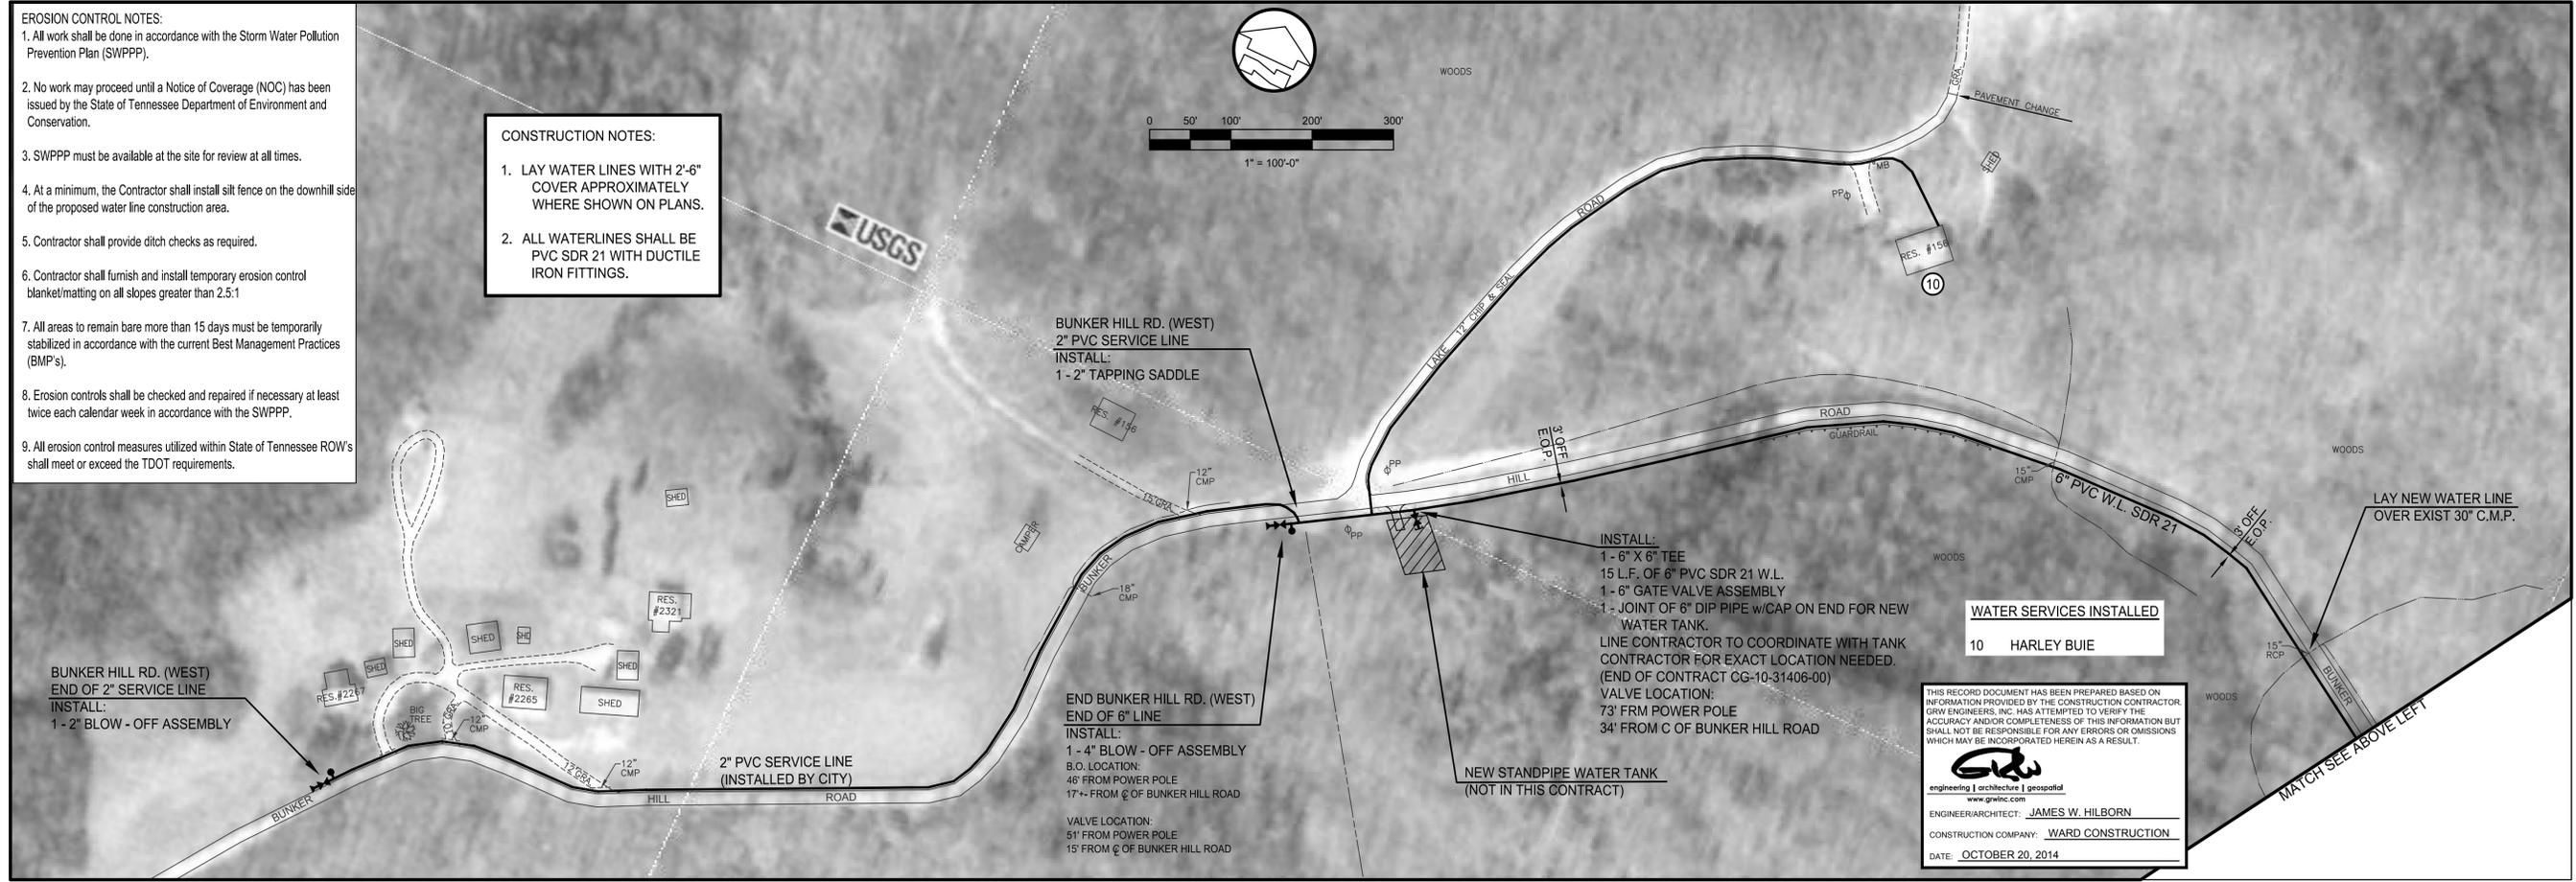

WATER SERVICES INSTALLED
 10 HARLEY BUIE

THIS RECORD DOCUMENT HAS BEEN PREPARED BASED ON INFORMATION PROVIDED BY THE CONSTRUCTION CONTRACTOR, GRW ENGINEERS, INC. HAS ATTEMPTED TO VERIFY THE ACCURACY AND/OR COMPLETENESS OF THIS INFORMATION BUT SHALL NOT BE RESPONSIBLE FOR ANY ERRORS OR OMISSIONS WHICH MAY BE INCORPORATED HEREIN AS A RESULT.

engineering | architecture | geospatial
 www.grwinc.com
 ENGINEER/ARCHITECT: JAMES W. HILBORN
 CONSTRUCTION COMPANY: WARD CONSTRUCTION
 DATE: OCTOBER 20, 2014

NO.	DATE	DESCRIPTION	DESIGNED	DRAWN	REVIEWED	APPROVED
			JWH	SG	JWH	JWH

DATE: JULY 2010
 SCALE: AS NOTED
 SHEET NO. C-09