



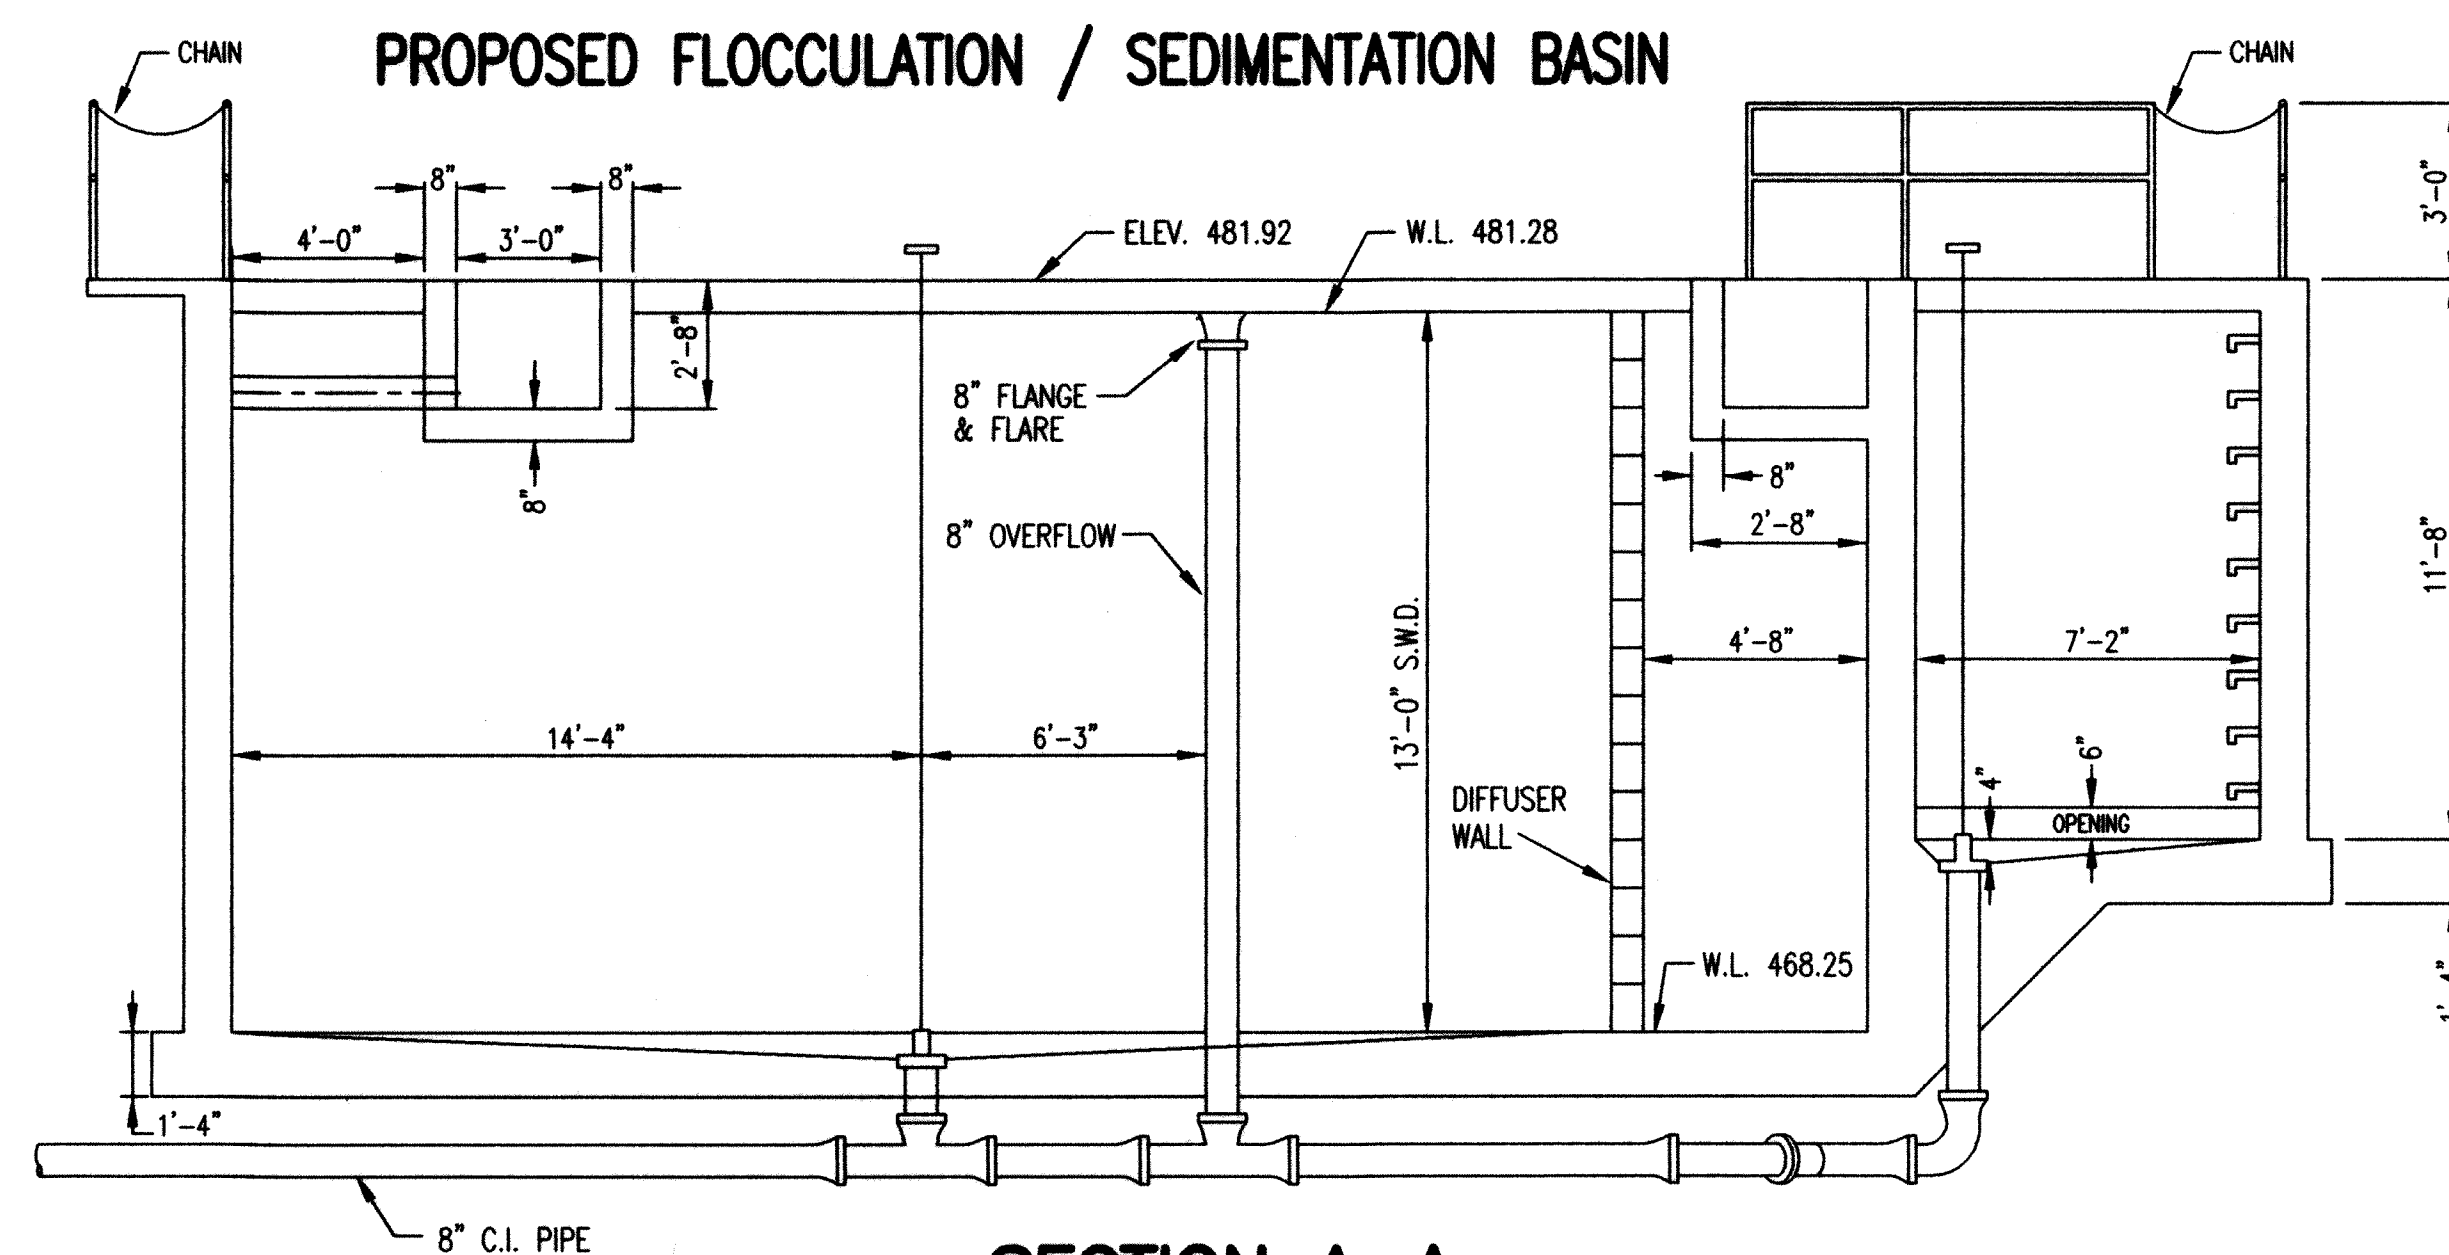

SECTION A-A
SCALE: 1/4" = 1'-0"

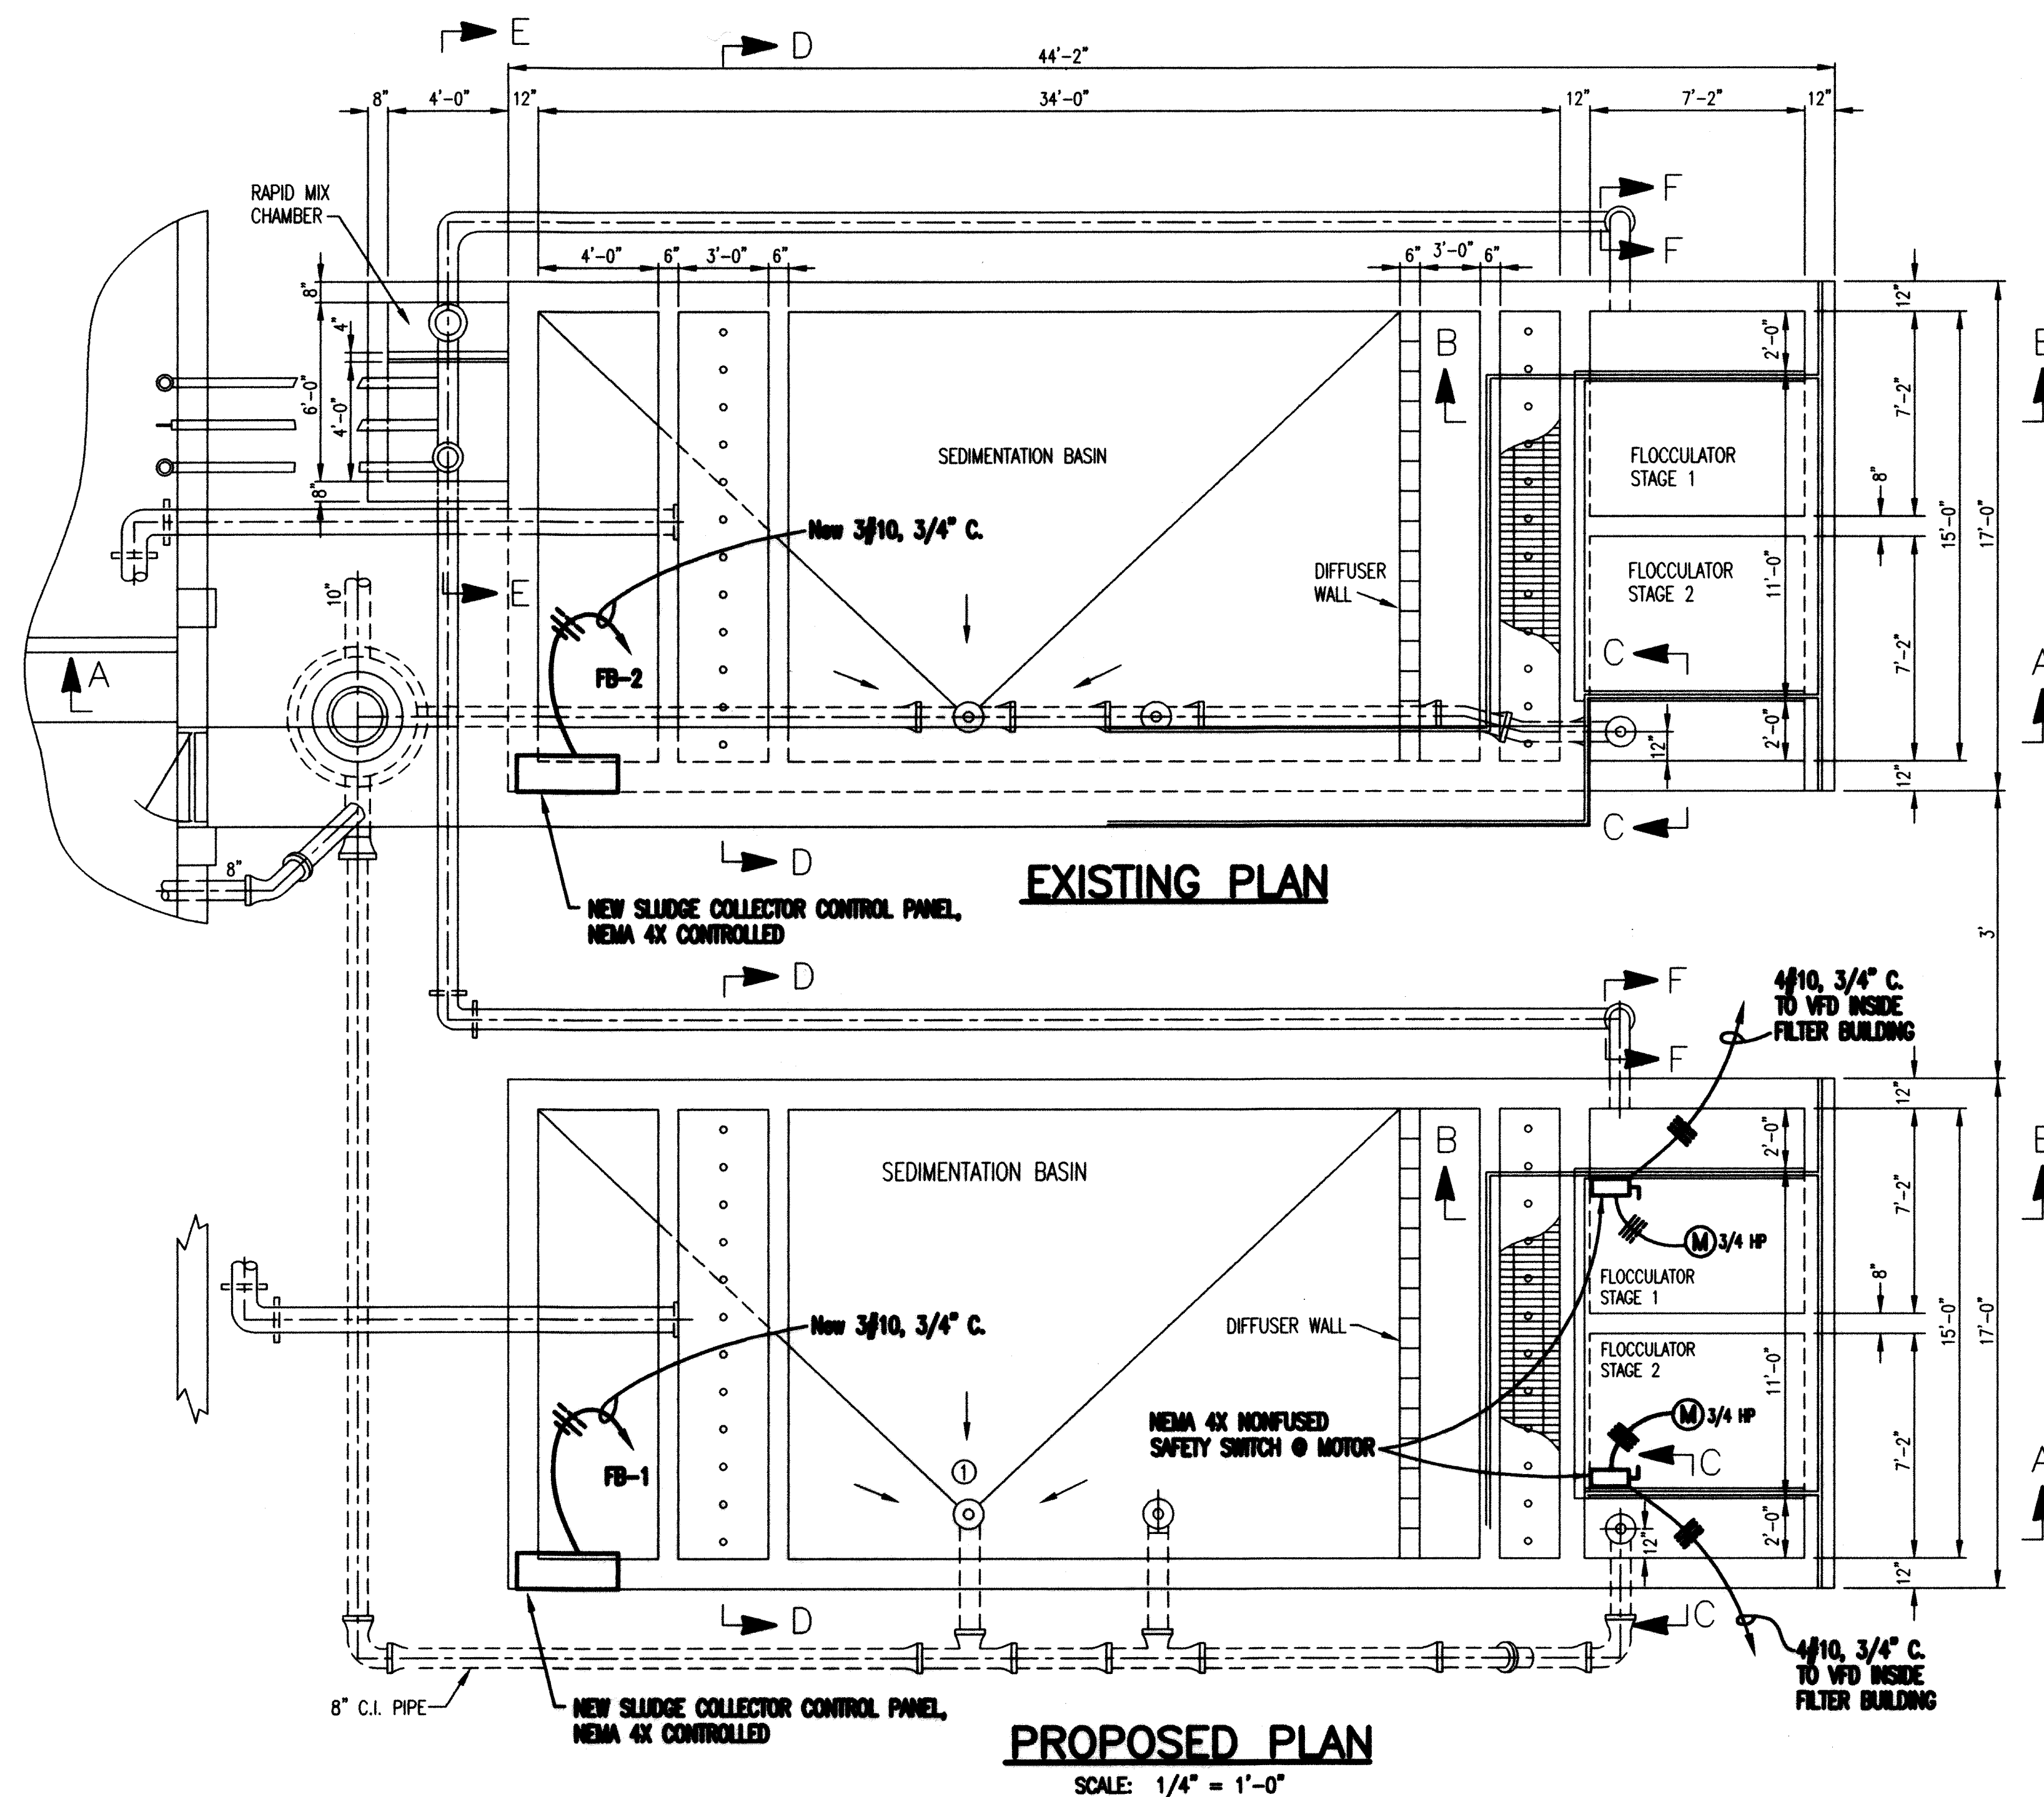

PROPOSED PLAN
SCALE: 1/4" = 1'-0"


NOTE:

- * CONTRACTOR SHALL ROUTE CONDUITS TO AVOID CONFLICTS WITH DOORWAYS, WALKWAYS, AND EQUIPMENT REMOVAL OPERATIONS.
- * GROUT AROUND CONDUITS WHERE THEY ENTER THE BUILDING.
- * DETAILED WIRING FROM SLUDGE COLLECTOR CONTROL PANEL TO DRIVE UNIT AND ACCESSORIES SHALL BE PER ACCEPTED MANUFACTURER SHOP DRAWINGS. SEE DIVISION II SPECIFICATIONS FOR THE INFORMATION ABOUT THIS SYSTEM.

GRW PROJECT NO. 7385

**WATER TREATMENT PLANT EXPANSION
LOBELVILLE, TENNESSEE
NEW FLOCCULATION / SEDIMENTATION BASIN**

THIS DOCUMENT IS THE PROPERTY OF GRW ENGINEERS, INC. AND SHALL NOT BE REPRODUCED IN WHOLE OR IN PART OR USED FOR CONSTRUCTION OF OTHER THAN THIS SPECIFIC PROJECT WITHOUT WRITTEN PERMISSION OF GRW ENGINEERS, INC.			
NO.	DESCRIPTION	DATE	BY
REVISIONS			

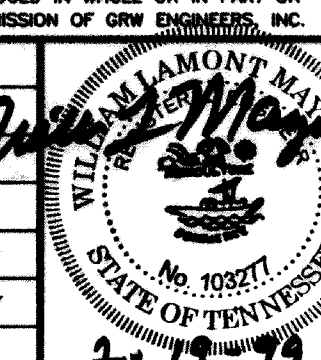

GRW
GRW Engineers, Inc.
Engineers, Architects, Planners
LEXINGTON LOUISVILLE NASHVILLE INDIANAPOLIS

DESIGNED: KRS	DATE: DECEMBER, 1998
DRAWN: GAM	SCALE: 1/4" = 1'-0"
REVIEWED: KRS	SHEET NO.
APPROVED: JWH	E-1