



Defect Listing

Pipe Segment Refere... A8-7_A8-6	City Oliver Springs	Street Main St	Material Fibreglass Reinforc...	Location C... Light High...	Sewer Use Sanitary
Upstream MH A8-7	Total Length 40.1	Year Laid	Shape Circular	Location Details	
DS Manhole A8-6	Length surveyed 40.1	Year Renewed	Height 8	Width 8	Pipe Joint... N/A

SPR N/A	MPR 8	PO Number 4397-03	Customer GRW
SPRI N/A	MPRI 2.7	Work Order 4397-02	Purpose Pre-Rehabilitation Survey
QSR N/A	QMR 4122		
OPR 8	Surveyed By Barry Rogers	Direction Downstream	Date 20150811
OPRI 2.7	Certificate Number U-1012-16405	Pre-Cleaning Jetting	Time 14:43
	Date Cleaned 20150811	End Time 14:49	Weather Dry
			Media label
			Additional Info

Distance	Condition	Cont. Dfct.	Values			Joint	Clock Position		Grade
			1st	2nd	%		At/From	To	
0.0 ft.	Access Point Manhole				0	<input type="checkbox"/>			
Remarks: A8-7									
0.0 ft.	Water Level				5	<input type="checkbox"/>			
6.1 ft.	Deposits Attached Grease				5	<input type="checkbox"/>	9	3	2
Remarks: This is a continious defect									
11.1 ft.	Camera Underwater					<input type="checkbox"/>			4
11.2 ft.	Water Level Sag				25	<input type="checkbox"/>			2
38.9 ft.	Water Level				10	<input type="checkbox"/>			
40.1 ft.	Access Point Manhole				0	<input type="checkbox"/>			
Remarks: A8-6									

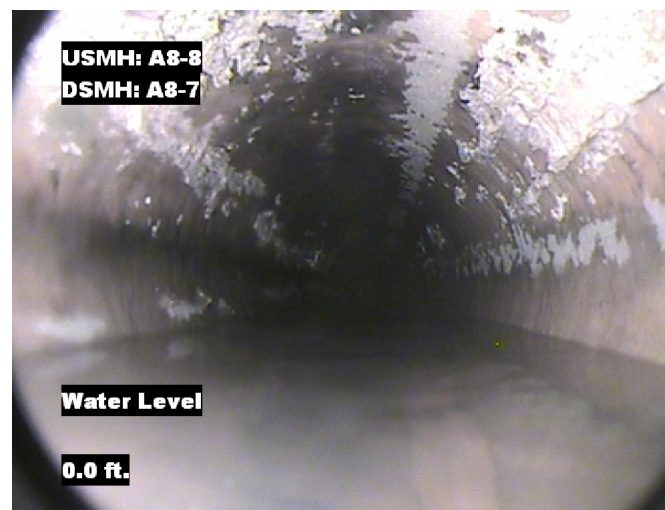


Image Report 4/Page

Pipe Segment Refere...	City	Street	Material	Location C...	Sewer Use
A8-7_A8-6	Oliver Springs	Main St	Fibreglass Reinforc...	Light High...	Sanitary
Upstream MH	Total Length	Year Laid	Shape	Location Details	
A8-7	40.1		Circular		
DS Manhole	Length surveyed	Year Renewed	Height	Width	Pipe Joint...
A8-6	40.1		8	8	N/A



Distance: 0.0 ft. Grade: 0
Condition: Access Point Manhole
Remarks: A8-7



Distance: 0.0 ft. Grade: 0
Condition: Water Level
Remarks: N/A



Distance: 6.1 ft. Grade: 2
Condition: Deposits Attached Grease
Remarks: This is a continious defect



Distance: 11.1 ft. Grade: 4
Condition: Camera Underwater
Remarks: N/A

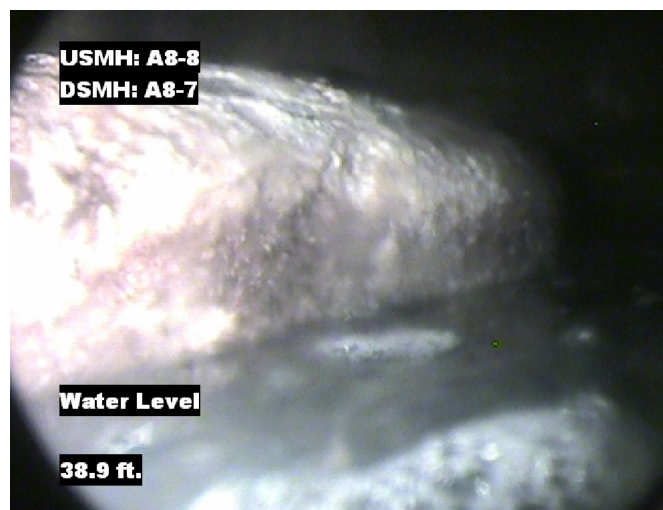


Image Report 4/Page

Pipe Segment Refere...	City	Street	Material	Location C...	Sewer Use
A8-7_A8-6	Oliver Springs	Main St	Fibreglass Reinforc...	Light High...	Sanitary
Upstream MH	Total Length	Year Laid	Shape	Location Details	
A8-7	40.1		Circular		
DS Manhole	Length surveyed	Year Renewed	Height	Width	Pipe Joint...
A8-6	40.1		8	8	N/A



Distance: 11.2 ft. Grade: 2
Condition: Water Level Sag
Remarks: N/A



Distance: 38.9 ft. Grade: 0
Condition: Water Level
Remarks: N/A



Distance: 40.1 ft. Grade: 0
Condition: Access Point Manhole
Remarks: A8-6



Pipe Segment Refere...	City	Street	Material	Location C...	Sewer Use
A8-7_A8-6	Oliver Springs	Main St	Fibreglass Reinforc...	Light High...	Sanitary
Upstream MH	Total Length	Year Laid	Shape	Location Details	
A8-7	40.1		Circular		
DS Manhole	Length surveyed	Year Renewed	Height	Width	Pipe Joint...
A8-6	40.1		8	8	N/A
SPR	N/A	MPR	8	Customer	
SPRI	N/A	MPRI	2.7	GRW	
QSR	N/A	QMR	4122	Purpose	
OPR	Surveyed By	Direction	Date	Media label	
8	Barry_Rogers	Downstream	20150811		
OPRI	Certificate Number	Pre-Cleaning	Time	Weather	
2.7	U-1012-16405	Jetting	14:43	Dry	
Date Cleaned			End Time	Additional Info	
20150811			14:49		

[illegible]