


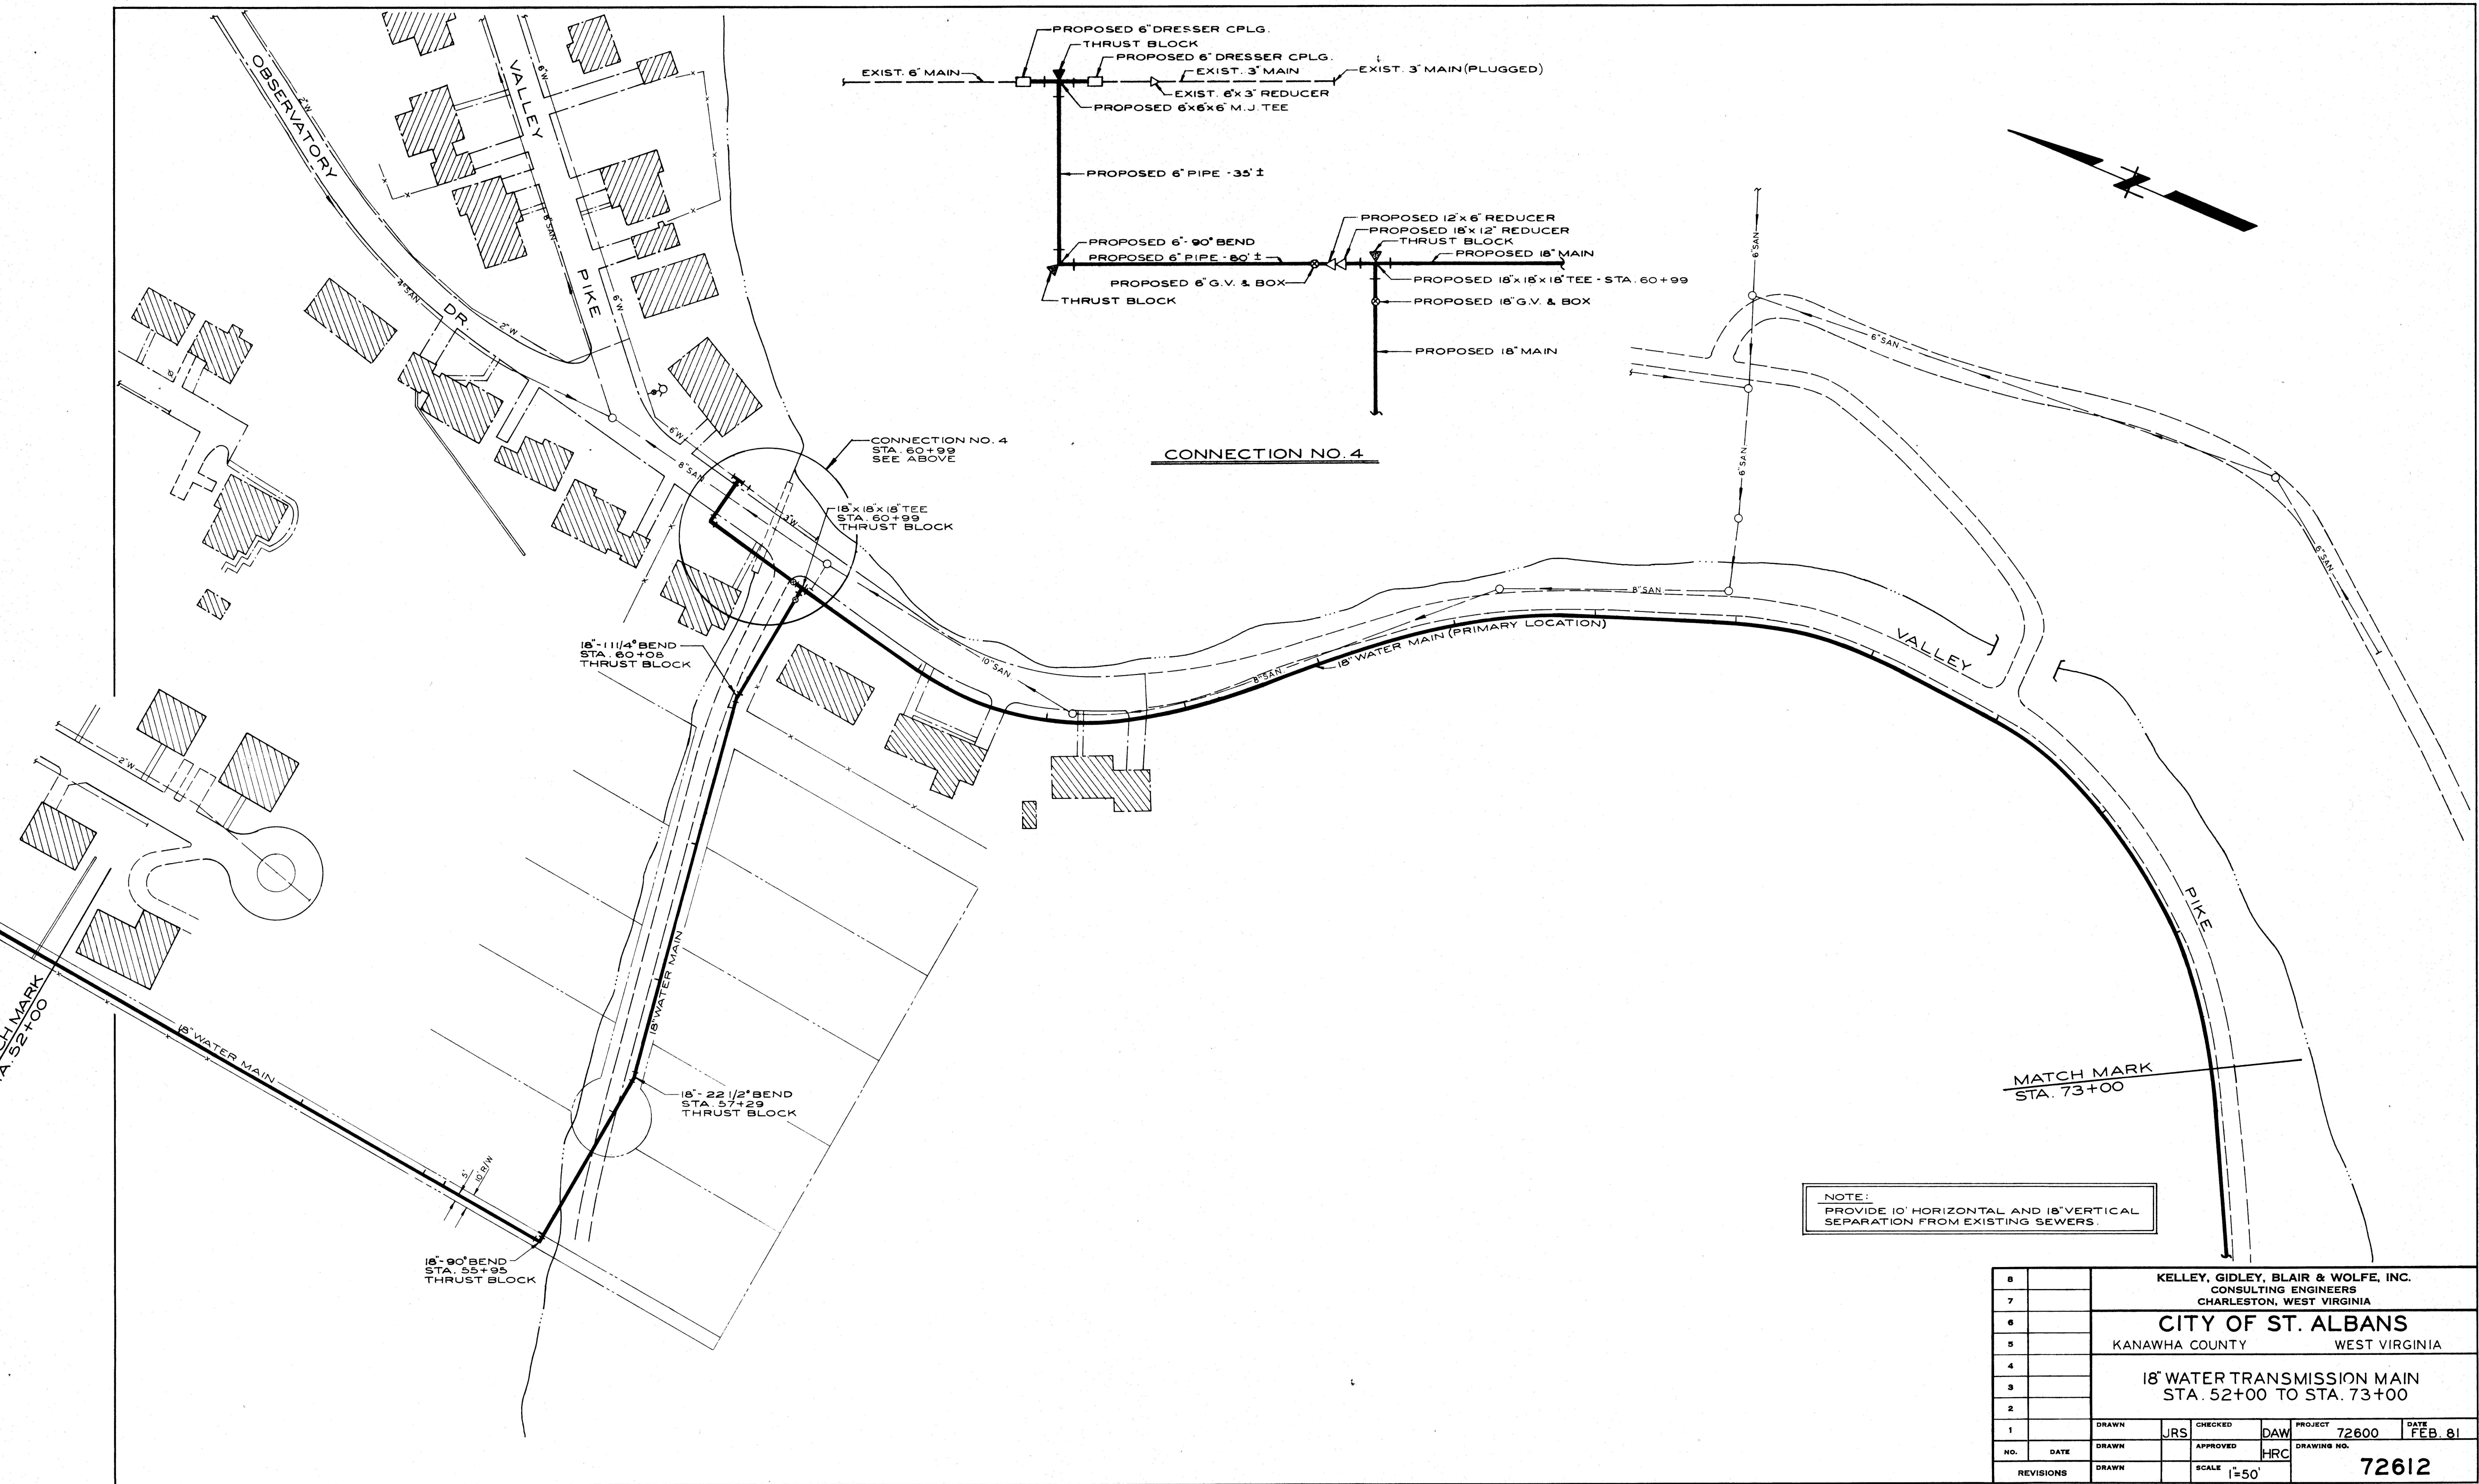

NOTE:
PROVIDE 10' HORIZONTAL AND 18" VERTICAL
SEPARATION FROM EXISTING SEWERS.

8		KELLEY, GIDLEY, BLAIR & WOLFE, INC. CONSULTING ENGINEERS CHARLESTON, WEST VIRGINIA			
7		CITY OF ST. ALBANS			
6		KANAWHA COUNTY WEST VIRGINIA			
5		18" WATER TRANSMISSION MAIN			
4		STA. 52+00 TO STA. 73+00			
3					
2					
1		DRAWN	JRS	CHECKED	DAW
NO.	DATE	DRAWN		APPROVED	HRC
REVISIONS		DRAWN		SCALE	1"=50'
				PROJECT	72600
				DATE	FEB. 81
				DRAWING NO.	72612